


0K2438

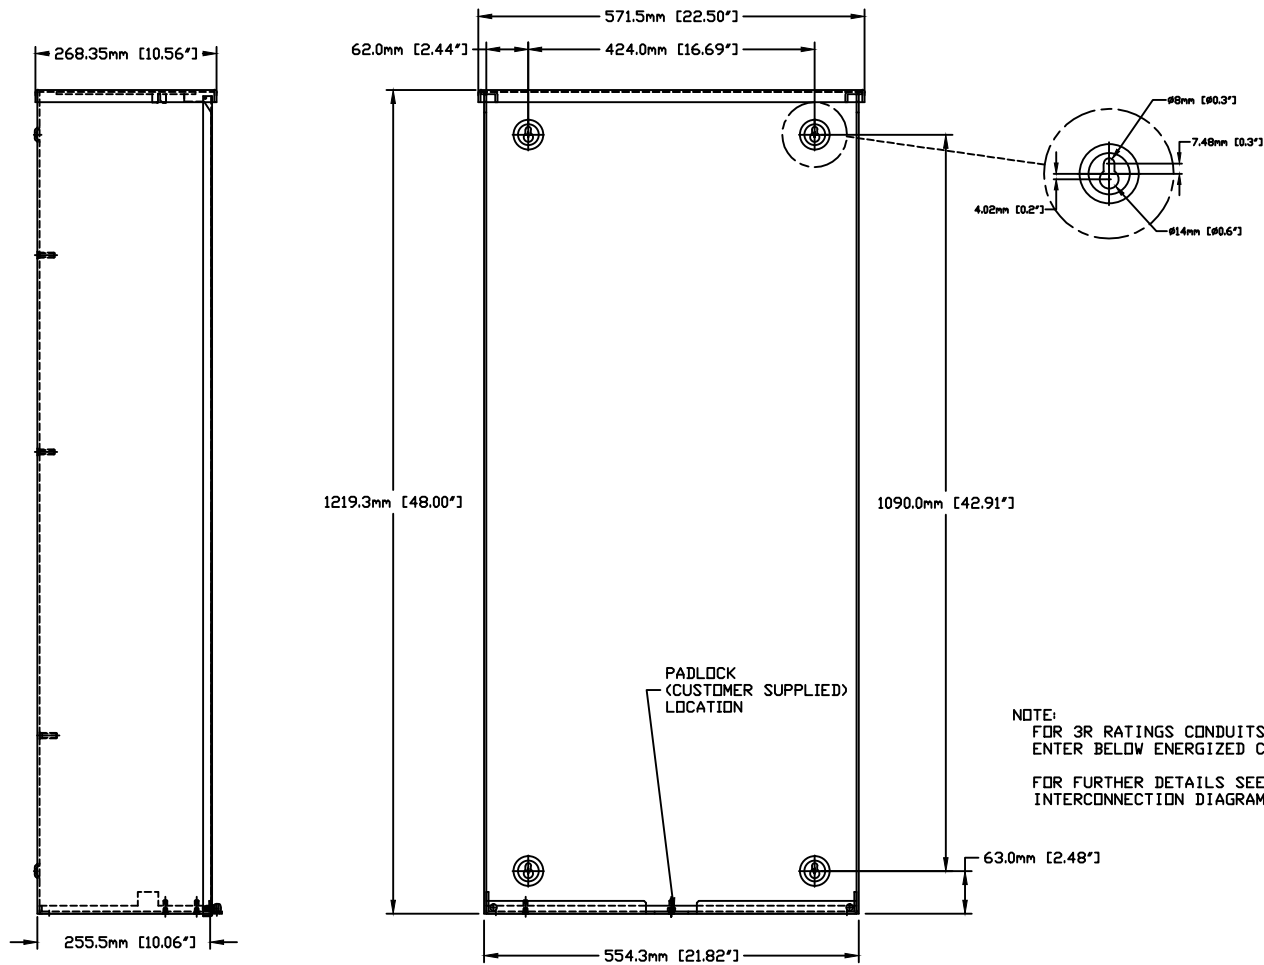

NOTE:
FOR 3R RATINGS CONDUITS MUST
ENTER BELOW ENERGIZED COMPONENTS
FOR FURTHER DETAILS SEE
INTERCONNECTION DIAGRAM IN THIS MANUAL.

-A- RELEASED FOR PRODUCTION				EST. VT. FINAL VT.				DRAWING TITLE INSTALLATION DRAWING 400A SERVICE ENTRANCE				GENERAC POWER SYSTEMS P.O. BOX # WAUKESHA, WIS. 53187			
				DO NOT SCALE				MATERIAL N/A				FILE NAME 0K2438.DWG			
				UNLESS OTHERWISE SPECIFIED:				DATE 3/6/13				SCALE 1 = 5			
				ALL DIMENSIONS AND TOLERANCES PER ASME Y14.5M-1994				DATE 3/10/13				FIRST USE 2013 RTSY			
				ALL DIMENSIONS AND TOLERANCES PER ASME Y14.5M-1994				DATE 3/12/13				DWG NO. 0K2438			
				ALL DIMENSIONS AND TOLERANCES PER ASME Y14.5M-1994				DATE 3/10/13				REV A			
				ALL DIMENSIONS AND TOLERANCES PER ASME Y14.5M-1994				DATE 3/10/13							

THIS PAGE IS LEFT INTENTIONALLY BLANK

