

4

3

SH

1/2

REV

B

WINDCHILL VERSION

B.2

1

REMOVE PANEL TO ALLOW TANK VENTS TO TERMINATE OUTSIDE OF THE GENERATOR ENCLOSURE (CHECK LOCAL AND STATE CODE FOR APPLICABILITY)

INTERNAL DIVIDER PANEL SEPARATES FUEL TANK VENTILATION DUCT FROM THE ENGINE, ALTERNATOR AND EXHAUST SYSTEM

1046 [41.2]  
CENTER OF GRAVITY  
SEE NOTE 5

RADIATOR/EXHAUST DISCHARGE AIR (BOTH SIDES)

AIR INTAKE (BOTH SIDES)

SERVICE ITEM	2.4L
OIL FILL CAP	RIGHT SIDE
OIL DIP STICK	RIGHT SIDE
OIL FILTER	RIGHT SIDE
OIL DRAIN HOSE	RIGHT SIDE
RADIATOR DRAIN HOSE	LEFT SIDE
AIR CLEANER ELEMENT	LEFT SIDE
MUFFLER	FRONT
FAN BELT	EITHER SIDE
BATTERY	LEFT SIDE

REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS.

TOP VIEW

173  
[6.8]

618 [24.3]

LIFT DOOR PROVIDES ACCESS TO: FUEL FILL, FUEL LEVEL GAUGE, NORMAL VENT, INNER TANK EMERGENCY VENT, OUTER TANK EMERGENCY VENT, OPTIONAL 90% ALARM ASSEMBLY, OPTIONAL 5 GALLON SPILL BOX

RADIATOR/EXHAUST DISCHARGE AIR

758 [29.8]  
DOOR TYP

REAR ENCLOSURE COVER PANEL  
SEE NOTE 4  
CIRCUIT BREAKER  
SEE NOTE 3

CUSTOMER ACCESS ASSEMBLY, CONTROL PANEL ACCESS, BATTERY CHARGER LOCATED WITHIN  
SEE NOTE 4

REAR TANK COVER  
SEE NOTE 4


FUEL TANK VENTILATION DUCT

EXHAUST MUFFLER ENCLOSED WITHIN GENERATOR ENCLOSURE

LEFT SIDE VIEW

OPEN PUNCHED LOUVERS TYPICAL ON BOTH SIDES OF FUEL TANK VENTILATION DUCT TO PROVIDE ADEQUATE CROSS-FLOW OF AIR VENTILATION


DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

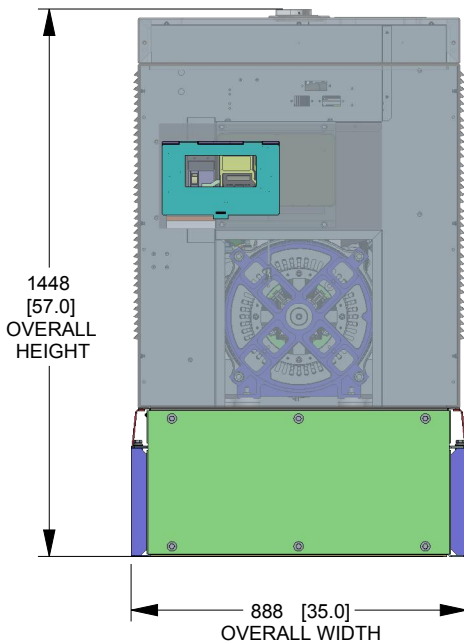

REAR VIEW

WISE ACTION LATCH, ONE PER DOOR, LIFT-OFF DOORS ON FRONT, RIGHT, AND LEFT SIDES

LIFTING PROVISIONS (4 PLACES)  
SEE NOTES 5, 9 AND CENTER OF GRAVITY DIMENSIONS

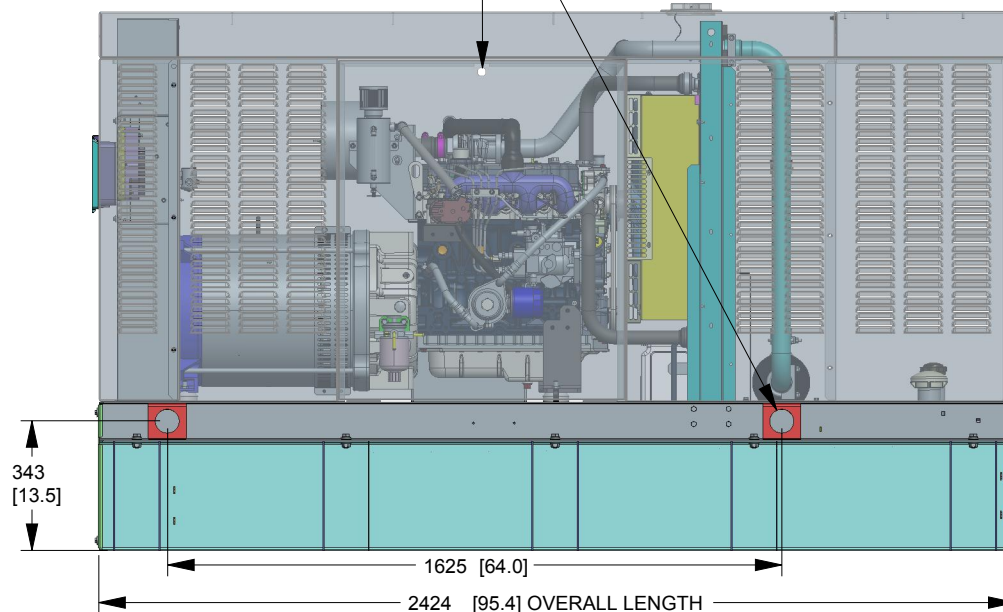

RIGHT SIDE VIEW

**GENERAC**

TITLE

INSTALL CPL PROT D2.4L EXT

ISSUE DATE:

SIZE  
B

CAGE NO

DWG NO

OK7002

REV  
B

SCALE

0.050

WT-KG

SEE ABOVE

SHEET

1 of 2

# INSTALLATION DRAWING


4

3

2

1



B

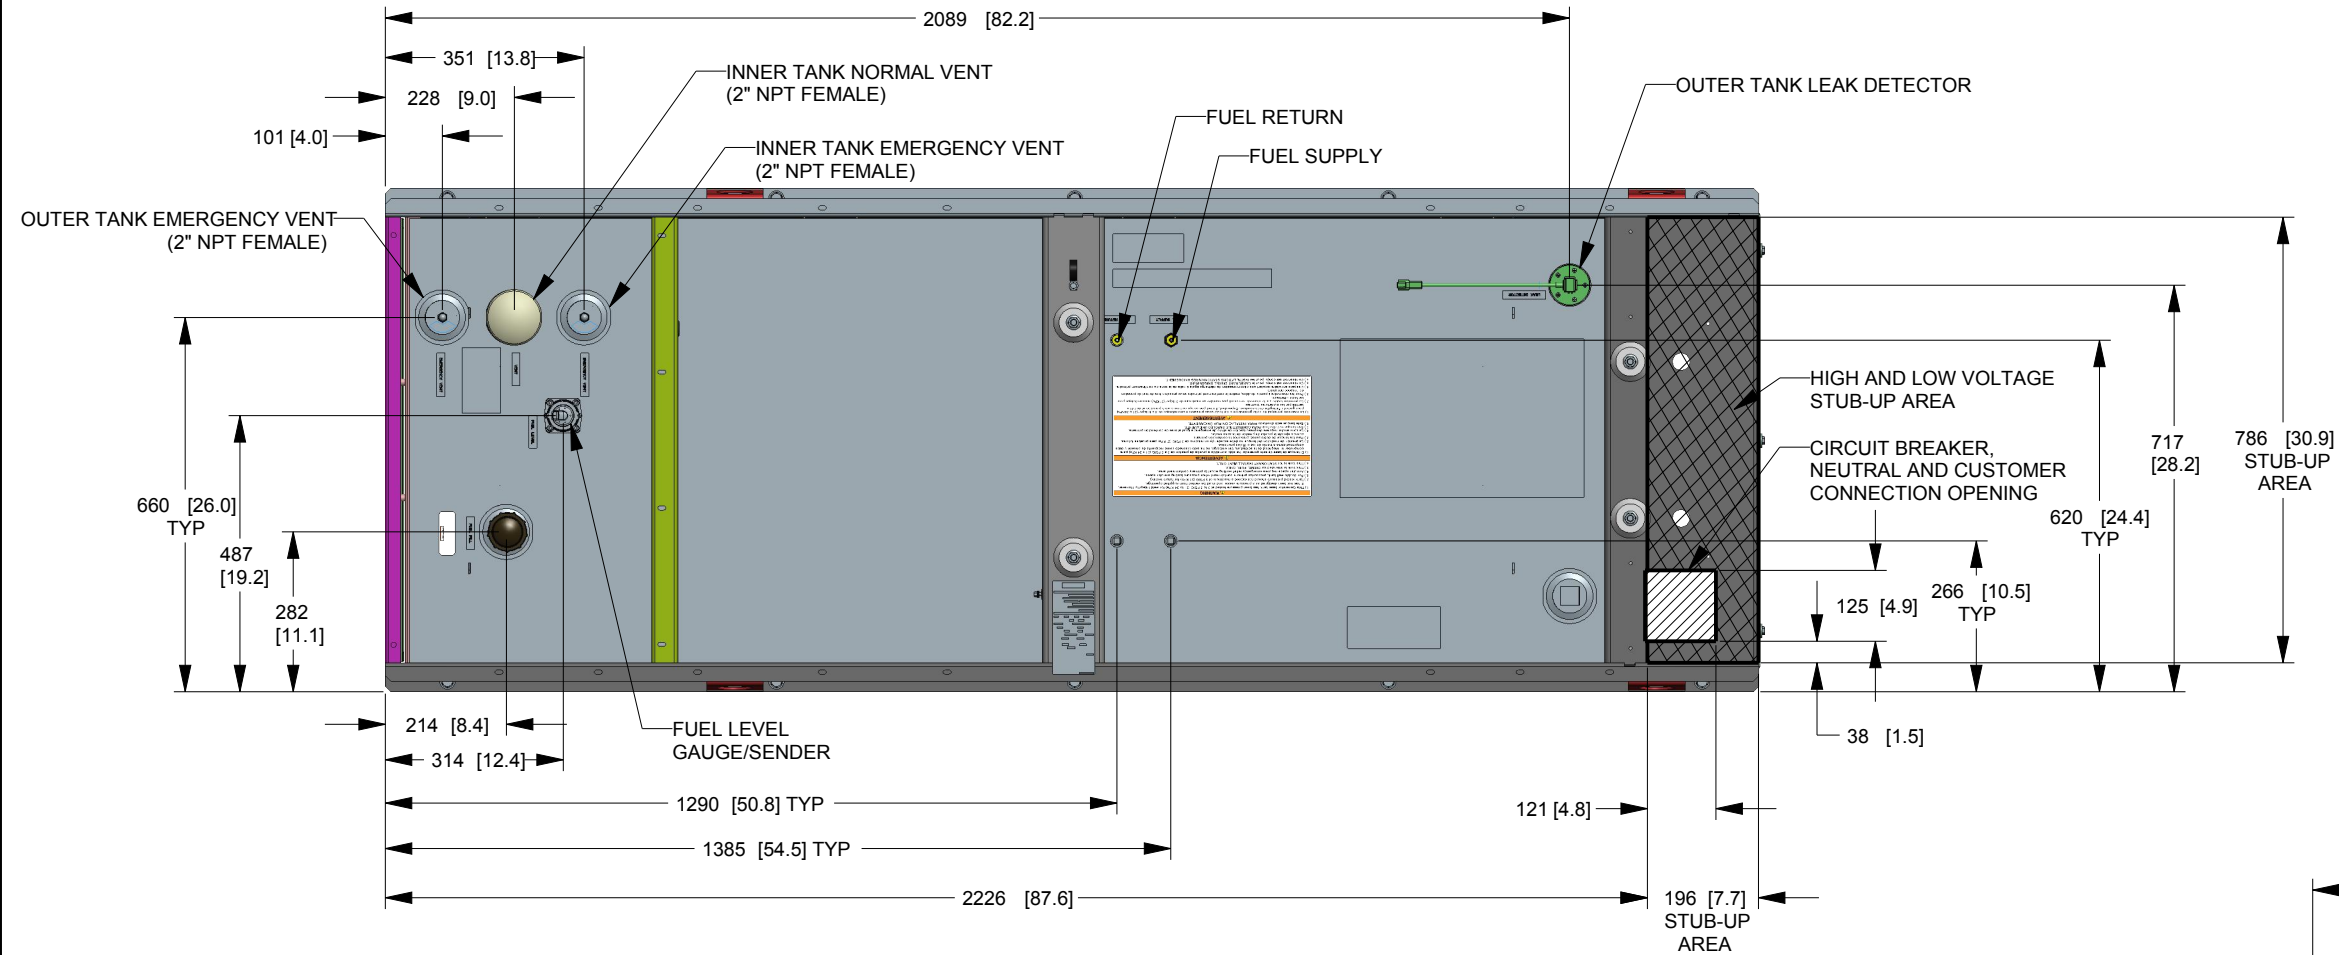

FUEL TANK	
TOTAL CAPACITY	233 [61]
USABLE CAPACITY	203 [55]

CAPACITY: LITER [GALLON]  
DIMENSIONS: MM [INCH]  
TANK IS LISTED TO UL142 AND  
ULC/ORD C142.18

A

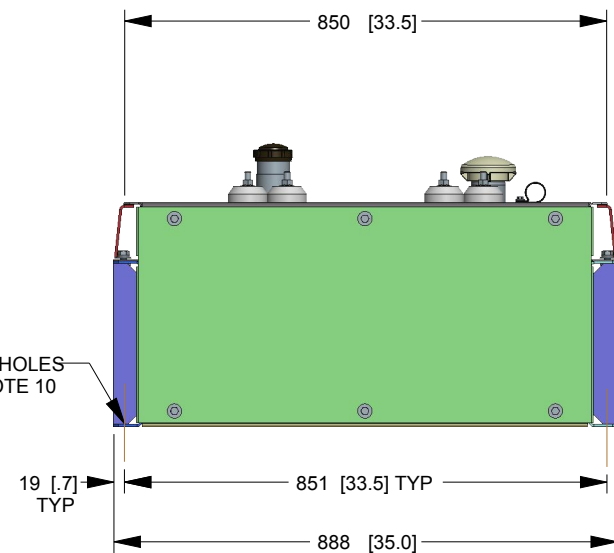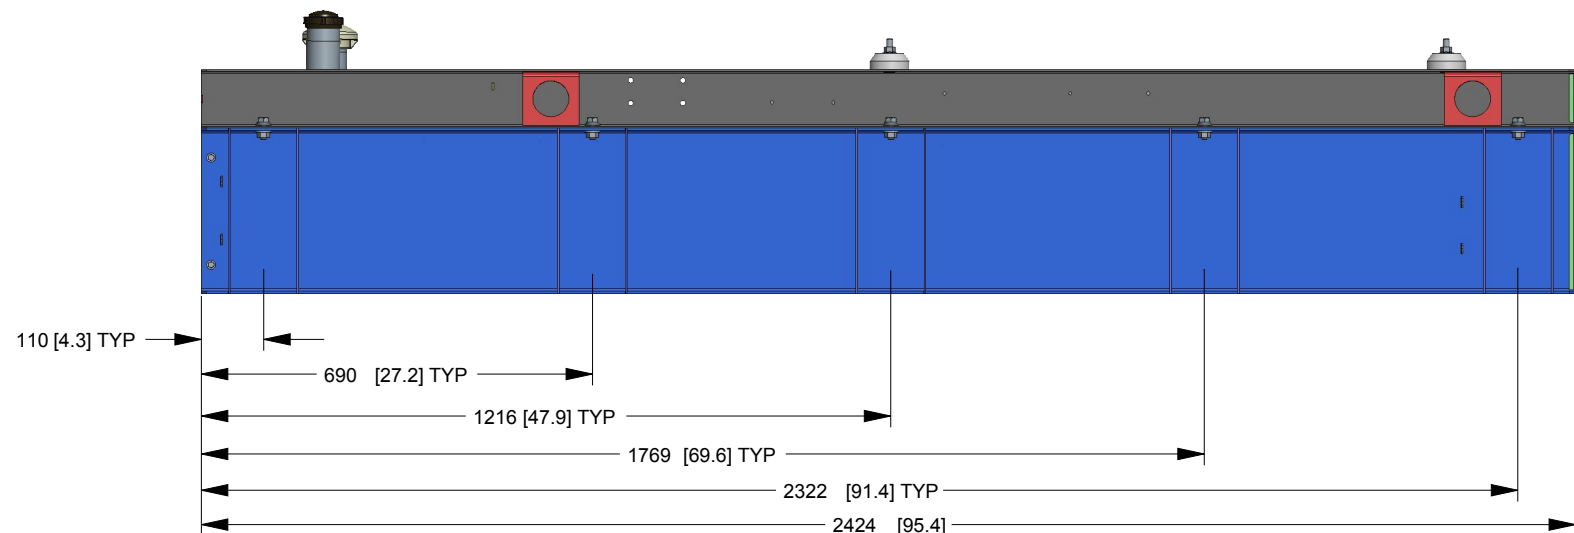

B

A

DRAWING CREATED FROM PRO/ENGINEER  
3D FILE. ECO MODIFICATION TO BE  
APPLIED TO SOLID MODEL ONLY.

# INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING  
WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR  
ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT  
THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS.  
©GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED  
INSIDE WINDCHILL



TITLE				
INSTALL CPL PROT D2.4L EXT				
ISSUE DATE:				
SIZE B	CAGE NO	DWG NO OK7002	REV B	
SCALE	0.075	WT-KG	SEE ABOVE	SHEET 2 of 2