


GROUP G

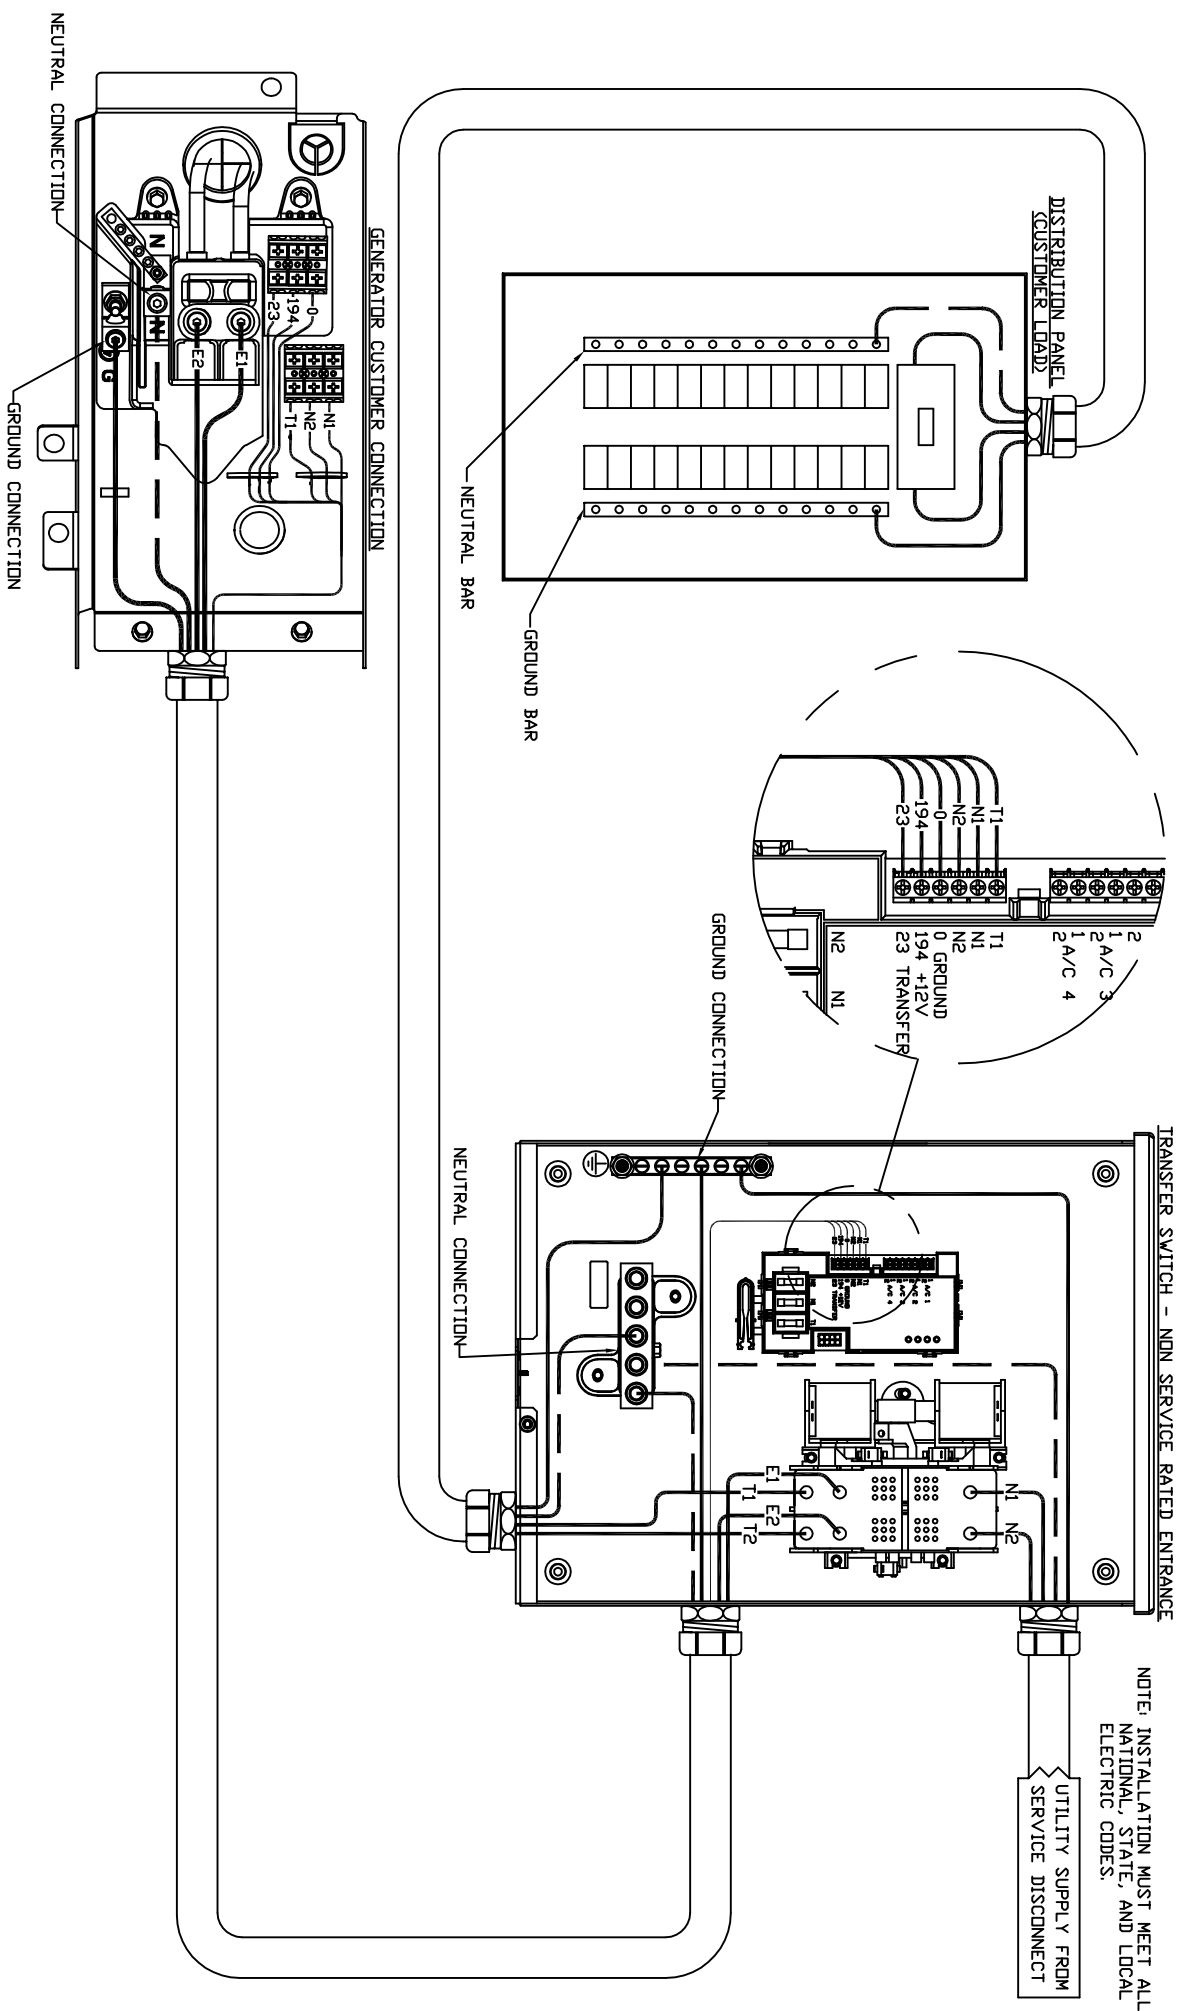

NON SERVICE ENTRANCE SWITCH INTERCONNECT

GROUP G

NOTE: INSTALLATION MUST MEET ALL NATIONAL, STATE, AND LOCAL ELECTRIC CODES.

