


4

3

1

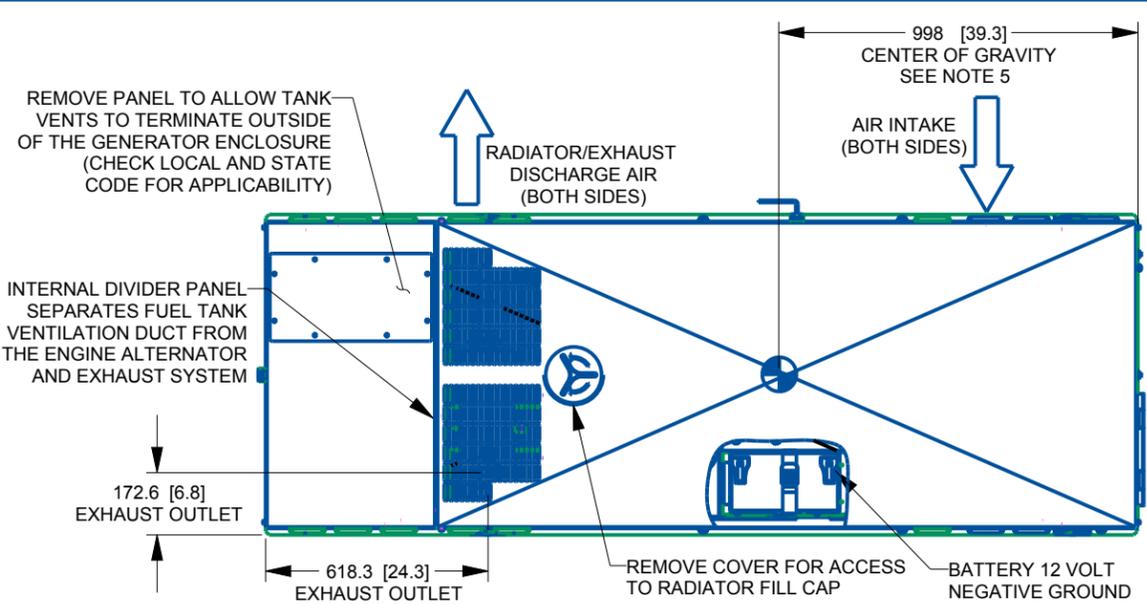

SERVICE ITEM	3.4L	WEIGHT DATA WITH EMPTY BASETANK (SEE NOTE 5)	
OIL FILL CAP	RIGHT SIDE	GENERATOR AS SHOWN	1094 [2411]
OIL DIP STICK	RIGHT SIDE	WITH WOODEN SHIPPING SKID	1139 [2511]
OIL FILTER	RIGHT SIDE	WEIGHT: KG [LBS]	
OIL DRAIN HOSE	RIGHT SIDE	DIMENSIONS: MM [INCH]	
RADIATOR DRAIN HOSE	LEFT SIDE		
AIR CLEANER ELEMENT	RIGHT SIDE		
MUFFLER	FRONT		
FAN BELT	EITHER SIDE		
BATTERY	LEFT SIDE		




REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS

NOTES:

1. MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1194 (47") WIDE X 2718 (107") LONG. REFERENCE INSTALLATION GUIDE SUPPLIED WITH UNIT FOR CONCRETE PAD GUIDELINES
2. ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE AND LOCAL CODES.
3. CONTROL PANEL / CIRCUIT BREAKER INFORMATION:
 - SEE SPECIFICATION SHEET OR OWNERS MANUAL
 - ACCESSIBLE THROUGH CUSTOMER ACCESS ASSEMBLY DOOR ON REAR OF GENERATOR
4. REMOVE THE REAR TANK AND REAR ENCLOSURE COVER PANEL TO ACCESS THE STUB-UP AREAS AS FOLLOWS:
 - HIGH VOLTAGE CONNECTION INCLUDING AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION, BATTERY CHARGER 120 VOLT AC (0.5 AMP MAX) CONNECTION.
 - LOW VOLTAGE CONNECTIONS INCLUDING TRANSFER SWITCH CONTROL WIRES
5. CENTER OF GRAVITY AND WEIGHT MAY CHANGE DUE TO UNIT OPTIONS.
6. ENGINE SERVICE CONNECTIONS
 - OIL DRAIN: 3/8" NPT
 - EXHAUST OUTLET: 2" O.D.
7. BOTTOM OF GENERATOR SET MUST BE ENCLOSED TO PREVENT PEST INTRUSION AND RECIRCULATION OF DISCHARGE AIR AND/OR IMPROPER COOLING AIR FLOW.
8. REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
9. MOUNTING BOLTS OR STUDS TO CONCRETE PAD SHALL BE 5/8-11 GRADE 5 (USE STANDARD SAE TORQUE SPECS)

B

B

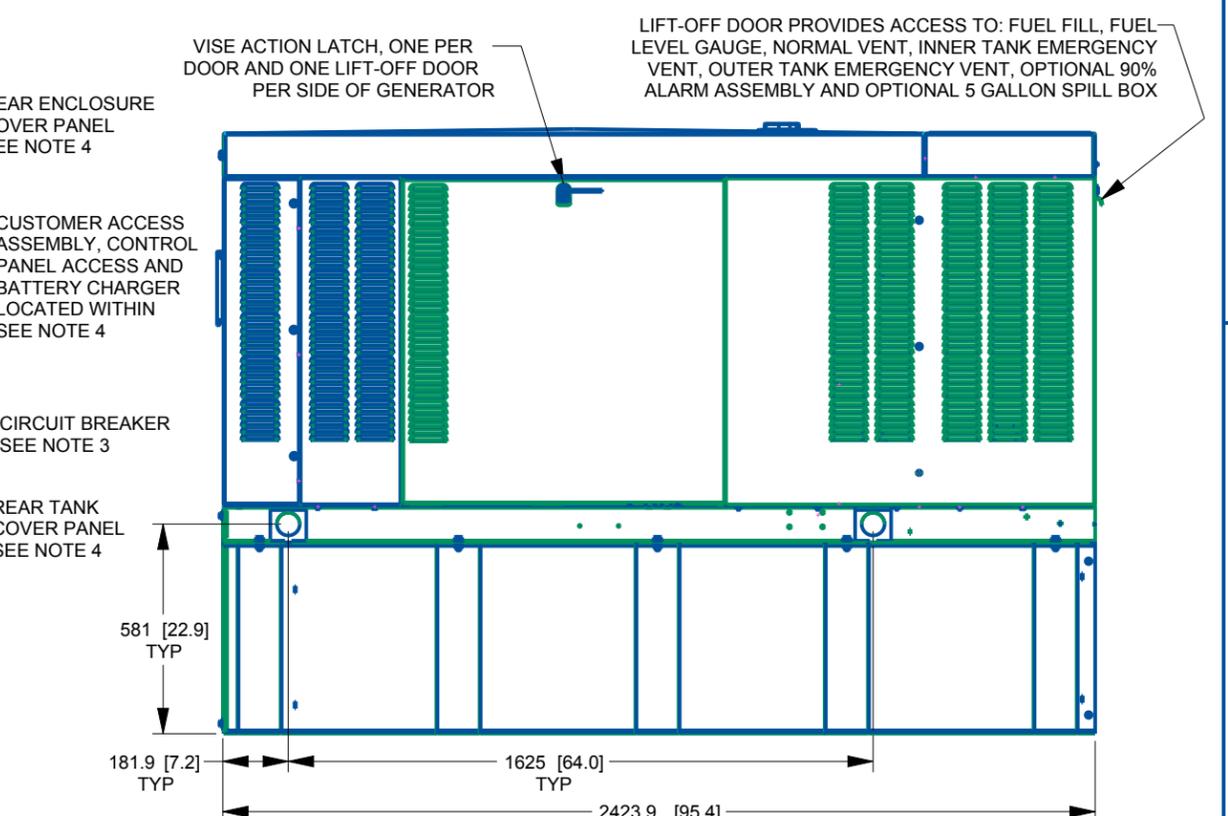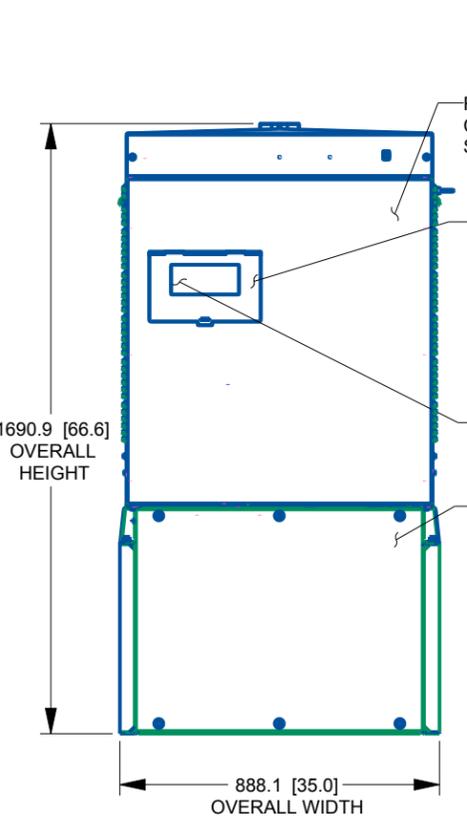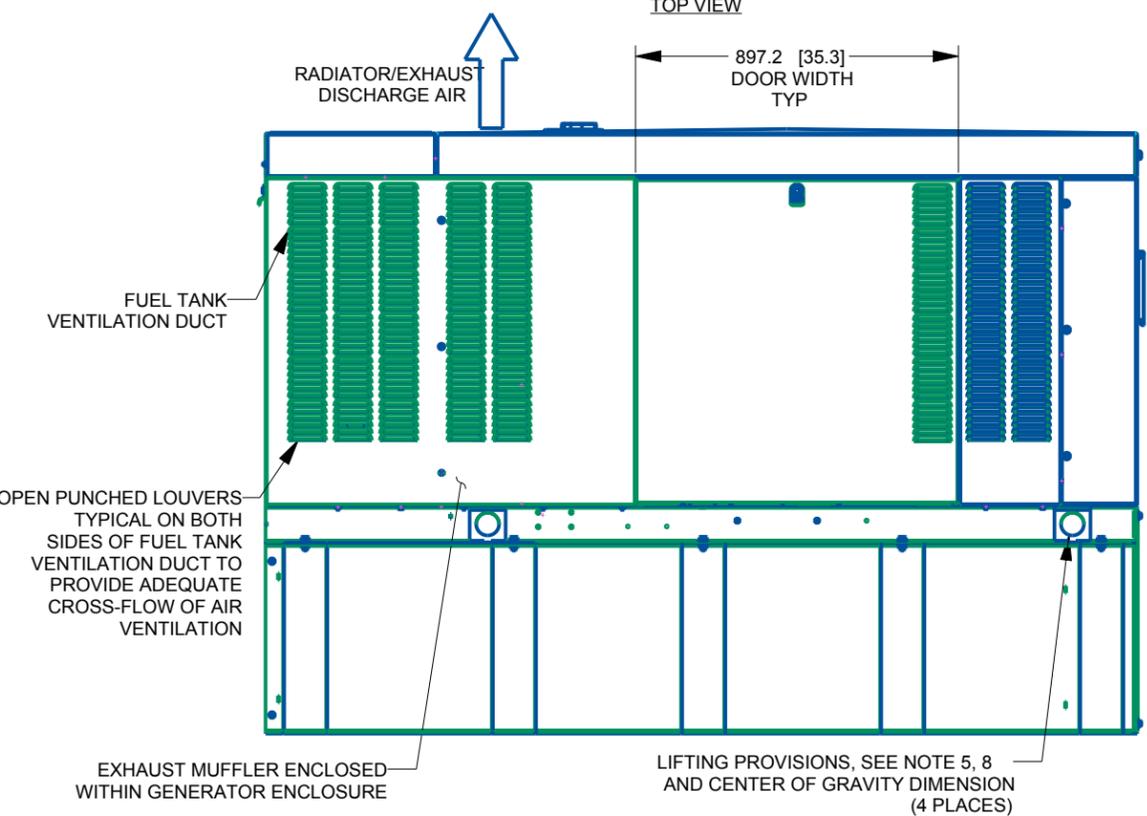

A

A

DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. ©GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED
INSIDE WINDCHILL




TITLE				
INSTALL PROTECTOR D3.4L G16 132 GAL TANK				
ISSUE DATE:		08/2018		
SIZE	CAGE NO	DWG NO	REV	
B	N/A	10000043316	A	
SCALE	0.050	WT-KG	SEE ABOVE	SHEET 1 of 2

4

3

2

1

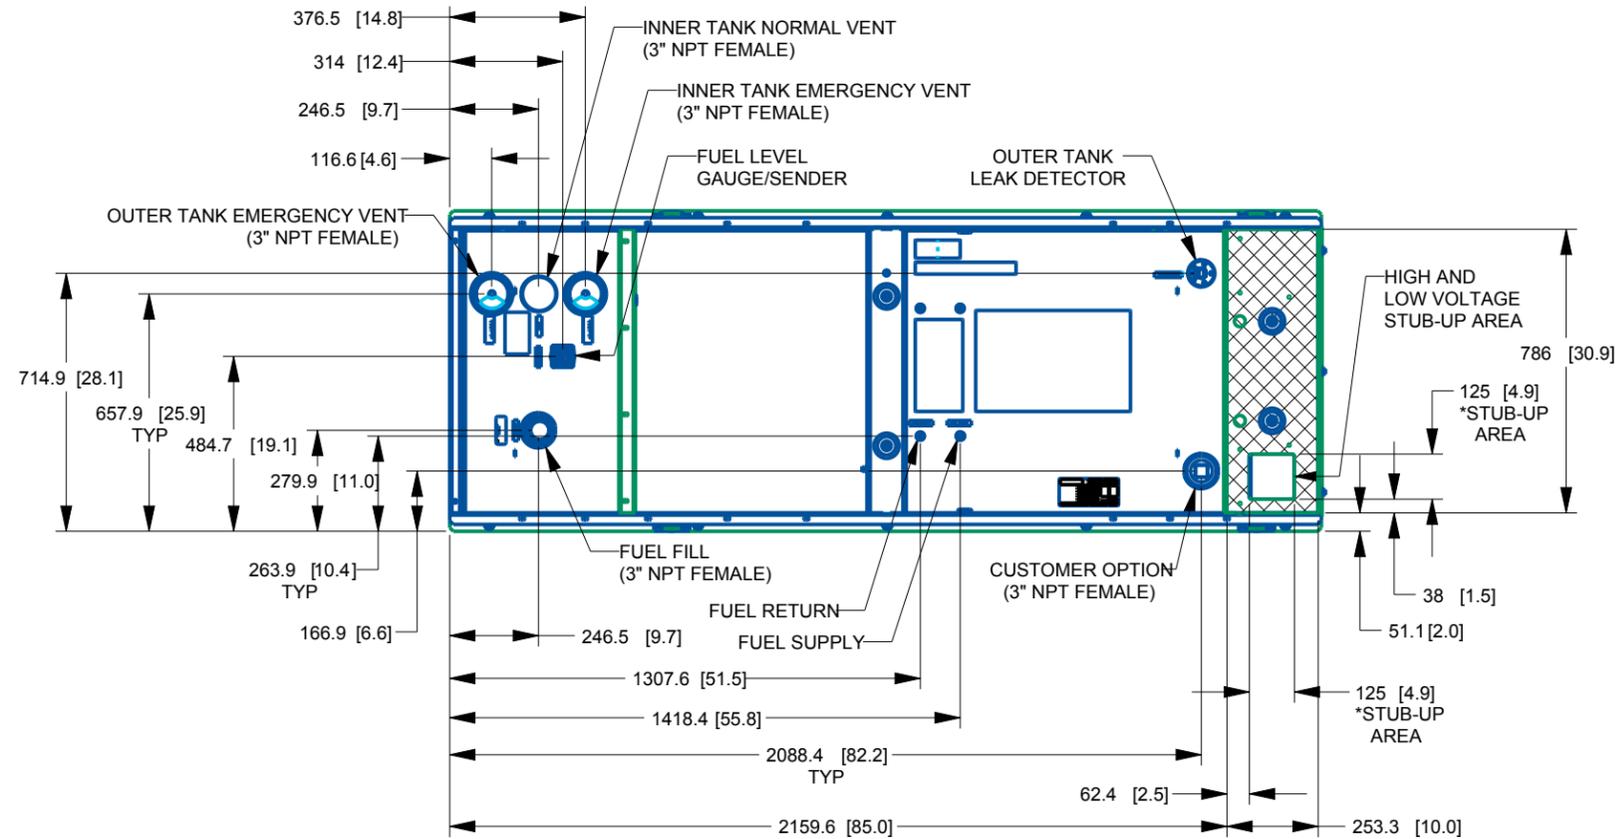

FUEL TANK	
TOTAL CAPACITY	524 [138.5]
USABLE CAPACITY	500 [132]

CAPACITY: LITER [GALLONS]
 DIMENSIONS: MM [INCH]

THIS TANK IS LISTED TO UL142 AND ULC5601

*NOTE: STUB-UP AREA FOR HIGH AND LOW VOLTAGE CONNECTIONS, CIRCUIT BREAKER, NEUTRAL AND CUSTOMER CONNECTION OPENING.


B

B


A

A

TOP VIEW

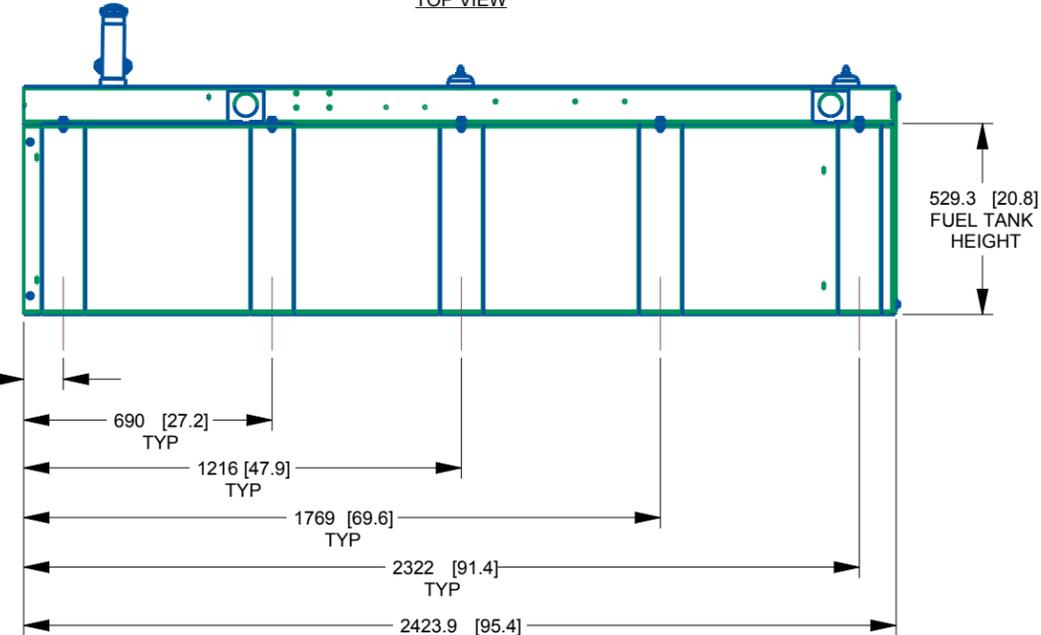

LEFT SIDE VIEW

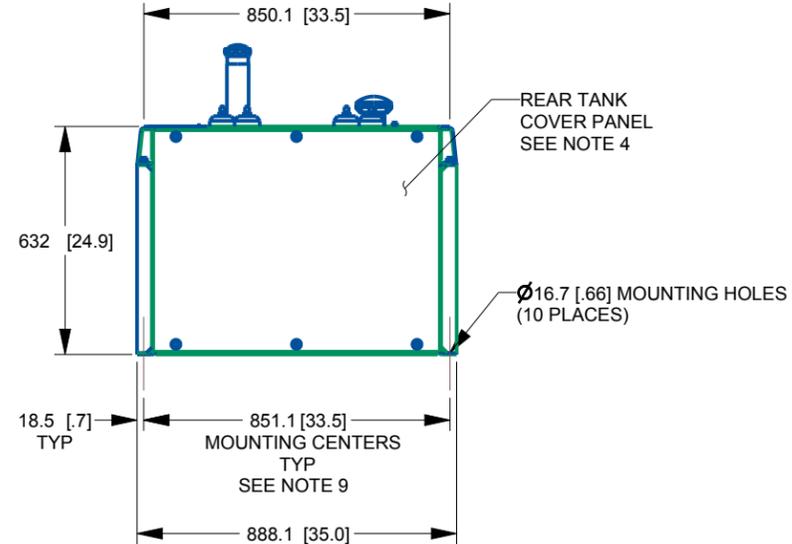

REAR VIEW

DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. ©GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED
INSIDE WINDCHILL



TITLE				
INSTALL PROTECTOR D3.4L G16 132 GAL TANK				
ISSUE DATE:		08/2018		
SIZE	CAGE NO	DWG NO	10000043316	REV
B	N/A			A
SCALE	0.050	WT-KG	SEE ABOVE	SHEET 2 of 2