



HOLE LOCATIONS FOR
OPTIONAL MOUNTING TO
A CONCRETE PAD


16 [5/8] DIA. CLEARANCE
HOLE (3) PLACES,
10 [3/8] DIA. MASONRY ANCHOR
BOLTS RECOMMENDED

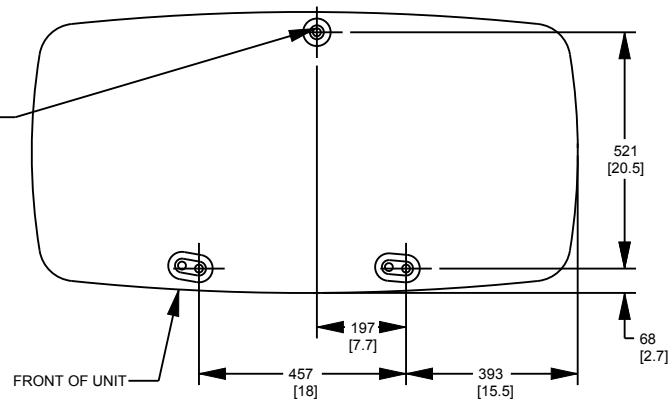

MOUNTING TO CONCRETE PAD

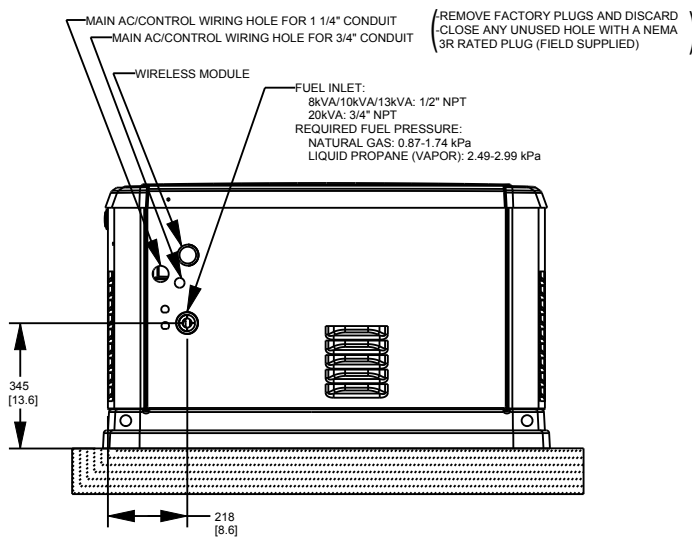

REAR VIEW

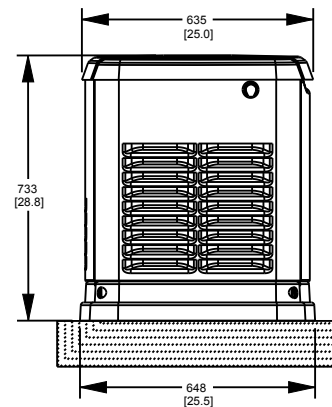

LEFT SIDE VIEW

INSTALLATION DRAWING

TITLE

INSTALL HSB GENERATOR AU WM 50HZ

SIZE
A

CAGE NO
N/A

DWG NO
10000010257

REV
C

SCALE

NTS


WT-KG

N/A


SHEET

1 of 2


ALL DIMENSIONS IN:
MILLIMETERS [INCHES]

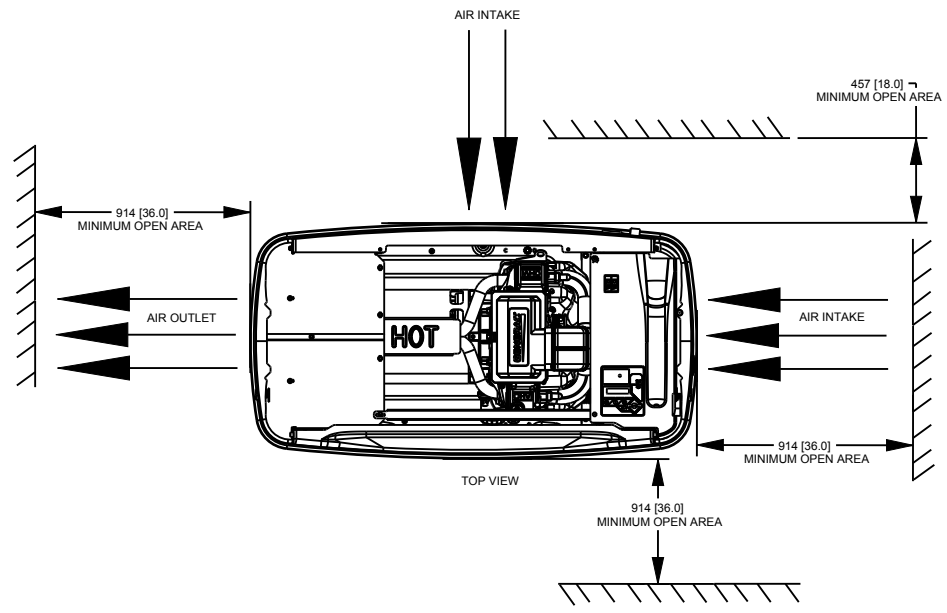



"DO NOT LIFT BY ROOF"

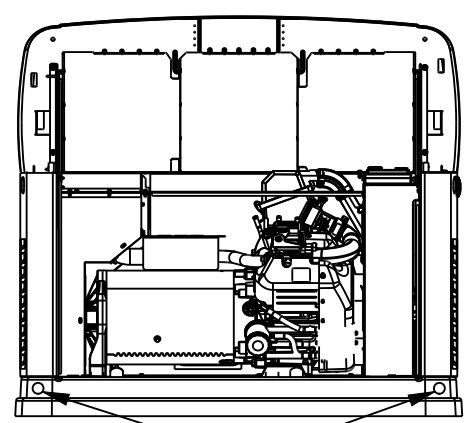

LIFTING HOLES 4 CORNERS: $\varnothing 30$ $\varnothing 1.2$
- MUST BE LIFTED WITH STEEL RODS
- RECOMMENDED LIFTING ROD SIZE: $\varnothing 25$ $\varnothing 1.0$

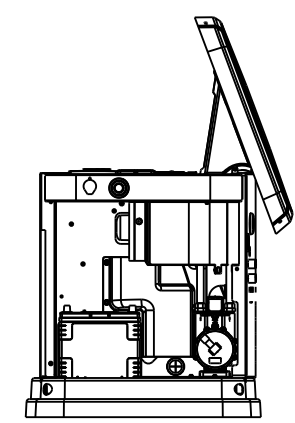

RIGHT VIEW
(INTAKE PANEL REMOVED)

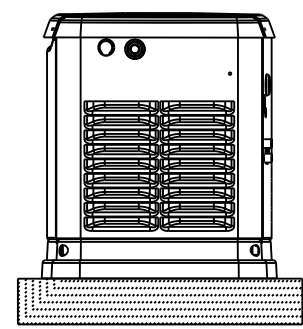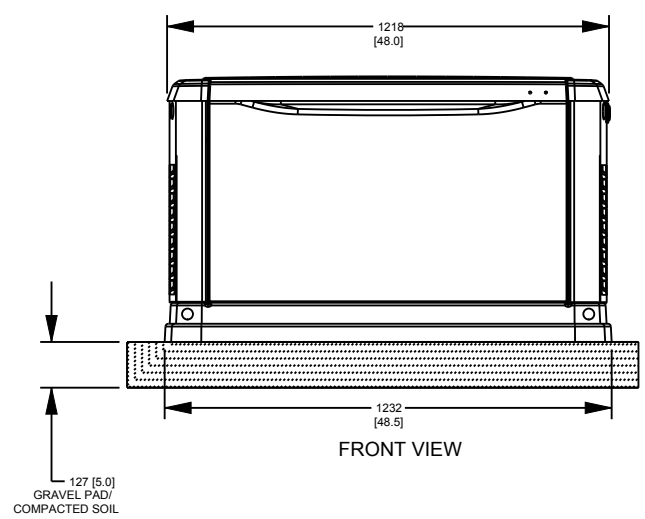

RIGHT SIDE VIEW

INSTALLATION DRAWING

TITLE						INSTALL HSB GENERATOR AU WM 50HZ					
SIZE		CAGE NO		DWG NO		10000010257				REV	
A		N/A								C	
SCALE		NTS		WT-KG		N/A		SHEET		2 of 2	

ALL DIMENSIONS IN:
MILLIMETERS [INCHES]