



HOLE LOCATIONS FOR
OPTIONAL MOUNTING TO
A CONCRETE PAD


16 [5/8] DIA. CLEARANCE
HOLE (3) PLACES,
10 [3/8] DIA. MASONRY ANCHOR
BOLTS RECOMMENDED

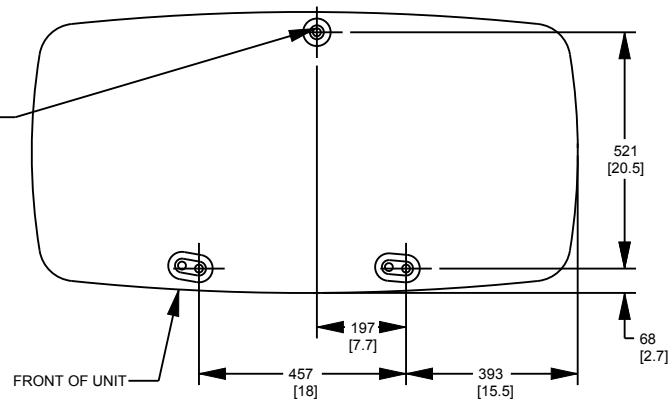

MOUNTING TO CONCRETE PAD

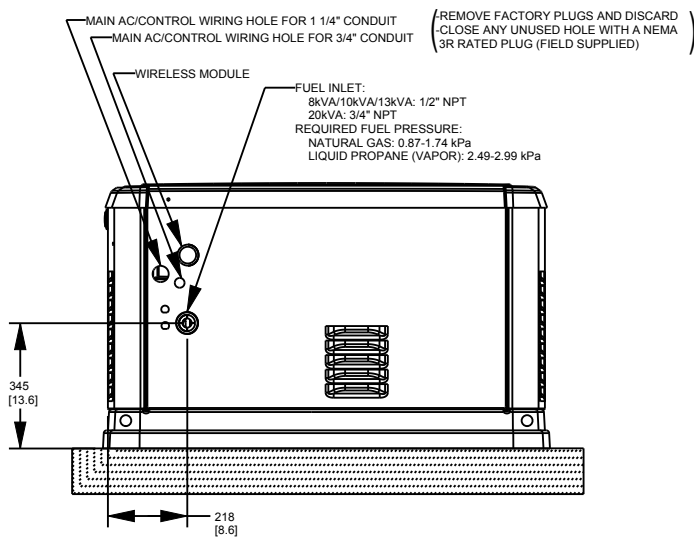

REAR VIEW

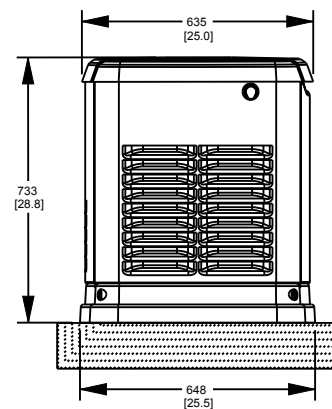

LEFT SIDE VIEW

INSTALLATION DRAWING

TITLE

INSTALL HSB GENERATOR AU WM 50HZ

SIZE

A

CAGE NO

N/A

DWG NO

10000010257

REV

C

SCALE

NTS


WT-KG

N/A


SHEET

1 of 2


ALL DIMENSIONS IN:
MILLIMETERS [INCHES]

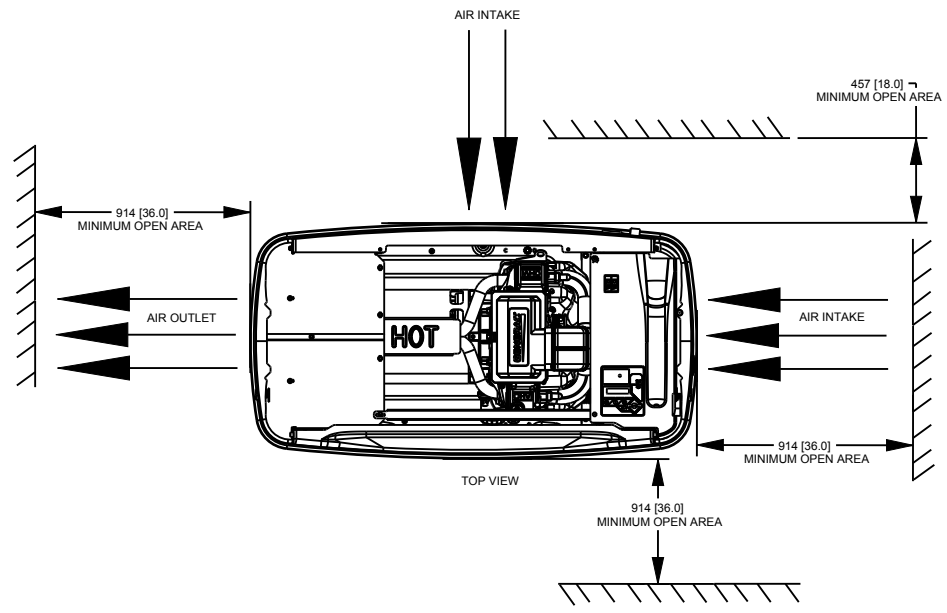



"DO NOT LIFT BY ROOF"

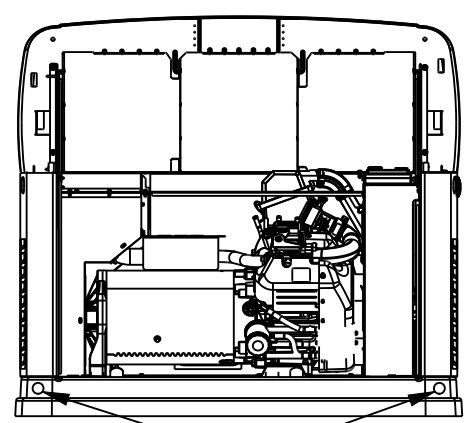

LIFTING HOLES 4 CORNERS: $\varnothing 30$ $\varnothing 1.2$
- MUST BE LIFTED WITH STEEL RODS
- RECOMMENDED LIFTING ROD SIZE: $\varnothing 25$ $\varnothing 1.0$

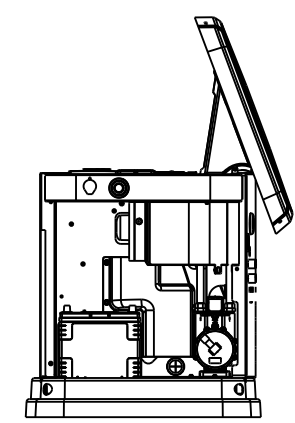

RIGHT VIEW
(INTAKE PANEL REMOVED)

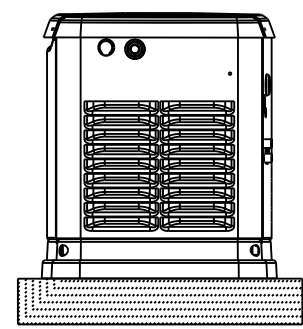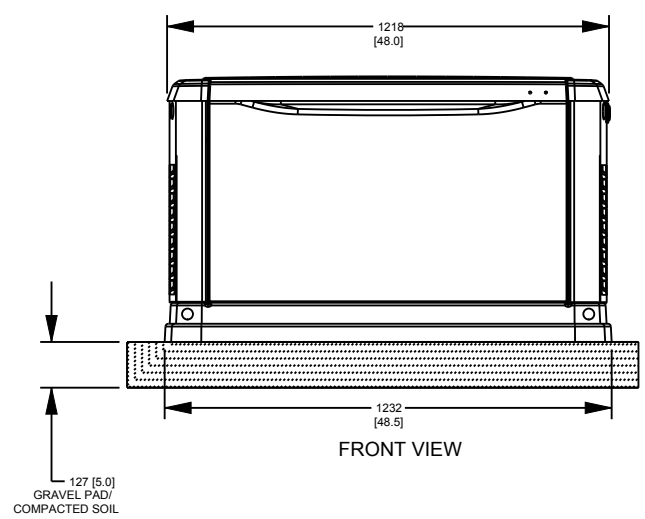

RIGHT SIDE VIEW

INSTALLATION DRAWING

TITLE				
INSTALL HSB GENERATOR AU WM 50HZ				
SIZE	CAGE NO	DWG NO	REV	
A	N/A	10000010257	C	
SCALE	NTS	WT-KG	N/A	SHEET 2 of 2

ALL DIMENSIONS IN:
MILLIMETERS [INCHES]