

4

3

SH

1/2


REV

A


WINDCHILL VERSION

A.1



1

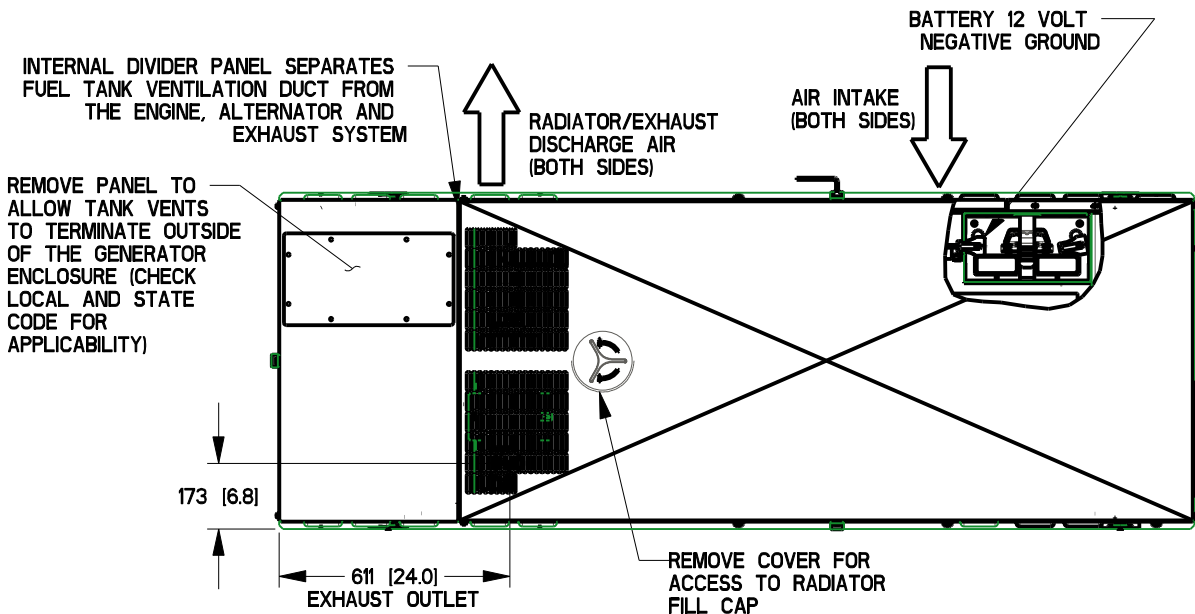

TOP VIEW

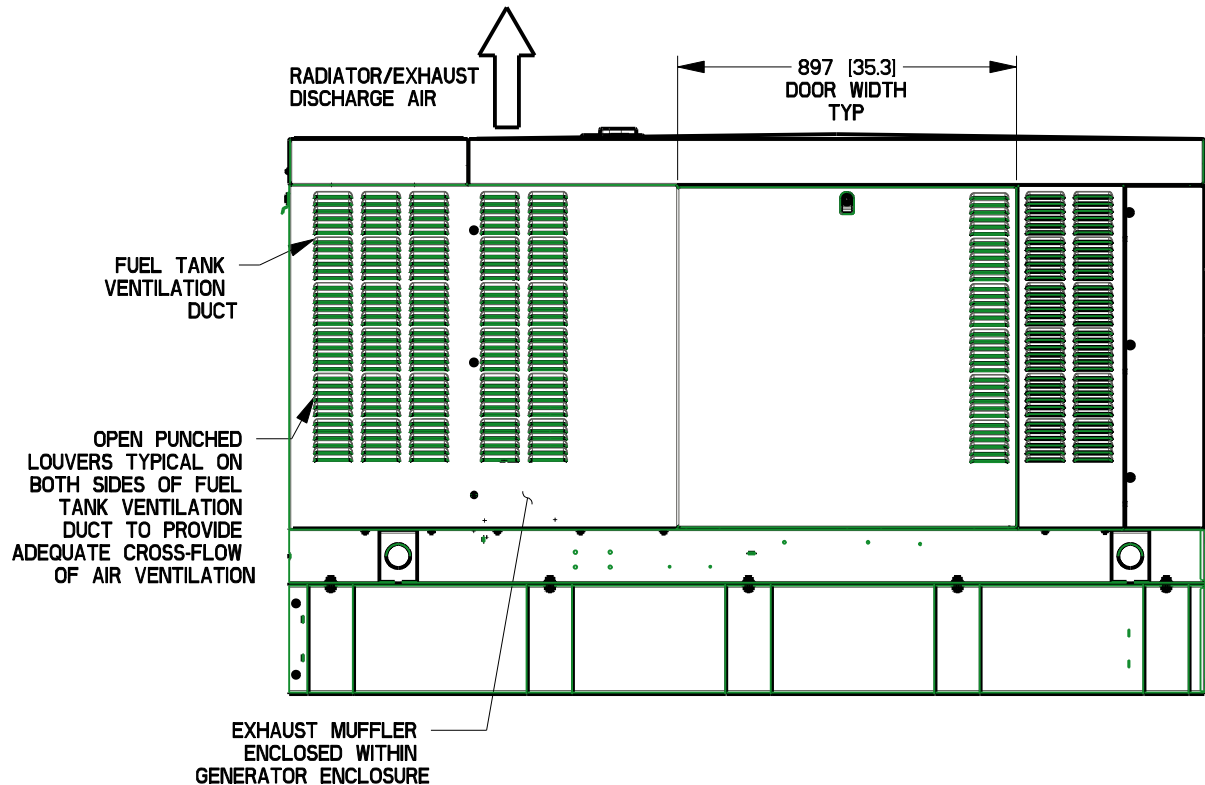

LEFT SIDE VIEW

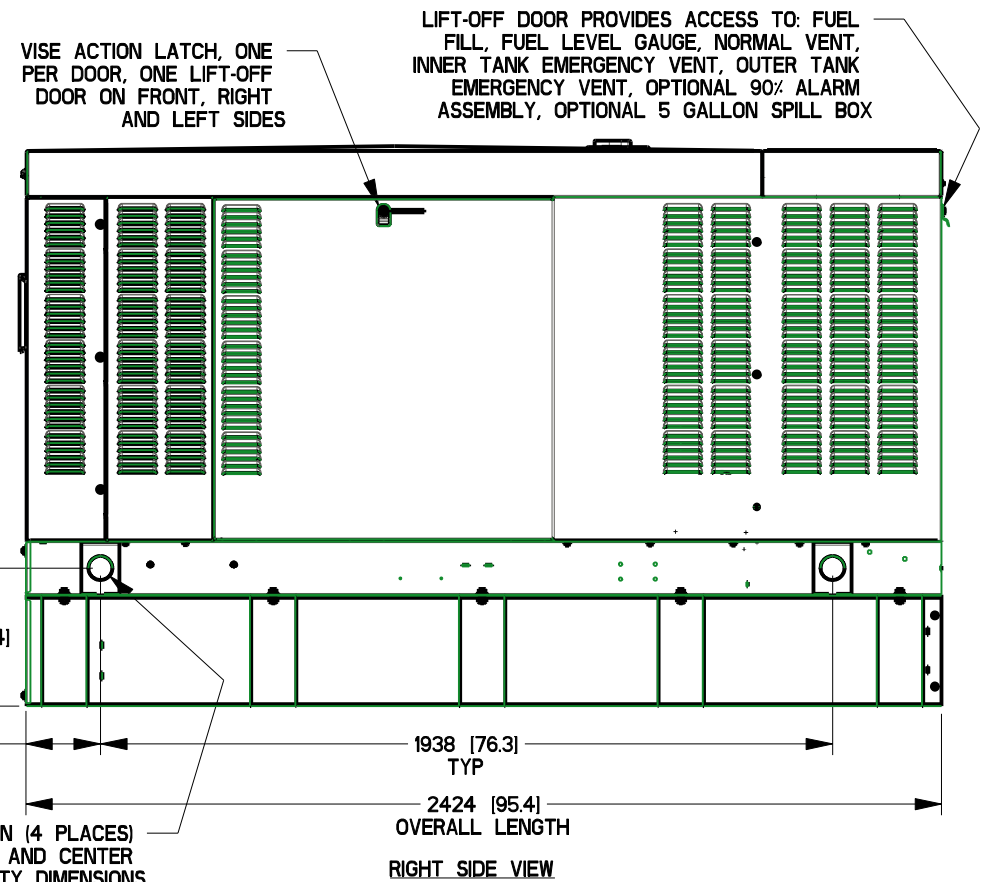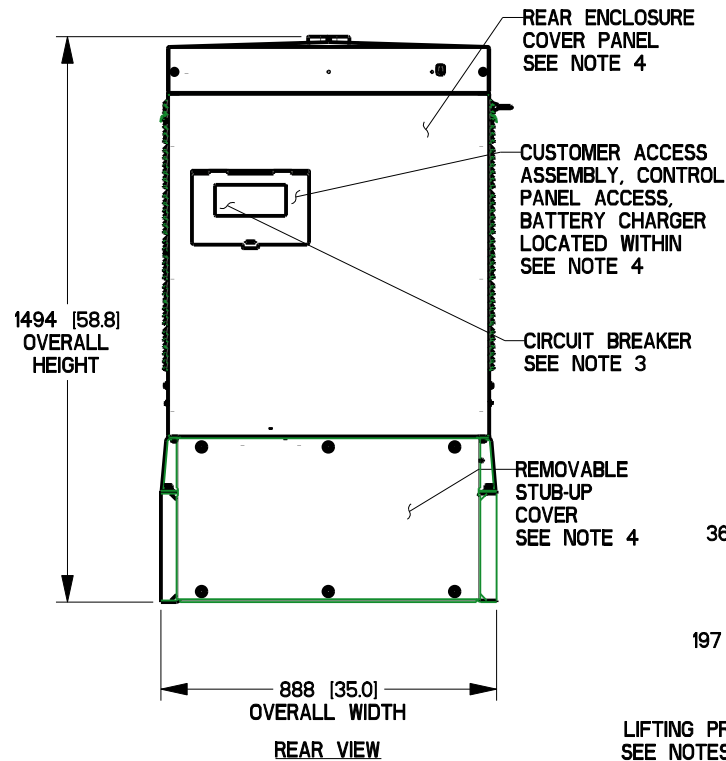

REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS

SERVICE ITEM	3.3L
OIL FILL CAP	LEFT
OIL DIP STICK	LEFT
OIL FILTER	LEFT
OIL DRAIN HOSE	RIGHT
RADIATOR DRAIN HOSE	RIGHT
COOLANT RECOVERY BOTTLE	LEFT
RADIATOR FILL CAP ACCESS	ROOF
AIR CLEANER ELEMENT	RIGHT
MUFFLER	FRONT
FAN BELT	EITHER
BATTERY	RIGHT

WEIGHT DATA WITH EMPTY BASETANK (SEE NOTE 5)	
GENERATOR AS SHOWN	**** [****]
WITH WOODEN SHIPPING SKID	**** [****]
WEIGHT: KG [LBS]	
DIMENSIONS: MM [INCH]	

NOTES:

1. MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1194 (47") WIDE X 2718 (107") LONG. REFERENCE INSTALLATION GUIDE SUPPLIED WITH UNIT FOR CONCRETE PAD GUIDELINES
2. ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE, AND LOCAL CODES.
3. CONTROL PANEL / CIRCUIT BREAKER INFORMATION:
 - SEE SPECIFICATION SHEET OR OWNERS MANUAL
 - ACCESSIBLE THROUGH CUSTOMER ACCESS ASSEMBLY DOOR ON REAR OF GENERATOR
4. REMOVE THE REAR TANK AND REAR ENCLOSURE COVER PANEL TO ACCESS THE STUB-UP AREAS AS FOLLOWS:
 - HIGH VOLTAGE CONNECTION INCLUDING AC LOAD LEAD CONDUIT CONNECTION
 - NEUTRAL CONNECTION, BATTERY CHARGER 120 VOLT AC (0.5 AMP MAX) CONNECTION.
 - LOW VOLTAGE CONNECTIONS INCLUDING TRANSFER SWITCH CONTROL WIRES
5. CENTER OF GRAVITY AND WEIGHT MAY CHANGE DUE TO UNIT OPTIONS.
6. ENGINE SERVICE CONNECTIONS
 - OIL DRAIN: 3/8" NPT
 - EXHAUST OUTLET: 2" OD.
7. BOTTOM OF GENERATOR SET MUST BE ENCLOSED TO PREVENT PEST INTRUSION AND AND RECIRCULATION OF DISCHARGE AIR AND/OR IMPROPER COOLING AIR FLOW.
8. REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
9. MOUNTING BOLTS OR STUDS TO CONCRETE PAD SHALL BE 5/8-11 GRADE 5 (USE STANDARD SAE TORQUE SPECS)

DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. © GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED
INSIDE WINDCHILL

GENERAC


TITLE

INSTALL PROTECTOR D3.3L G2
EXTENDED TANK


ISSUE DATE: 07/2017

SIZE	CAGE NO	DWG NO	REV
B	N/A	10000018949	A
SCALE	0.050	WT-KG	SEE ABOVE
SHEET	1	of	2

B

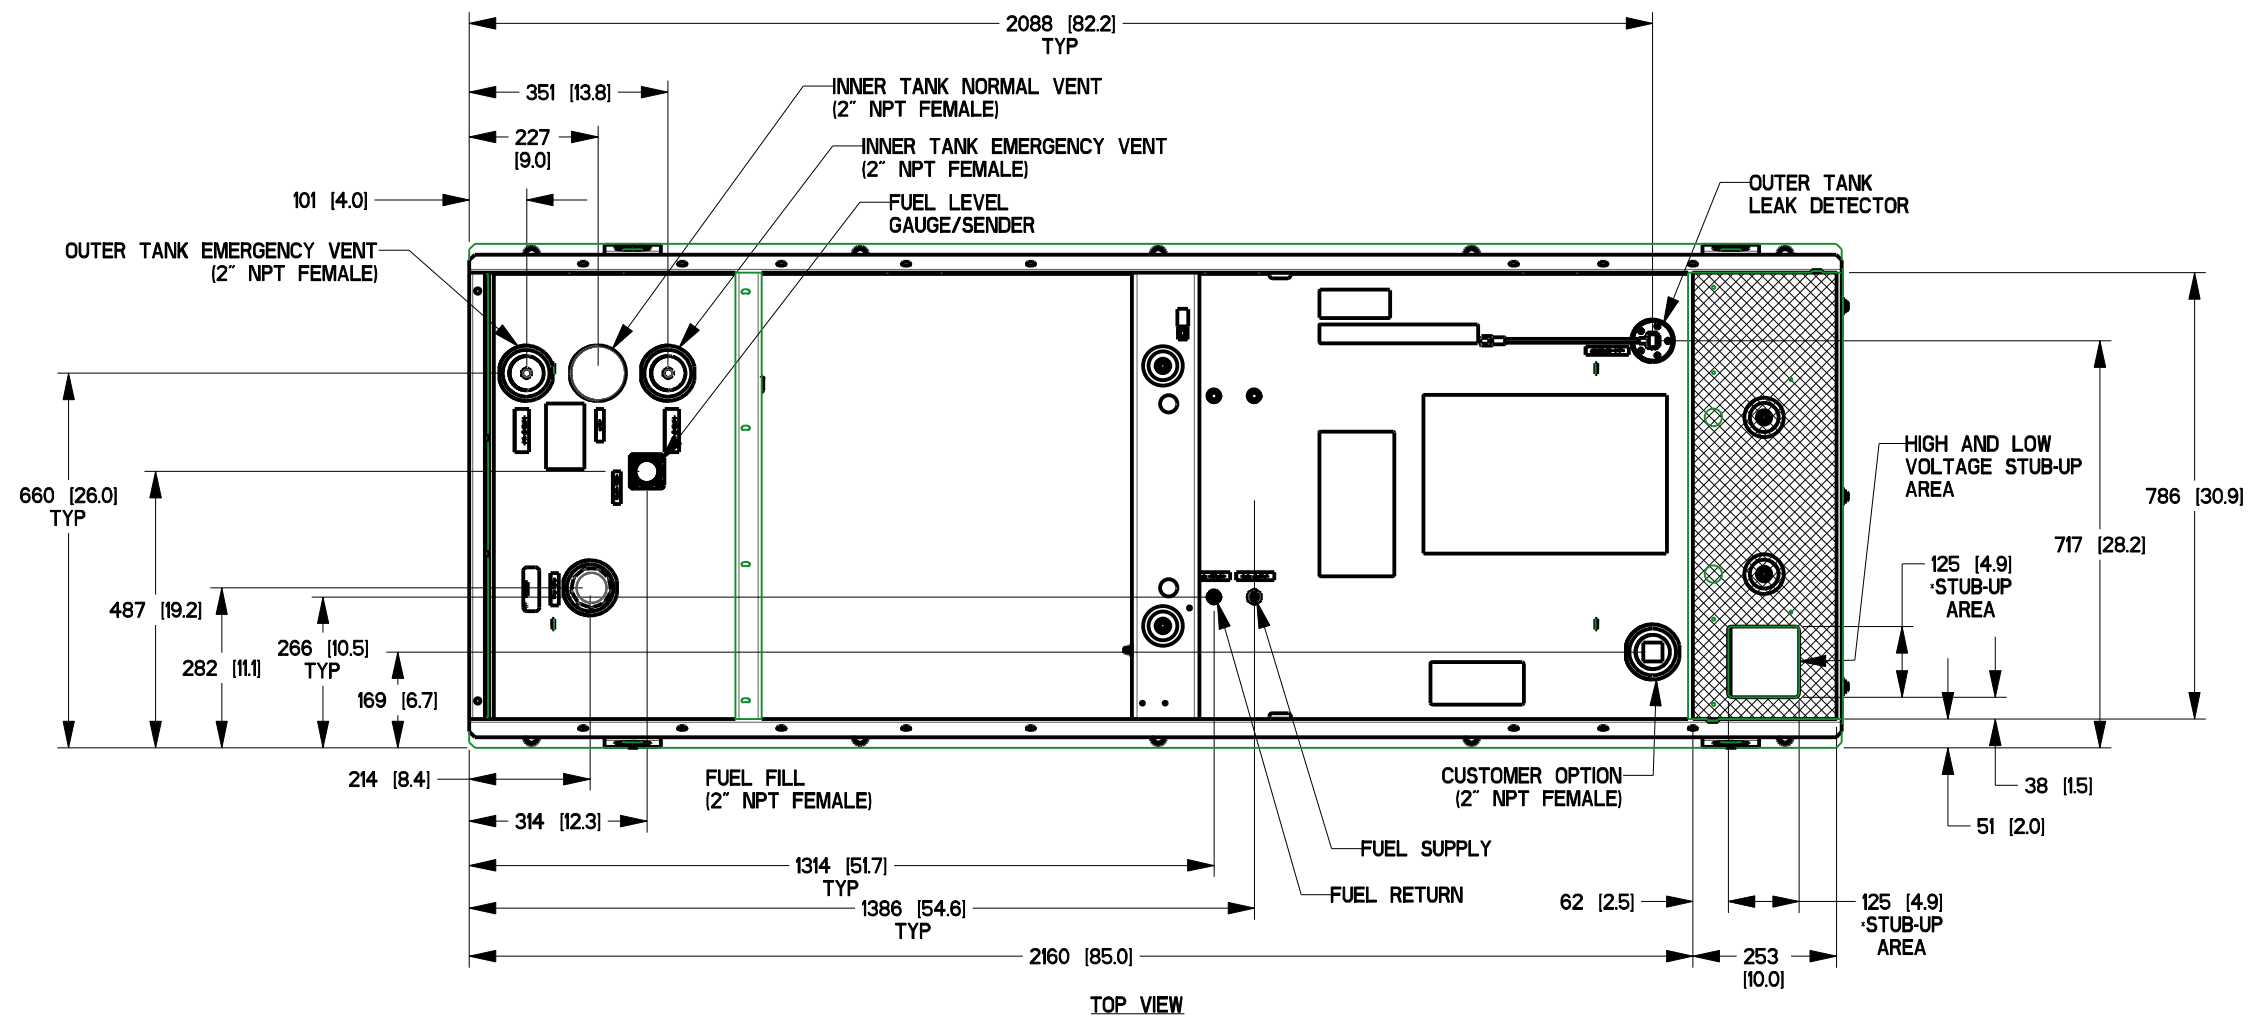

A

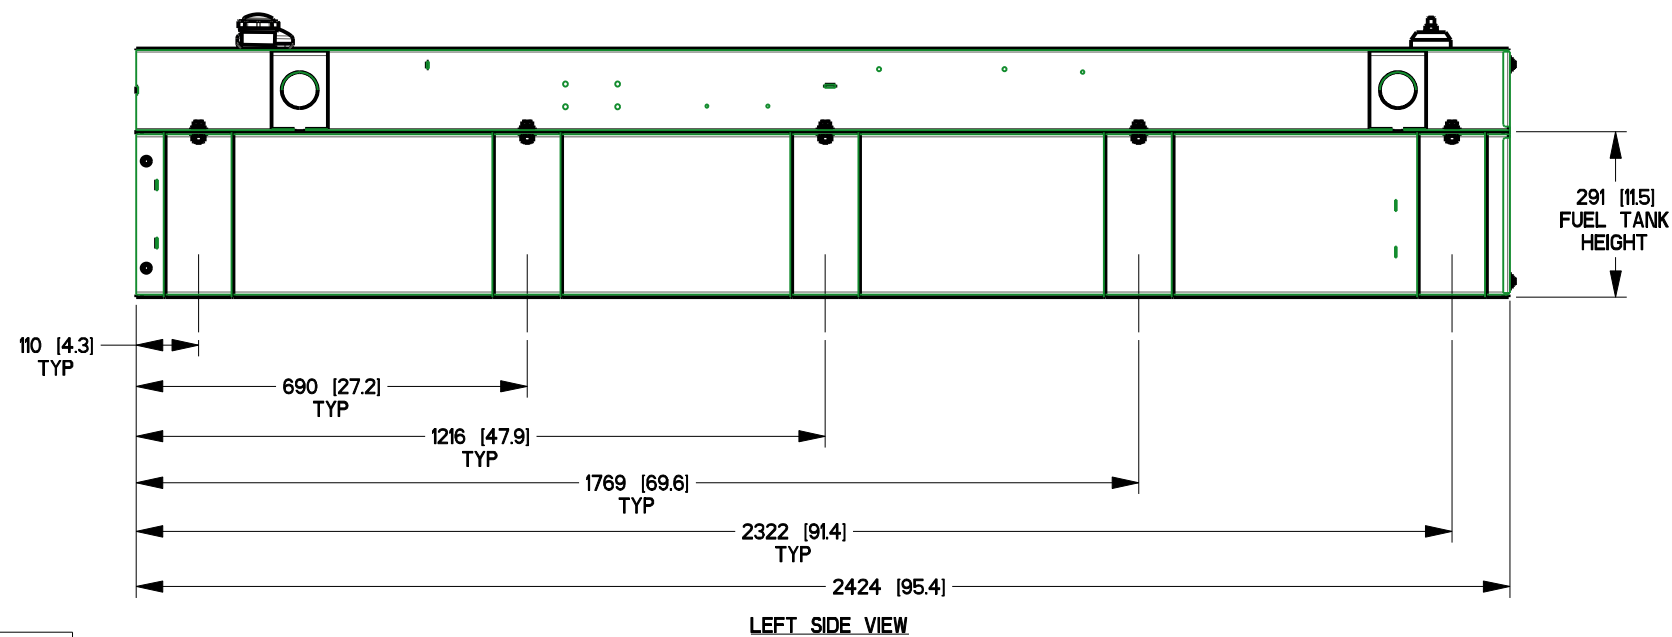


B

FUEL TANK	
TOTAL CAPACITY	233.8 [61.77]
USABLE CAPACITY	215 [57]

CAPACITY: LITER [GALLONS]
DIMENSIONS: MM [INCH]

THIS TANK IS LISTED TO UL142 AND ULC5601

NOTE: STUB-UP AREA FOR HIGH AND LOW VOLTAGE CONNECTIONS, CIRCUIT BREAKER, NEUTRAL AND CUSTOMER CONNECTION OPENING.

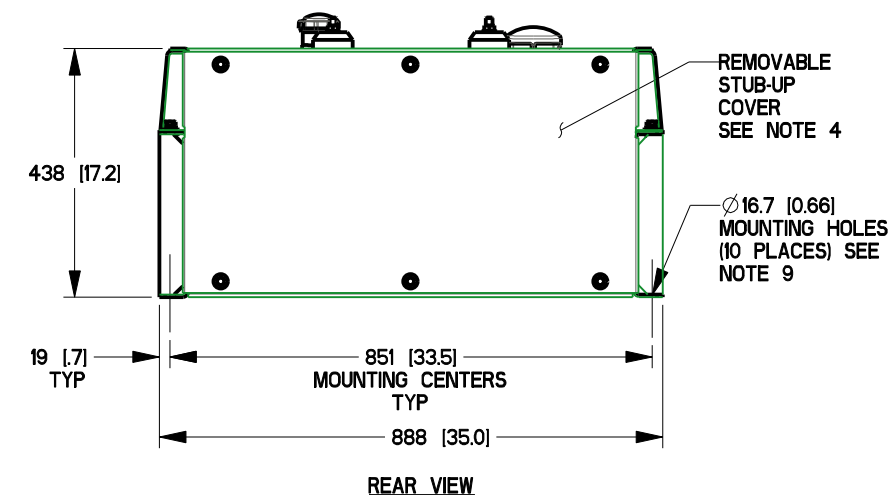

A

DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. © GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED
INSIDE WINDCHILL

GENERAC

TITLE

INSTALL PROTECTOR D3.3L G2
EXTENDED TANK

ISSUE DATE: 07/2017

SIZE	CAGE NO	DWG NO	REV
B	N/A	10000018949	A
SCALE	0.075	WT-KG	SEE ABOVE
SHEET	2	of	2

INSTALLATION DRAWING