

TOP VIEW

| SERVICE ITEM | 9.0L |
|-------------------------|-------------|
| OIL FILL CAP | EITHER SIDE |
| OIL DIP STICK | RIGHT SIDE |
| OIL FILTER | LEFT SIDE |
| OIL DRAIN HOSE | LEFT SIDE |
| RADIATOR DRAIN HOSE | LEFT SIDE |
| COOLANT RECOVERY BOTTLE | RIGHT SIDE |
| RADIATOR FILL CAP | ROOF TOP |
| AIR CLEANER ELEMENT | EITHER SIDE |
| SPARK PLUGS | EITHER SIDE |
| MUFFLER | SEE NOTE 11 |
| FAN BELT | EITHER SIDE |
| BATTERY | RIGHT SIDE |

REFERENCE OWNERS MANUAL
FOR PERIODIC REPLACEMENT
PART LISTINGS.

NOTES:

1. MINIMUM RECOMMENDED CONCRETE PAD SIZE: (6" LARGER PER SIDE THAN FRAME)
1269 (50") WIDE 2667 (105") LONG.
REFERENCE INSTALLATION GUIDE SUPPLIED WITH UNIT FOR CONCRETE PAD GUIDELINES.
2. ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE
AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT
APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL,
STATE, AND LOCAL CODES.
3. CONTROL PANEL / CIRCUIT BREAKER INFORMATION:
- SEE SPECIFICATION SHEET OR OWNERS MANUAL
- ACCESSIBLE THROUGH CUSTOMER ACCESS ASSEMBLY ON LEFT SIDE OF GENERATOR.
4. INSIDE STUB-UP AREA FOR AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION,
BATTERY CHARGER 120 VOLT AC (.5 AMP MAX) CONNECTION AND ACCESS TO TRANSFER
SWITCH CONTROL WIRES. REMOVE REAR COVER FOR ACCESS.
5. CENTER OF GRAVITY AND WEIGHT MAY CHANGE DUE TO UNIT OPTIONS.
6. BOTTOM OF GENERATOR SET MUST BE ENCLOSED TO PREVENT PEST INTRUSION AND
RECIRCULATION OF DISCHARGE AIR AND/OR IMPROPER COOLING AIR FLOW.
7. REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
8. MOUNTING BOLTS OR STUDS TO MOUNTING SURFACE SHALL BE 5/8-11 GRADE 5
(USE STANDARD SAE TORQUE SPECS)
9. MUST ALLOW FREE FLOW OF INTAKE AIR, DISCHARGE AIR AND EXHAUST. SEE SPEC
SHEET FOR MINIMUM AIR FLOW AND MAXIMUM RESTRICTION REQUIREMENTS.
10. GENERATOR MUST BE INSTALLED SUCH THAT FRESH COOLING AIR IS AVAILABLE
AND THAT DISCHARGE AIR FROM RADIATOR IS NOT RECIRCULATED.
11. REMOVE FRONT END PANEL TO ACCESS EXHAUST MUFFLER. ACCESS AVAILABLE
THROUGH DOORS TO FAN BELT.

RADIATOR/EXHAUST
DISCHARGE AIR

850 [33.5]
DOOR WIDTH
TYP

CUSTOMER ACCESS
ASSEMBLY, CONTROL
PANEL ACCESS,
BATTERY CHARGER
LOCATED WITHIN
SEE NOTE 3 & 4

AIR INTAKE

CIRCUIT BREAKER
SEE NOTE 3

FUEL LINE CONNECTION
1-1/4" NPT FEMALE TEE
THROUGH BASE FRAME

2814 [110.8]
OVERALL LENGTH

RADIATOR DRAIN

LEFT VIEW

LOCKING VICE ACTION LATCH, ONE PER DOOR
TWO LIFT OFF DOORS PER SIDE OF GENERATOR

1761 [69.3]
OVERALL
HEIGHT

1003 [39.5]
OVERALL WIDTH

REAR VIEW

58 [2.3]
TYP

Ø 63.5 [2.50]
LIFTING EYE
(4X)

2267 [89.3] TYP

47 [1.8] TYP

RIGHT VIEW

DRAWING CREATED FROM PRO/ENGINEER
3D FILE. ECO MODIFICATION TO BE
APPLIED TO SOLID MODEL ONLY.

DIMENSIONS: MM [INCH]

| WEIGHT DATA | | | | |
|-------------|--------------------|-----------------------------|-------------------------------|--------------------------|
| ENGINE/KW | ENCLOSURE MATERIAL | WEIGHT GENSET ONLY KG [LBS] | WEIGHT SHIPPING SKID KG [LBS] | SHIPPING WEIGHT KG [LBS] |
| 9.0L/100KW | AL | 1292 [2848] | 79 [175] | 1371 [3024] |

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING
WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR
ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT
THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS.
©GENERAC POWER SYSTEMS 2013


ELECTRONICALLY APPROVED
INSIDE WINDCHILL




| TITLE | | | | |
|----------------------------|---------|-------------|-----------|--------------|
| INSTALL 9.0L G26 100KW CPL | | | | |
| ISSUE DATE: | | | | |
| SIZE | CAGE NO | DWG NO | REV | |
| B | N/A | A0001453011 | A | |
| SCALE | 0.033 | WT-KG | SEE CHART | SHEET 1 of 2 |

INSTALLATION DRAWING

*NOTE:
STUB-UP AREA FOR HIGH AND LOW
VOLTAGE CONNECTIONS, CIRCUIT BREAKER,
NEUTRAL AND CUSTOMER CONNECTION OPENING.

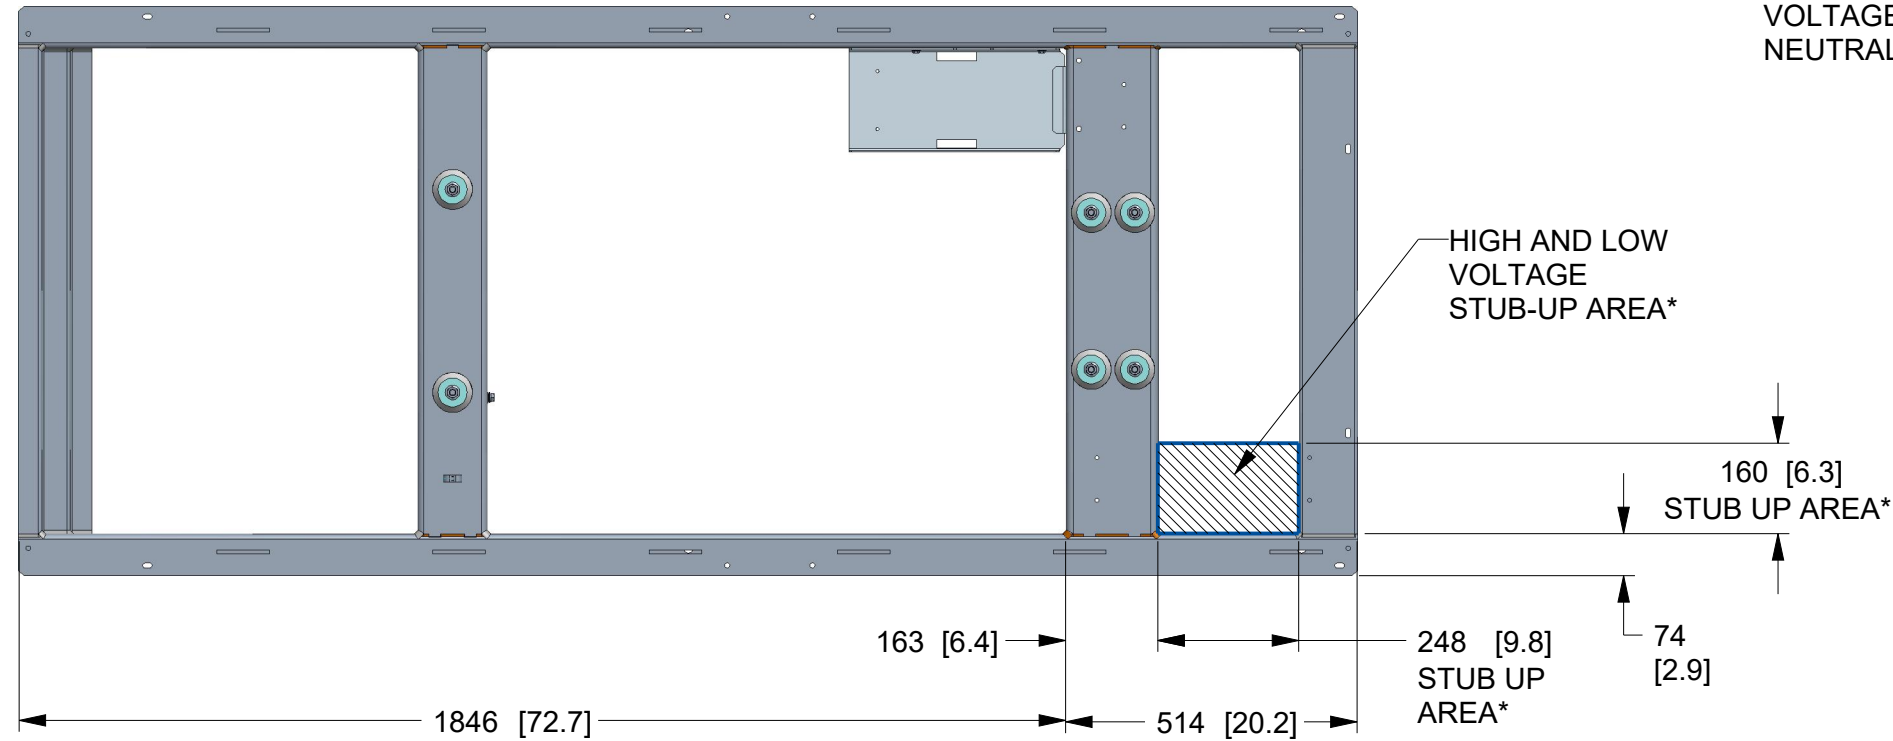


TOP VIEW

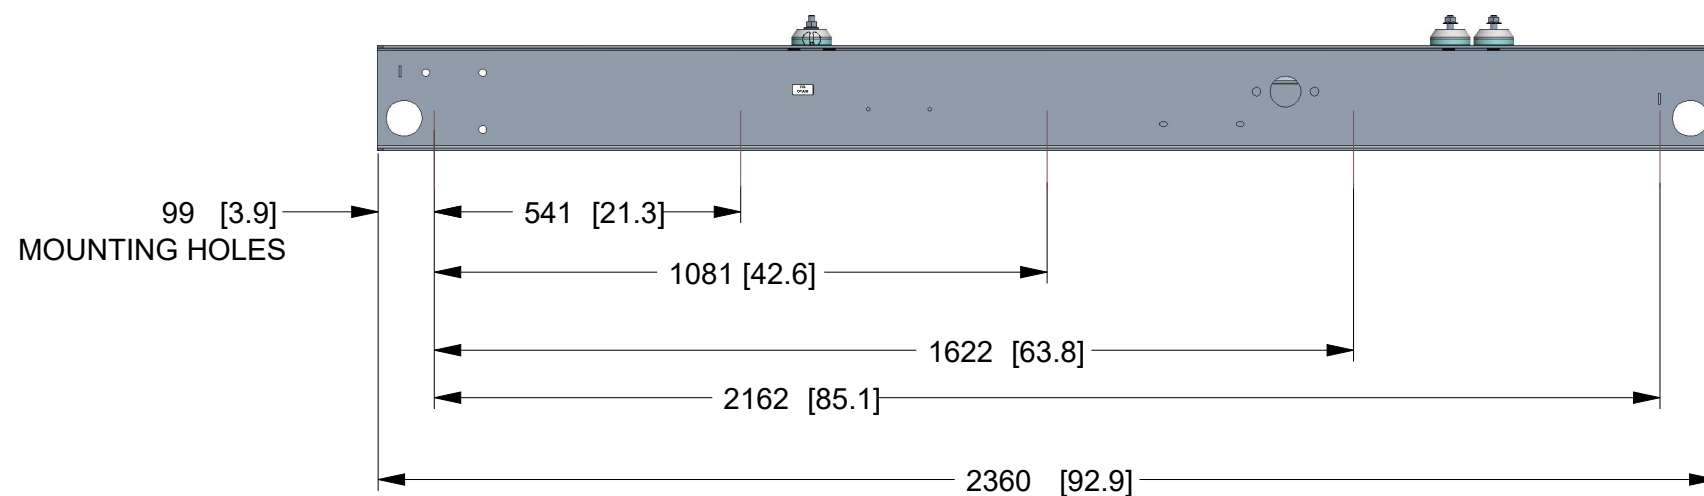

LEFT VIEW

10X Ø16.7 [.66]
MOUNTING HOLES

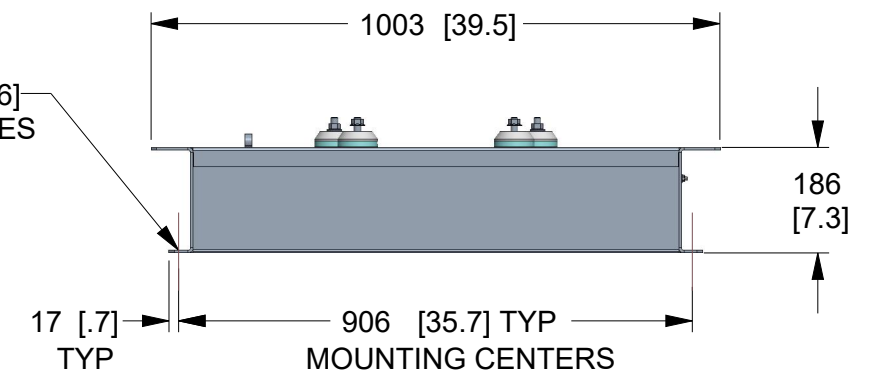

REAR VIEW

DRAWING CREATED FROM PRO/ENGINEER
3D FILE. ECO MODIFICATION TO BE
APPLIED TO SOLID MODEL ONLY.

INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING
WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR
ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT
THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS.
©GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED
INSIDE WINDCHILL

GENERAC

TITLE

INSTALL STUB-UP VIEW
G9.0L G26 100KW CPL

ISSUE DATE:

SIZE
B

CAGE NO
N/A

DWG NO
A0001453011

REV
A

SCALE 0.075

WT-KG

SHEET 2 of 2