


TOP VIEW

SERVICE ITEM	9.0L
OIL FILL CAP	EITHER SIDE
OIL DIP STICK	RIGHT SIDE
OIL FILTER	LEFT SIDE
OIL DRAIN HOSE	LEFT SIDE
RADIATOR DRAIN HOSE	LEFT SIDE
COOLANT RECOVERY BOTTLE	RIGHT SIDE
RADIATOR FILL CAP	ROOF TOP
AIR CLEANER ELEMENT	EITHER SIDE
SPARK PLUGS	EITHER SIDE
MUFFLER	SEE NOTE 11
FAN BELT	EITHER SIDE
BATTERY	RIGHT SIDE


REFERENCE OWNERS MANUAL  
FOR PERIODIC REPLACEMENT  
PART LISTINGS.

NOTES:

1. MINIMUM RECOMMENDED CONCRETE PAD SIZE: (6" LARGER PER SIDE THAN FRAME)  
1269 (50") WIDE 2667 (105") LONG.  
REFERENCE INSTALLATION GUIDE SUPPLIED WITH UNIT FOR CONCRETE PAD GUIDELINES.
2. ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE  
AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT  
APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL,  
STATE, AND LOCAL CODES.
3. CONTROL PANEL / CIRCUIT BREAKER INFORMATION:  
- SEE SPECIFICATION SHEET OR OWNERS MANUAL  
- ACCESSIBLE THROUGH CUSTOMER ACCESS ASSEMBLY ON LEFT SIDE OF GENERATOR.
4. INSIDE STUB-UP AREA FOR AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION,  
BATTERY CHARGER 120 VOLT AC (.5 AMP MAX) CONNECTION AND ACCESS TO TRANSFER  
SWITCH CONTROL WIRES. REMOVE REAR COVER FOR ACCESS.
5. CENTER OF GRAVITY AND WEIGHT MAY CHANGE DUE TO UNIT OPTIONS.
6. BOTTOM OF GENERATOR SET MUST BE ENCLOSED TO PREVENT PEST INTRUSION AND  
RECIRCULATION OF DISCHARGE AIR AND/OR IMPROPER COOLING AIR FLOW.
7. REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
8. MOUNTING BOLTS OR STUDS TO MOUNTING SURFACE SHALL BE 5/8-11 GRADE 5  
(USE STANDARD SAE TORQUE SPECS)
9. MUST ALLOW FREE FLOW OF INTAKE AIR, DISCHARGE AIR AND EXHAUST. SEE SPEC  
SHEET FOR MINIMUM AIR FLOW AND MAXIMUM RESTRICTION REQUIREMENTS.
10. GENERATOR MUST BE INSTALLED SUCH THAT FRESH COOLING AIR IS AVAILABLE  
AND THAT DISCHARGE AIR FROM RADIATOR IS NOT RECIRCULATED.
11. REMOVE FRONT END PANEL TO ACCESS EXHAUST MUFFLER. ACCESS AVAILABLE  
THROUGH DOORS TO FAN BELT.

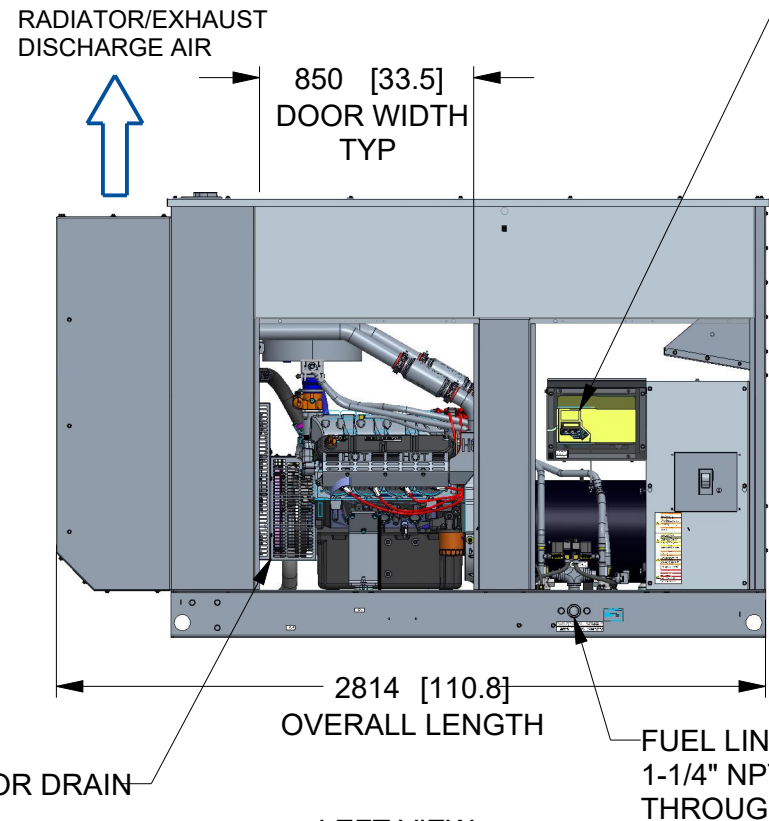


LEFT VIEW

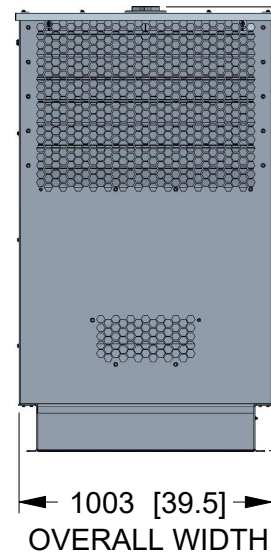

REAR VIEW

LOCKING VICE ACTION LATCH, ONE PER DOOR  
TWO LIFT OFF DOORS PER SIDE OF GENERATOR

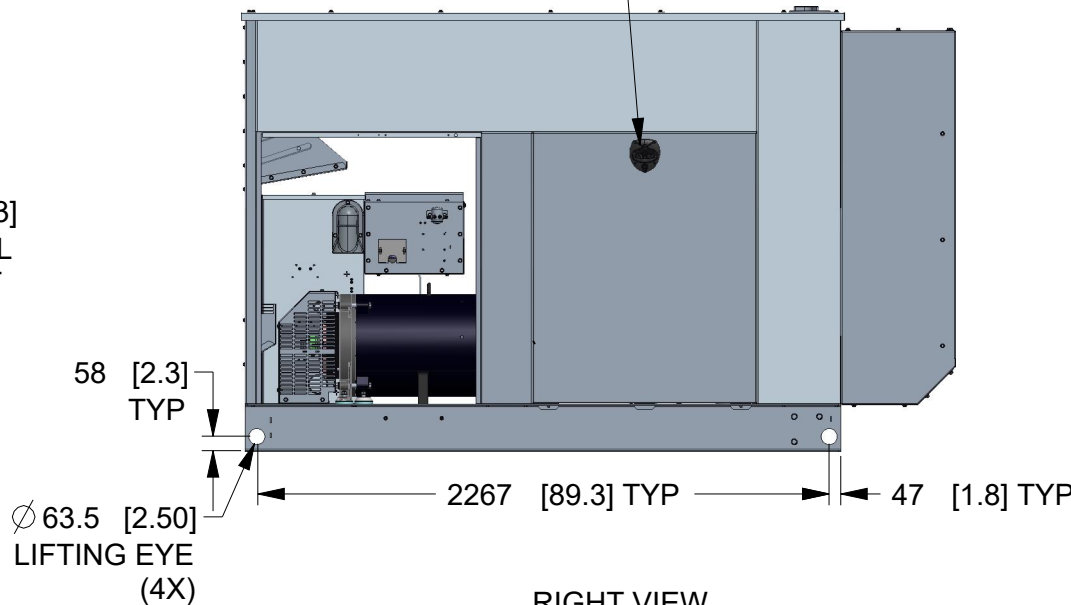

RIGHT VIEW

DRAWING CREATED FROM PRO/ENGINEER  
3D FILE. ECO MODIFICATION TO BE  
APPLIED TO SOLID MODEL ONLY.

DIMENSIONS: MM [INCH]

WEIGHT DATA				
ENGINE/KW	ENCLOSURE MATERIAL	WEIGHT GENSET ONLY KG [LBS]	WEIGHT SHIPPING SKID KG [LBS]	SHIPPING WEIGHT KG [LBS]
9.0L/100KW	AL	1292 [2848]	79 [175]	1371 [3024]

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING  
WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR  
ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT  
THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS.  
©GENERAC POWER SYSTEMS 2013


ELECTRONICALLY APPROVED  
INSIDE WINDCHILL




TITLE				
INSTALL 9.0L G26 100KW CPL				
ISSUE DATE:				
SIZE B	CAGE NO N/A	DWG NO A0001453011	REV A	
SCALE 0.033	WT-KG SEE CHART	SHEET 1 of 2		

# INSTALLATION DRAWING

\*NOTE:  
STUB-UP AREA FOR HIGH AND LOW  
VOLTAGE CONNECTIONS, CIRCUIT BREAKER,  
NEUTRAL AND CUSTOMER CONNECTION OPENING.

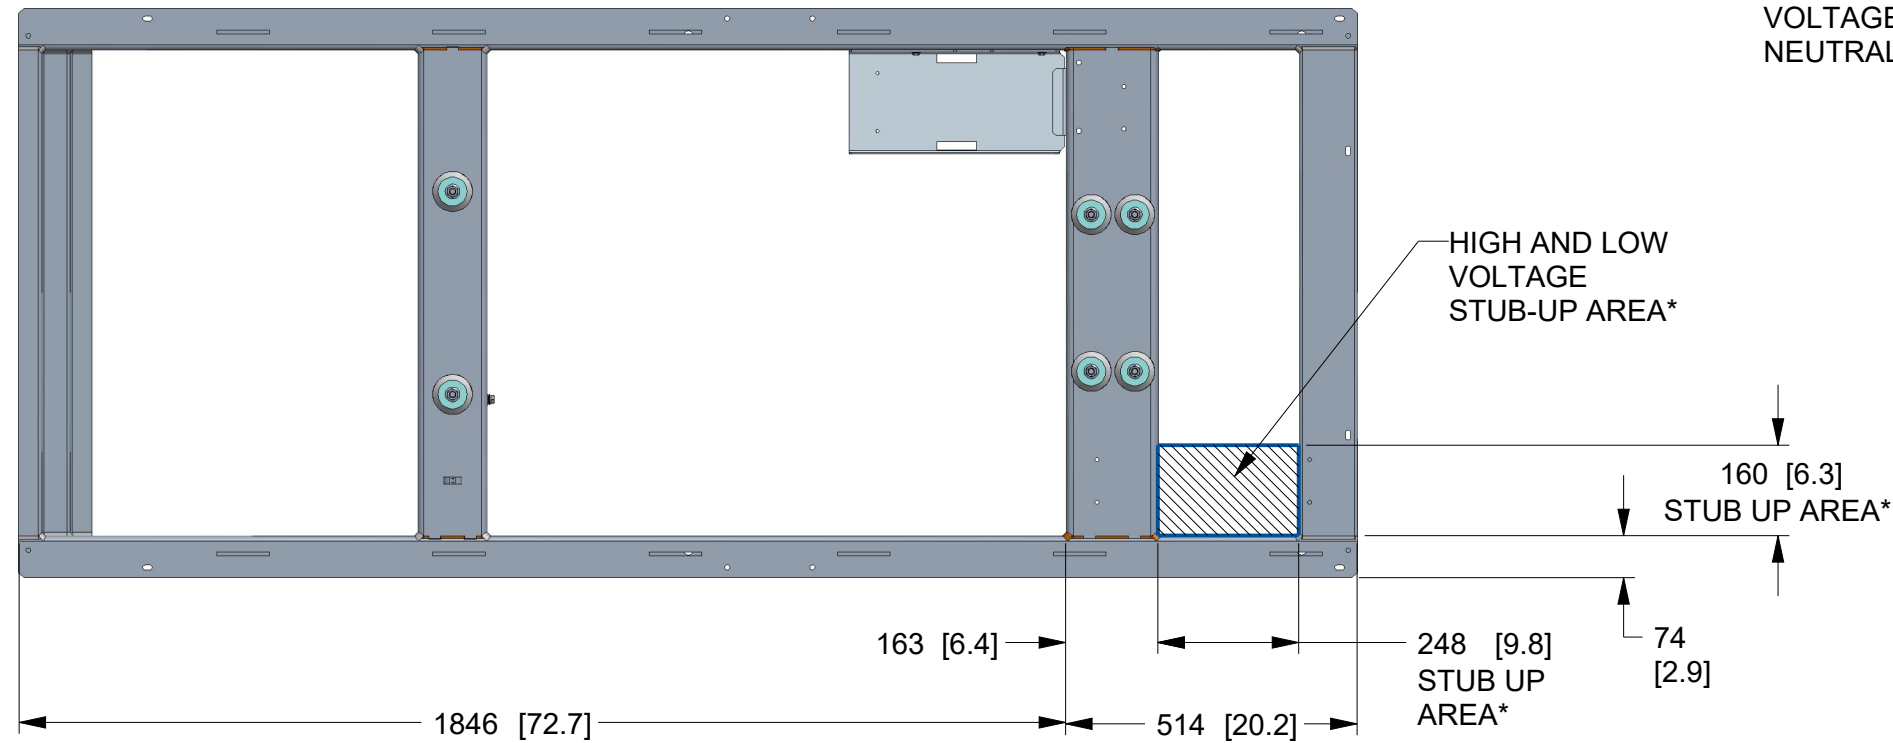


TOP VIEW

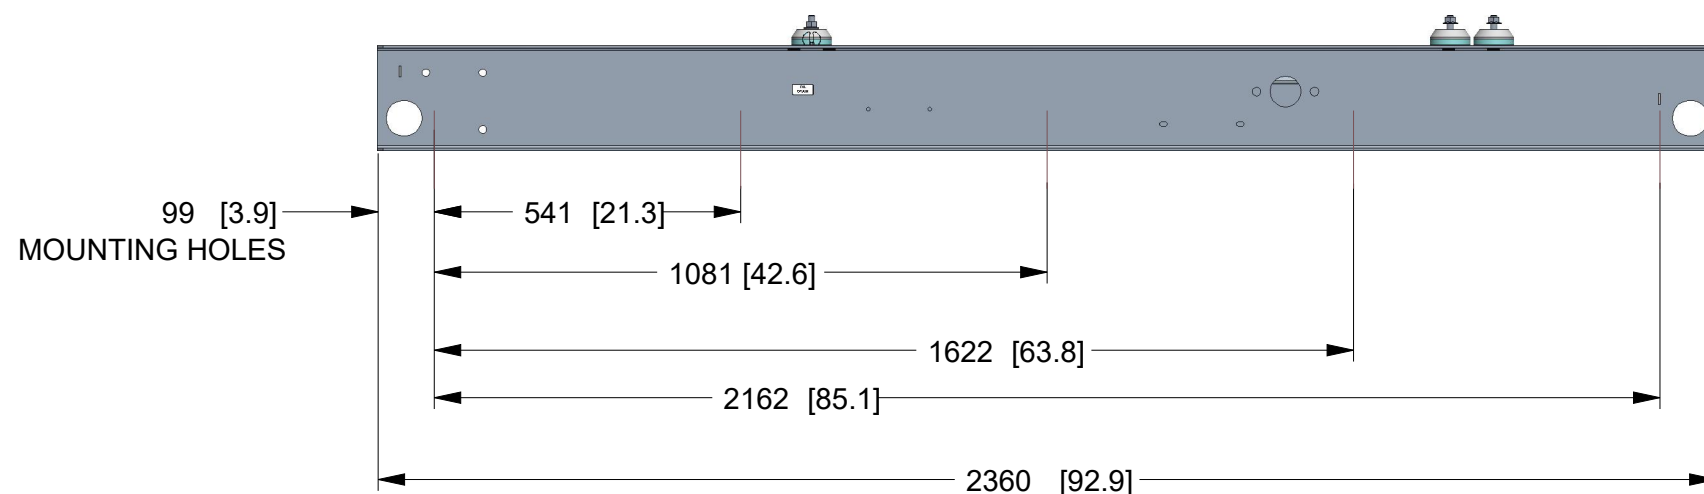

LEFT VIEW

10X Ø16.7 [.66]  
MOUNTING HOLES

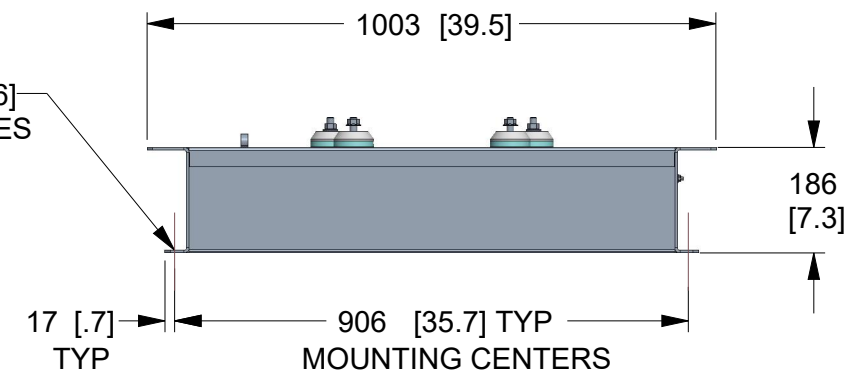

REAR VIEW

DRAWING CREATED FROM PRO/ENGINEER  
3D FILE. ECO MODIFICATION TO BE  
APPLIED TO SOLID MODEL ONLY.

# INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING  
WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR  
ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT  
THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS.  
©GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED  
INSIDE WINDCHILL



TITLE

INSTALL STUB-UP VIEW  
G9.0L G26 100KW CPL

ISSUE DATE:

SIZE  
B

CAGE NO  
N/A

DWG NO  
A0001453011

REV  
A

SCALE

0.075

WT-KG

SHEET

2 of 2