
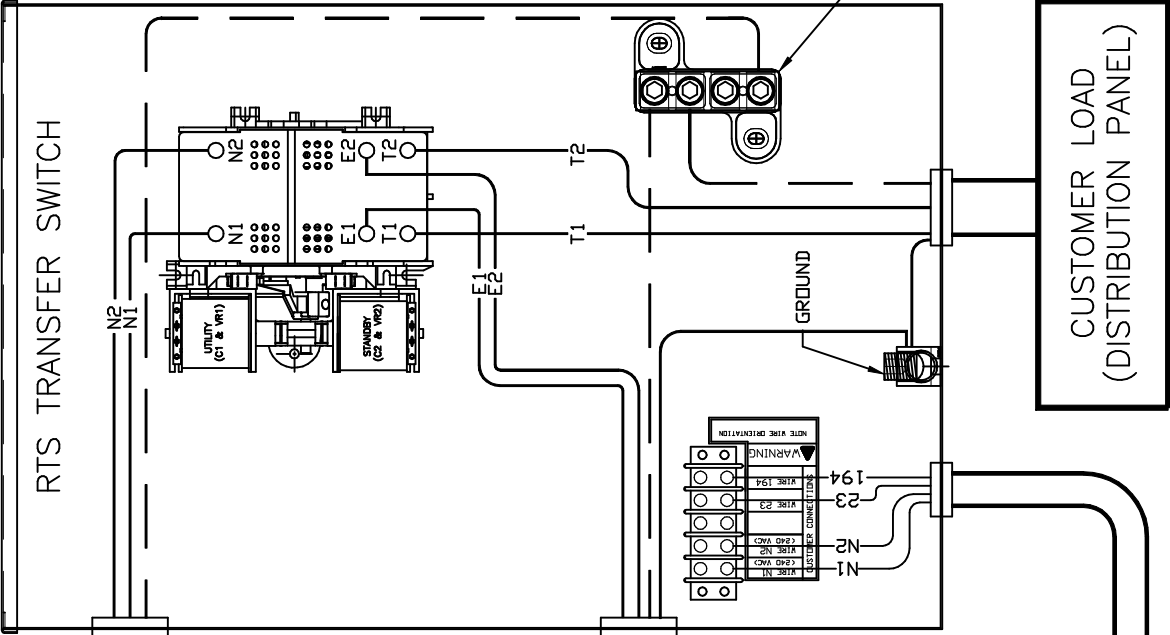


GROUP G

UTILITY SUPPLY FROM
SERVICE DISCONNECT

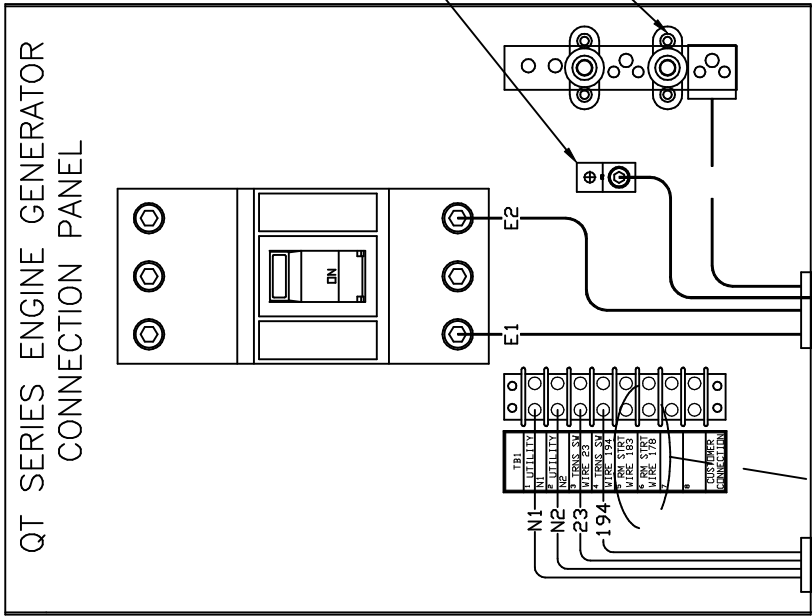

CUSTOMER LOAD
(DISTRIBUTION PANEL)

NOTE: POWER LEADS AND TRANSFER SWITCH LEADS TO BE RUN IN TWO DIFFERENT CONDUITS.

EXCEPTIONS:
IF THE INSULATION RATING ON ALL WIRING IS RATED FOR 600V AND THE LENGTH OF THE CONDUIT IS 30ft OR LESS IT IS ACCEPTABLE TO INCLUDE GENERATOR CONTROL & POWER WIRING IN ONE CONDUIT

LIQUID COOLED INSTALLATION

EXPLODED VIEW:

RTS SINGLE PHASE INTERCONNECTION

DRAWING #: 0F6941

REVISION: H-2100-A
DATE: 4/21/08

THIS PAGE IS LEFT INTENTIONALLY BLANK