


GROUP G

NOTES:

- 1) MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1240 (48. 8") WIDE X 2755 (108. 5") LONG.
- 2) ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA 37 & NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE AND LOCAL CODES FOR MINIMUM DISTANCES FROM OTHER STRUCTURES.
- 3) CIRCUIT BREAKER INFORMATION:
SEE SPECIFICATION SHEET WITHIN OWNERS MANUAL.
- 4) INSIDE STUB-UP AREA FOR AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION, AUXILIARY OUTPUT RELAYS, AND ACCESS TO TRANSFER SWITCH CONTROL WIRES. REMOVE COVER FOR ACCESS.
- 4A) FIELD CUT HOLE IS ONLY REQUIRED FOR MOUNTING OF GENERATOR ON AN EXISTING PAD.
- 5) REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
- 6) REMOVE EITHER LEFT OR RIGHT HAND SIDE PANEL TO ACCESS EXHAUST MUFFLERS.
- 7) INSIDE ACCESS TO 120VAC, 20A GFCI OUTLET PREWIRED TO SUPPLY POWER TO BATTERY CHARGER.
6. 8L ONLY: USE 20A GFCI OUTLET FOR ENG BLOCK HEATER.
5. 4L ONLY: 15A, 240VAC OUTLET FOR ENG BLOCK HEATER.

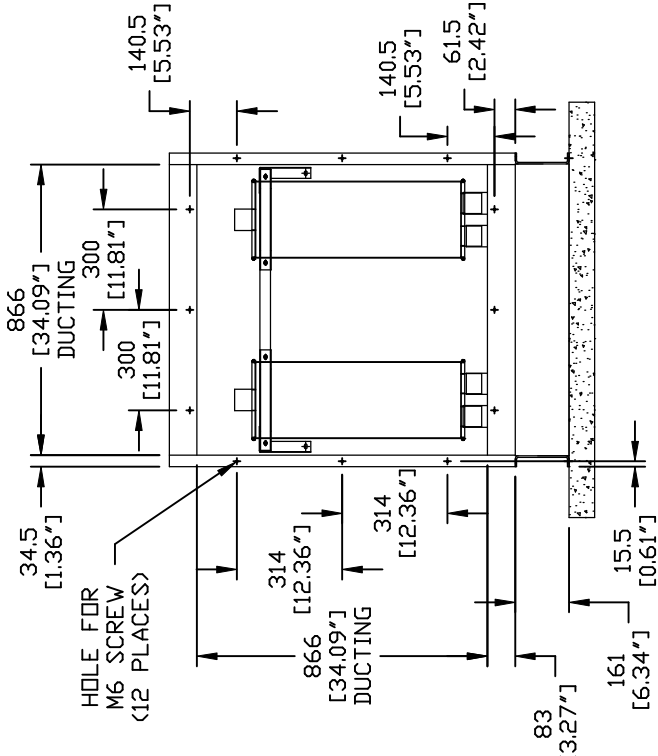


FRONT VIEW

WEIGHT DATA	
5. 4L 45/55KW - 753KG (1661 LB)	
6. 8L 70KW - 850KG (1873 LB)	
WOODEN SHIPPING SKIDS INCREASE OVERALL WEIGHT 79KG (175LB)	

EXPLODED VIEW:
INSTALL 5.4L/6.8L IND C3 OPEN
DRAWING #: 0G1539

GROUP G

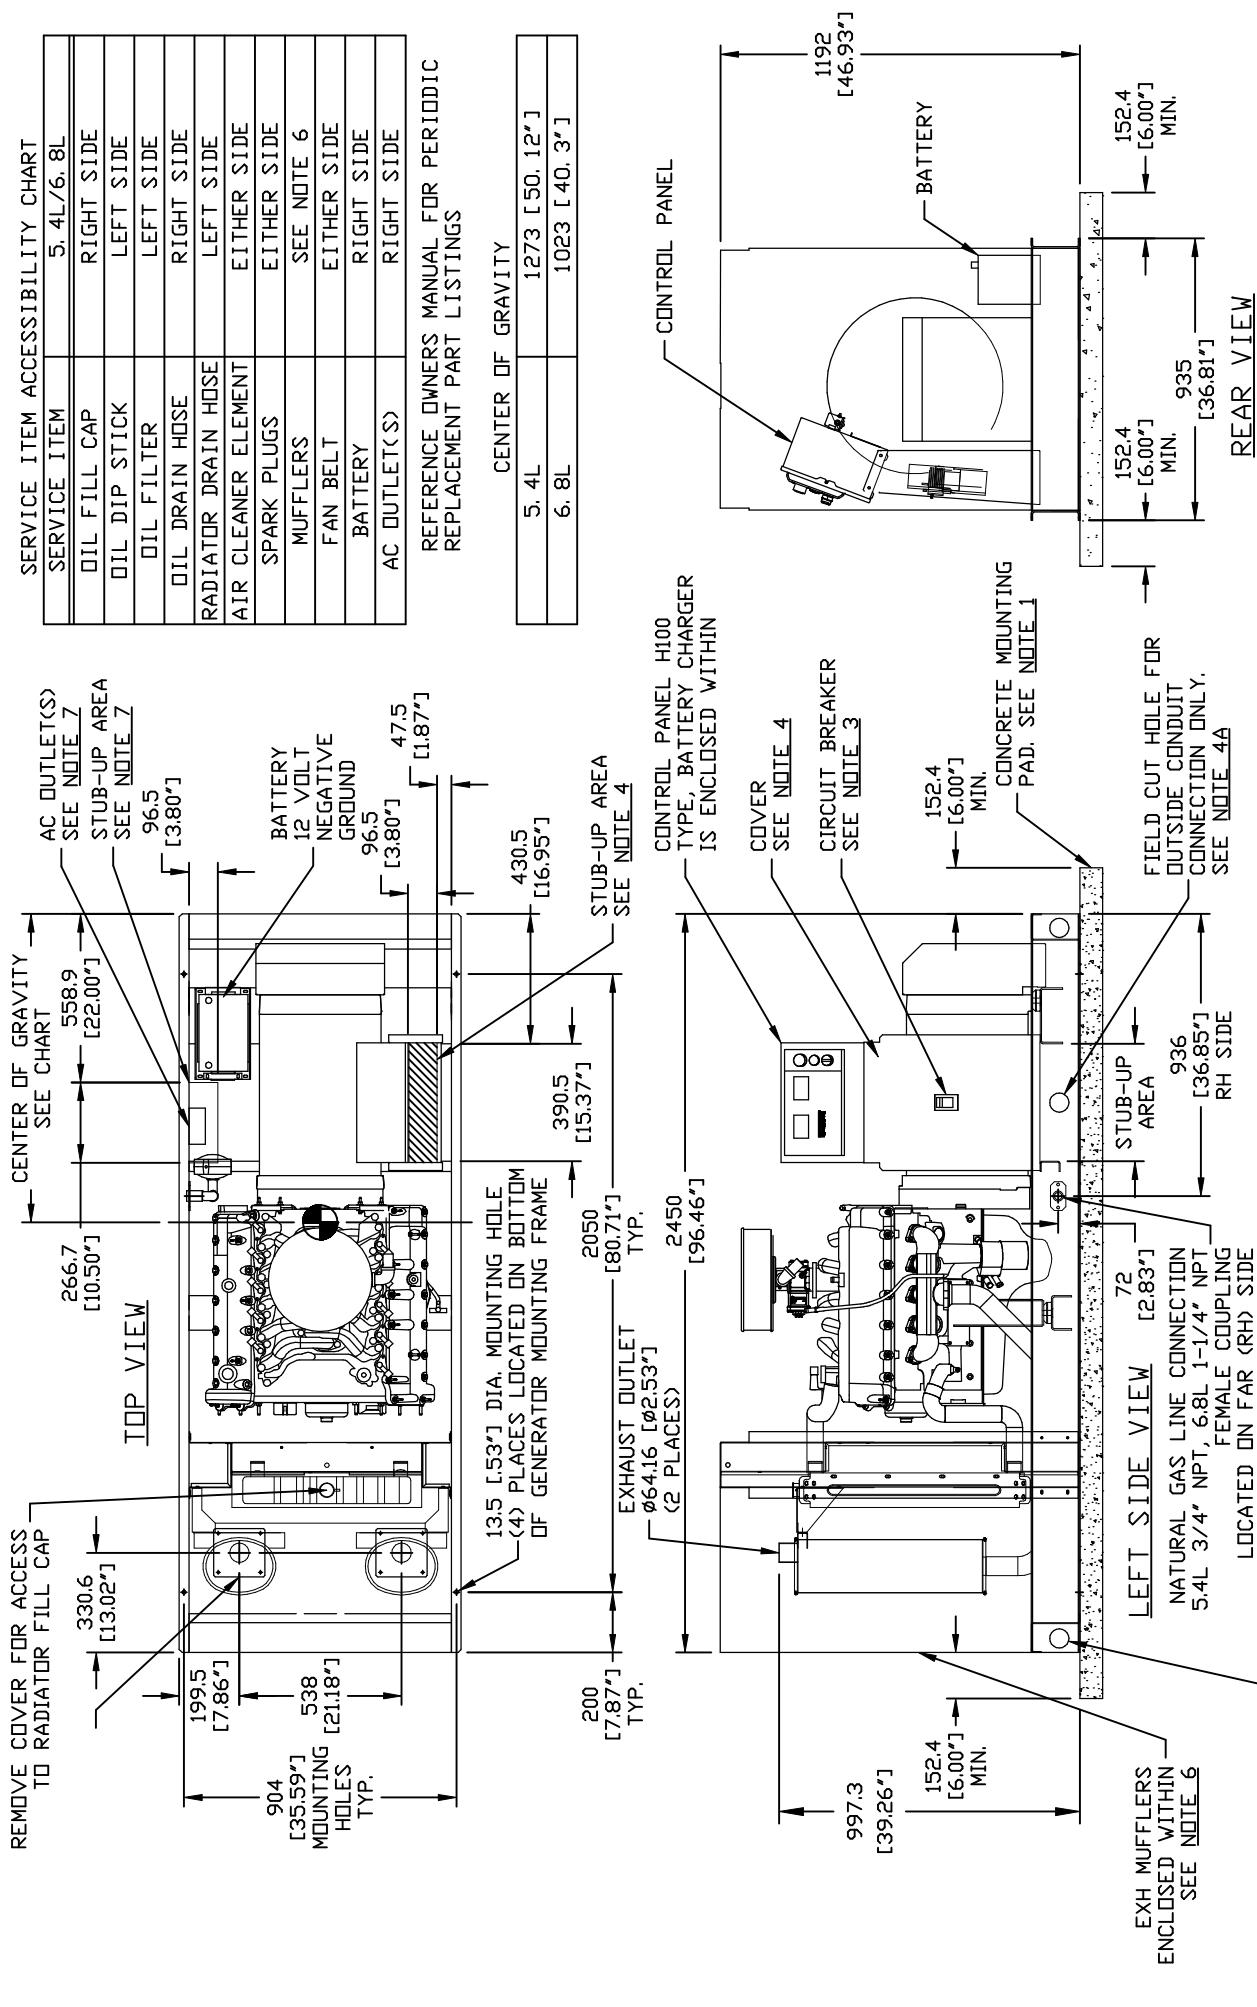

SERVICE ITEM ACCESSIBILITY CHART		
SERVICE ITEM	5. 4L/6. 8L	
OIL FILL CAP	RIGHT SIDE	
OIL DIP STICK	LEFT SIDE	
OIL FILTER	LEFT SIDE	
OIL DRAIN HOSE	RIGHT SIDE	
RADIATOR DRAIN HOSE	LEFT SIDE	
AIR CLEANER ELEMENT	EITHER SIDE	
SPARK PLUGS	EITHER SIDE	
MUFFLERS	SEE NOTE 6	
FAN BELT	EITHER SIDE	
BATTERY	RIGHT SIDE	
AC OUTLET(S)	RIGHT SIDE	

REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS		
CENTER OF GRAVITY		
5. 4L	1273 [50.12"]	
6. 8L	1023 [40.3"]	

EXPLODED VIEW:
INSTALL 5.4L/6.8L IND C3 OPEN
DRAWING #: 0G1539