


GROUP G

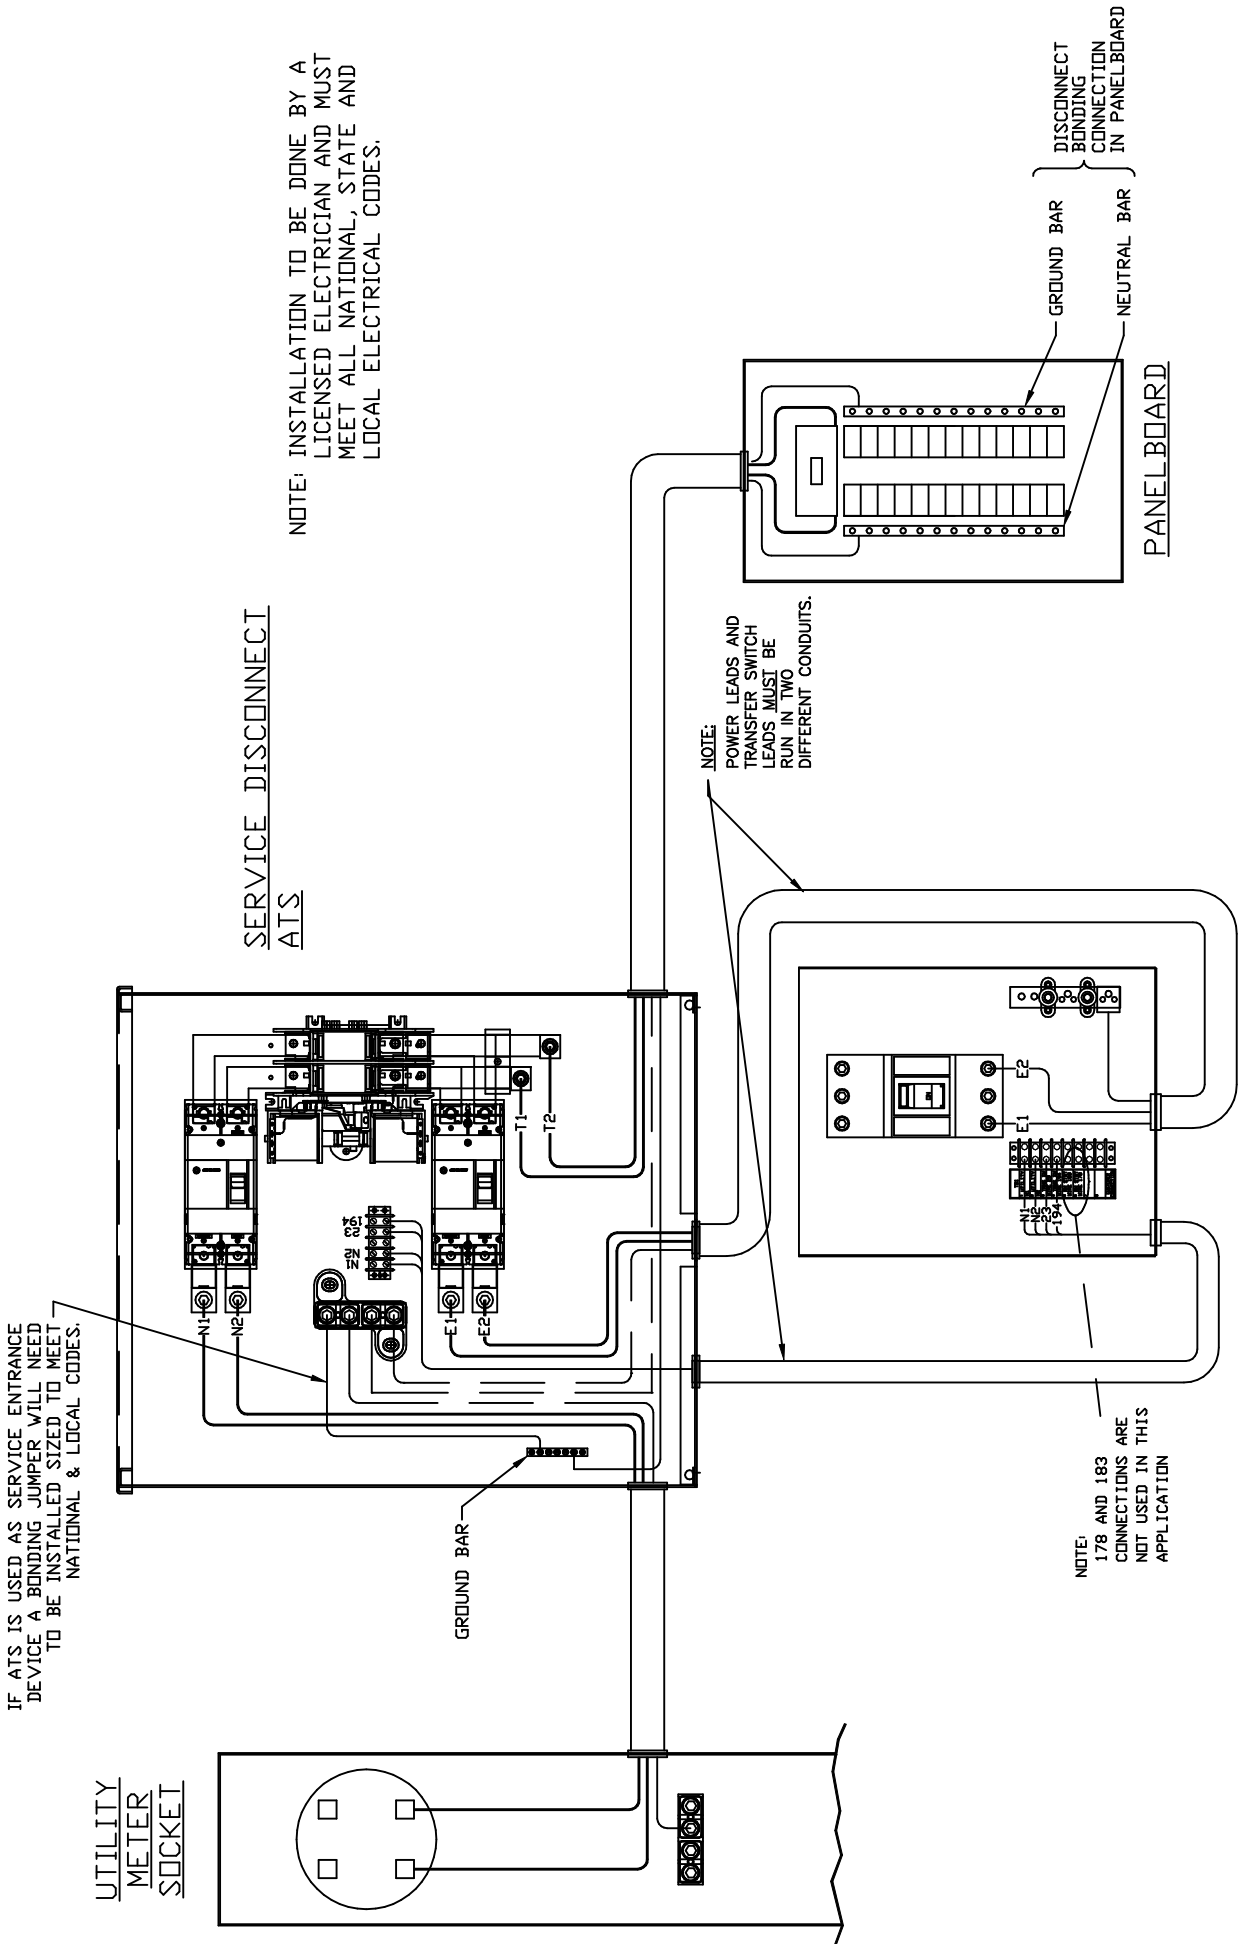

NOTE: INSTALLATION TO BE DONE BY A LICENSED ELECTRICIAN AND MUST MEET ALL NATIONAL, STATE AND LOCAL ELECTRICAL CODES.

QT SERIES ENGINE GENERATOR CONNECTION PANEL

EXPLODED VIEW:
RTS XFER SW INTERCONNECTIONS
DRAWING #: 0G5527


GROUP G

NOTE: INSTALLATION TO BE DONE BY A
LICENSED ELECTRICIAN AND MUST
MEET ALL NATIONAL, STATE AND
LOCAL ELECTRICAL CODES.

UTILITY
METER
SOCKET

IF ATS IS USED AS SERVICE ENTRANCE
DEVICE A BONDING JUMPER WILL NEED
TO BE INSTALLED SIZED TO MEET
NATIONAL & LOCAL CODES.

SERVICE DISCONNECT
ATS

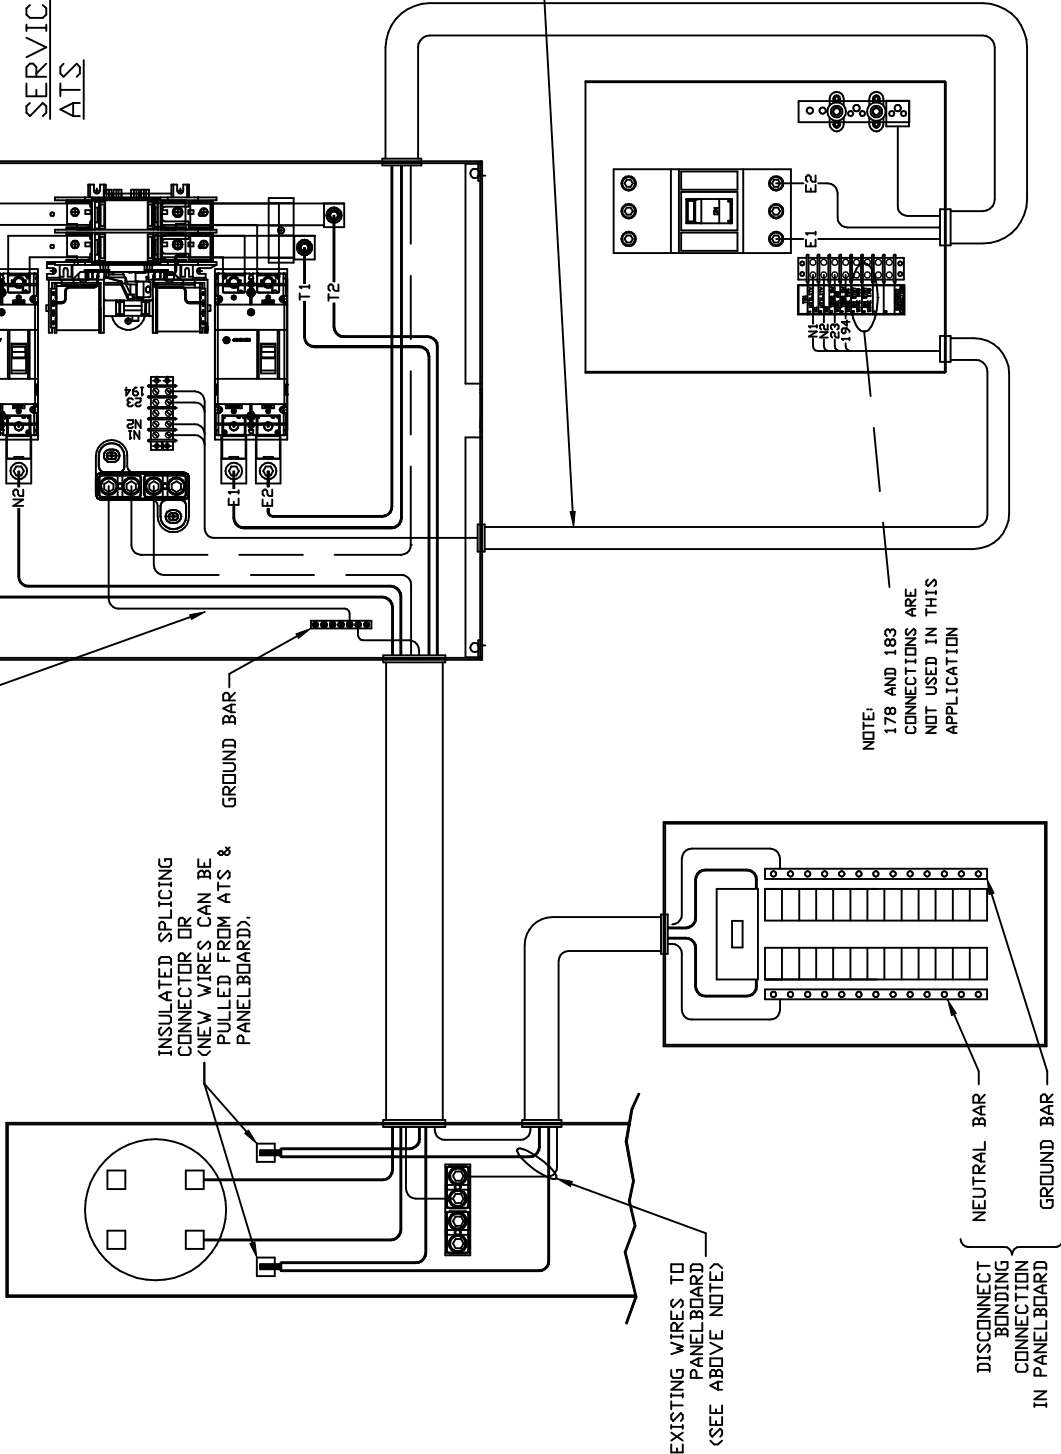

QT SERIES ENGINE GENERATOR
CONNECTION PANEL

EXPLODED VIEW:
RTS XFER SW INTERCONNECTIONS
DRAWING #: 0G5527

REVISION: -A-
DATE: 4/24/07