


GROUP G

- NOTES:
- 1) MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1240 (48. 8") WIDE X 3230 (127. 2") LONG.
 - 2) ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED WITH CURRENT APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE AND LOCAL CODES FOR MINIMUM DISTANCES FROM OTHER STRUCTURES.
 - 3) CIRCUIT BREAKER INFORMATION:
SEE SPECIFICATION SHEET WITHIN OWNERS MANUAL.
 - 4) INSIDE STUB-UP AREA FOR AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION, AUXILIARY OUTPUT RELAYS, AND ACCESS TO TRANSFER SWITCH CONTROL WIRES. REMOVE COVER FOR ACCESS.
 - 4A) FIELD CUT HOLE IS ONLY REQUIRED FOR MOUNTING OF GENERATOR ON AN EXISTING PAD.
 - 5) REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
 - 6) REMOVE EITHER LEFT OR RIGHT HAND SIDE PANEL TO ACCESS EXHAUST MUFFLERS.
 - 7) INSIDE ACCESS TO 120VAC, 20A GFCI OUTLET PREWIRED TO SUPPLY POWER TO BATTERY CHARGER.
6. 8L ONLY: USE 20A GFCI OUTLET FOR ENGINE BLOCK HEATER.
5. 4L ONLY: 15A, 240VAC OUTLET FOR ENGINE BLOCK HEATER.

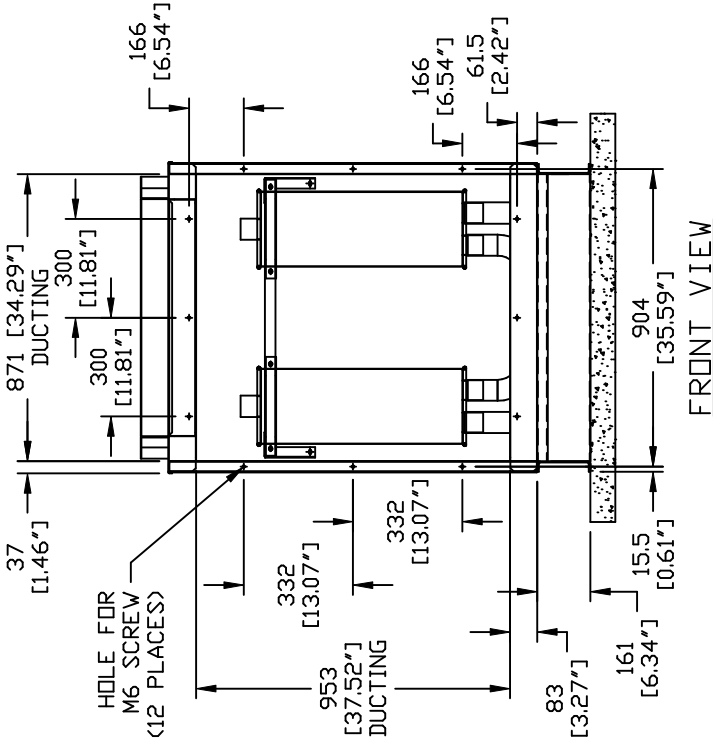

FRONT VIEW

CENTER OF GRAVITY

1310	(51. 5")	- 80KW 5. 4L
1275	(50. 2")	- 100KW 6. 8L
1230	(48. 4")	- 130KW 6. 8L
1315	(51. 8")	- 150KW 6. 8L


EXPLODED VIEW:
INSTALL 5.4L/6.8L IND C5 OPEN
DRAWING #: 0G1541

GROUP G

SERVICE ITEM	5. 4L/6. 8L
OIL FILL CAP	RIGHT SIDE
OIL DIP STICK	LEFT SIDE
OIL FILTER	LEFT SIDE
OIL DRAIN HOSE	RIGHT SIDE
RADIATOR DRAIN HOSE	LEFT SIDE
AIR CLEANER ELEMENT	EITHER SIDE
SPARK PLUGS	EITHER SIDE
MUFFLERS	SEE NOTE 6
FAN BELT	EITHER SIDE
BATTERY	RIGHT SIDE
AC OUTLET(S)	RIGHT SIDE

REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS

WEIGHT DATA	
5. 4L 80KW	- 977 KG (2153 LB)
6. 8L 100KW	- 1036 KG (2285 LB)
6. 8L 130KW	- 1113 KG (2453 LB)
6. 8L 150KW	- 1019 KG (2246 LB)
WOODEN SHIPPING SKIDS INCREASE OVERALL WEIGHT 79KG (175 LB)	

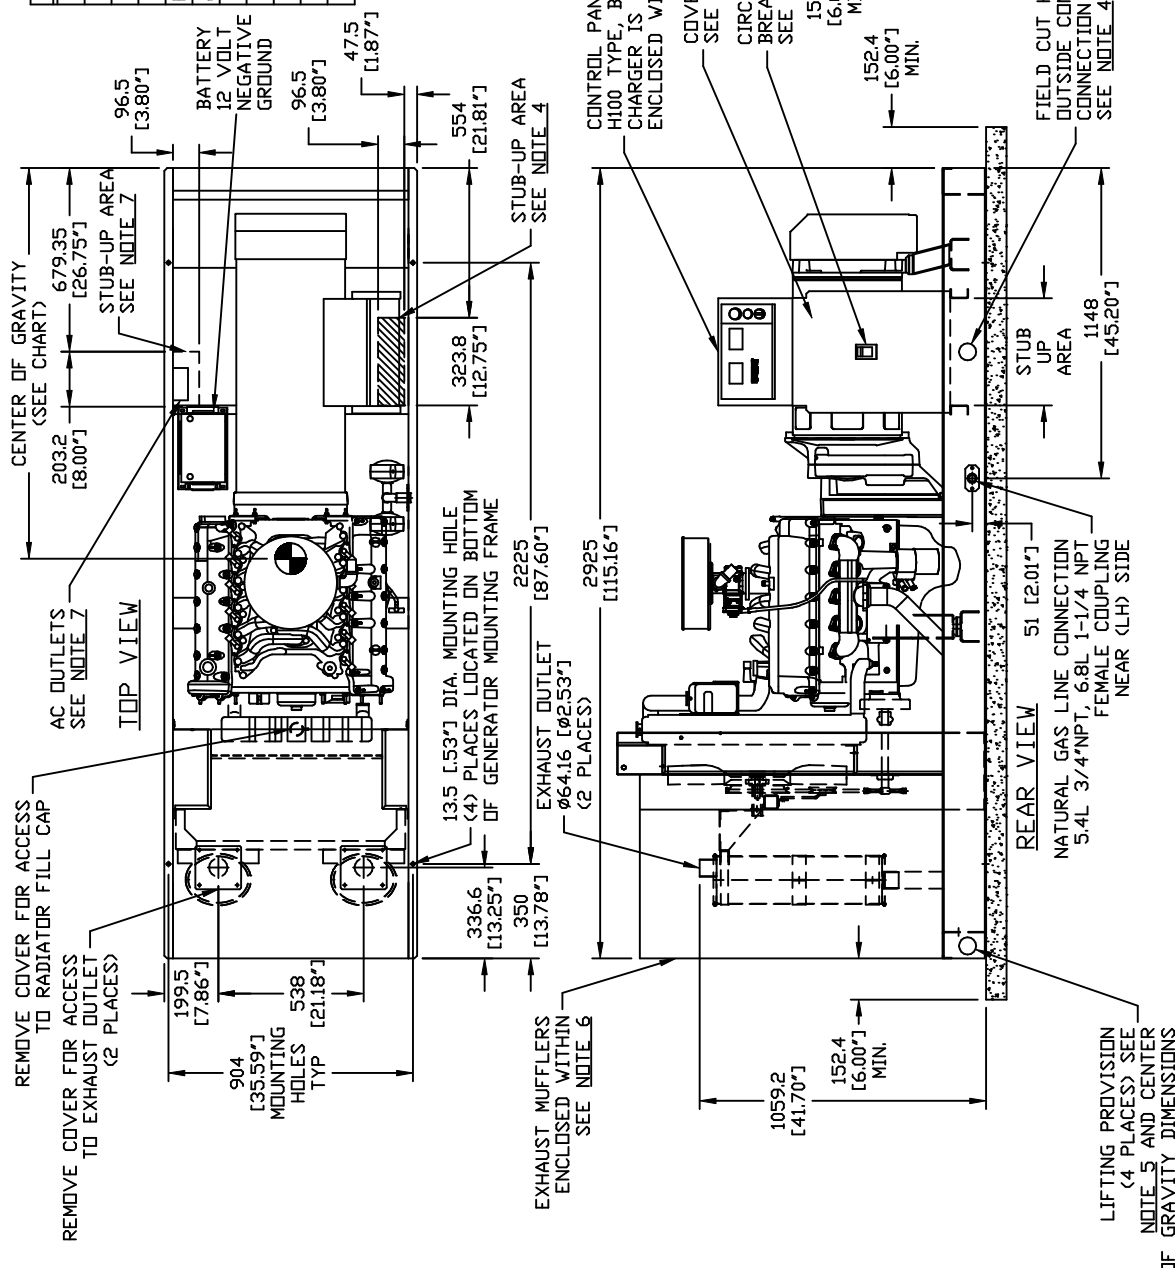

EXPLODED VIEW:
INSTALL 5.4L/6.8L IND C5 OPEN
DRAWING #: 0G1541