


GROUP G

NOTES:

- 1) MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1155 (45. 5') WIDE X 2255 (88. 8') LONG.
- 2) ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE AND LOCAL CODES FOR MINIMUM DISTANCES FROM OTHER STRUCTURES.
- 3) CIRCUIT BREAKER INFORMATION:
SEE SPECIFICATION SHEET WITHIN OWNERS MANUAL.
- 4) REMOVE THE CIRCUIT BREAKER BOX FRONT COVER TO ACCESS THE STUB UP AREAS AS FOLLOWS:
-HIGH VOLTAGE CONNECTION INCLUDING AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION, BATTERY CHARGER 120 VOLT AC (0. 5 AMP MAX) CONNECTION, GFCI 120 V AC OUTLET CONNECTION.
-LOW VOLTAGE CONNECTIONS INCLUDING TRANSFER SWITCH CONTROL WIRES AND ACCESSORY RELAY CONNECTION (QTY 4)
4A) FIELD CUT HOLE IS ONLY REQUIRED FOR MOUNTING OF GENERATOR ON AN EXISTING PAD.
- 5) REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
- 6) REMOVE EITHER LEFT OR RIGHT HAND SIDE PANEL TO ACCESS EXHAUST MUFFLERS.
- 7) PRE-WIRED 20A GFCI OUTLET FOR ENG BLOCK HEATER.

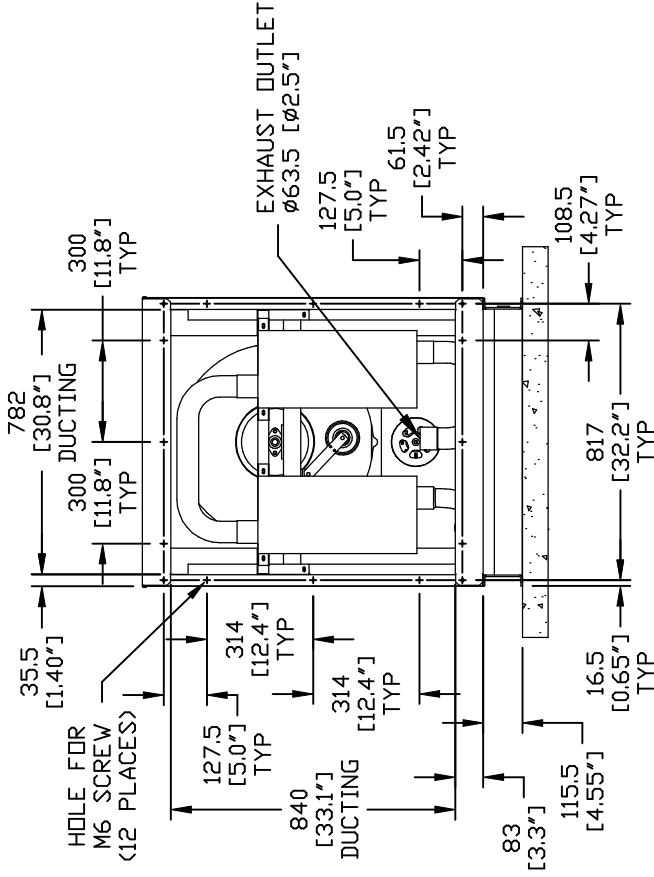

FRONT VIEW

WEIGHT DATA	
2. 4L 25KW	528KG (1,163 LB)
WOODEN SHIPPING SKIDS INCREASE	
OVERALL WEIGHT 42KG (98LB)	




EXPLODED VIEW:
INSTALL DRAWING 2.4L IND C2 OPEN SET
DRAWING #: 0J7003A

GROUP G

SERVICE ITEM ACCESSIBILITY CHART

SERVICE ITEM	2.4L
OIL FILL CAP	EITHER SIDE
OIL DIP STICK	RIGHT SIDE
OIL FILTER	RIGHT SIDE
OIL DRAIN HOSE	RIGHT SIDE
RADIATOR DRAIN HOSE	LEFT SIDE
AIR CLEANER ELEMENT	EITHER SIDE
SPARK PLUGS	RIGHT SIDE
MUFFLERS	SEE NOTE 6
FAN BELT	EITHER SIDE
BATTERY	LEFT SIDE
AC OUTLET(S)	LEFT SIDE

REFERENCE OWNERS MANUAL FOR PERIODIC
REPLACEMENT PART LISTINGS

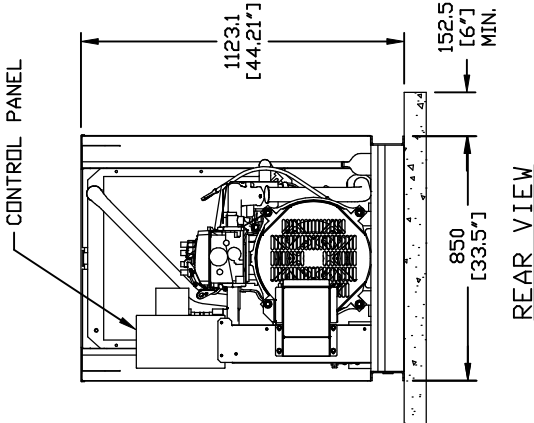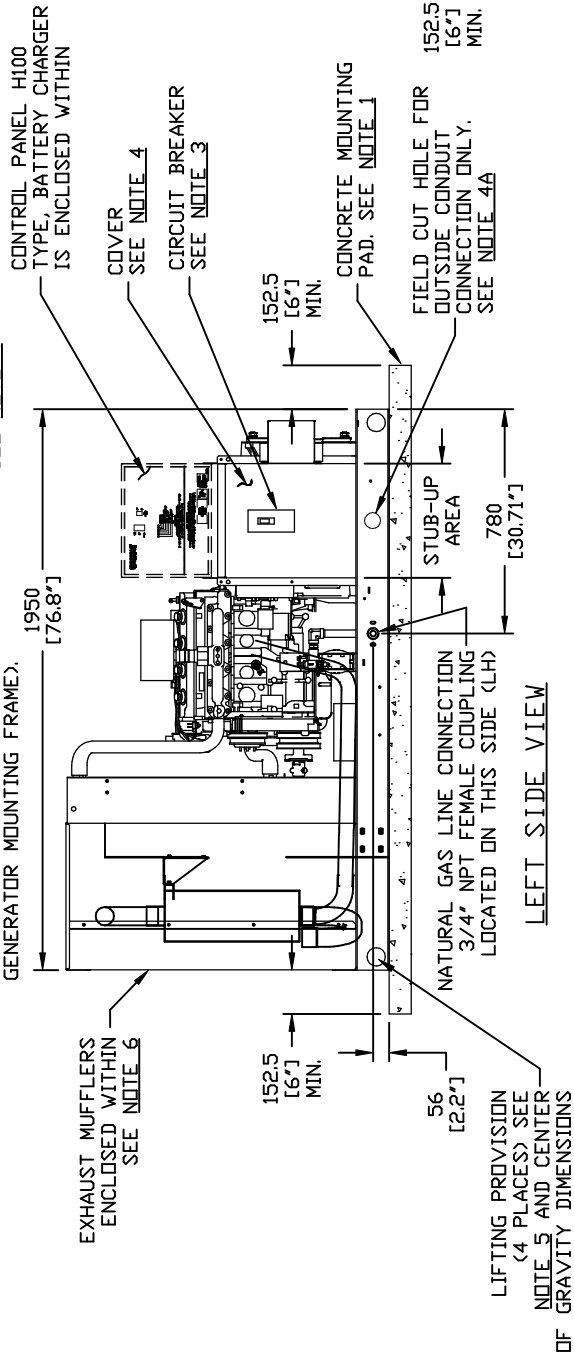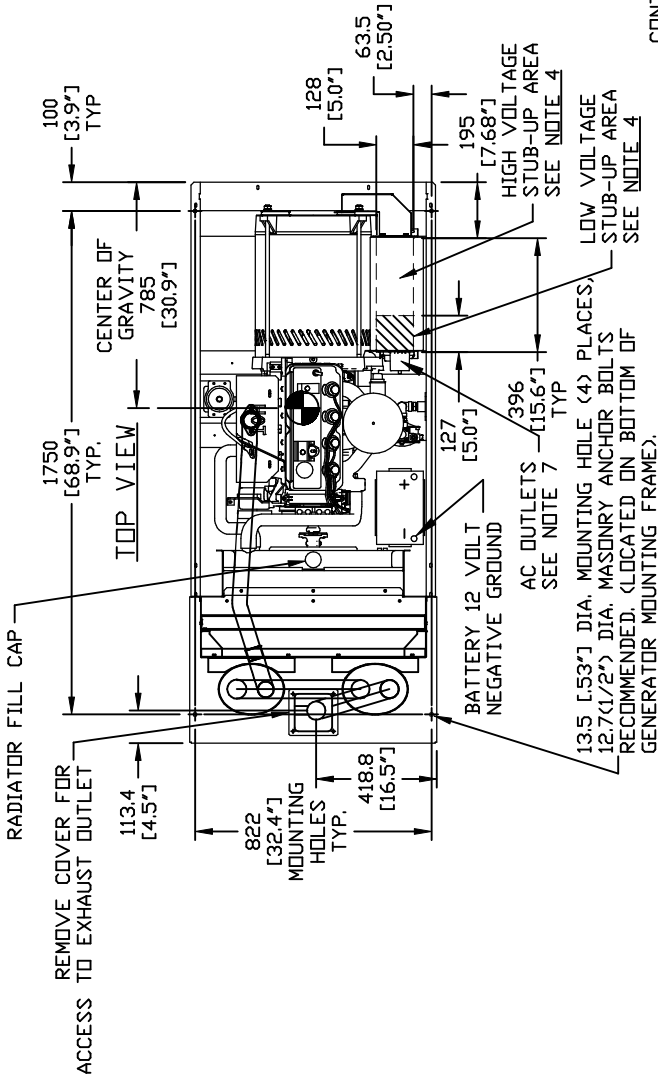

EXPLODED VIEW:
INSTALL DRAWING 2.4L IND C2 OPEN SET
DRAWING #: 0J7003A