


- NOTES:
- 1) MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1155 (45.5') WIDE X 2255 (88.8') LONG.
 - 2) ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE AND LOCAL CODES FOR MINIMUM DISTANCES FROM OTHER STRUCTURES.
 - 3) CIRCUIT BREAKER INFORMATION:
SEE SPECIFICATION SHEET WITHIN OWNERS MANUAL.
 - 4) INSIDE STUB-UP AREA FOR AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION, AUXILIARY OUTPUT RELAYS, AND ACCESS TO TRANSFER SWITCH CONTROL WIRES. REMOVE COVER FOR ACCESS.
 - 4A) FIELD CUT HOLE IS ONLY REQUIRED FOR MOUNTING OF GENERATOR ON AN EXISTING PAD.
 - 5) REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
 - 6) REMOVE EITHER LEFT OR RIGHT HAND SIDE PANEL TO ACCESS EXHAUST MUFFLERS.
 - 7) INSIDE ACCESS TO 120VAC, 20A GFCI OUTLET PREWIRED TO SUPPLY POWER TO BATTERY CHARGER.
USE 20A GFCI OUTLET FOR ENG BLOCK HEATER.

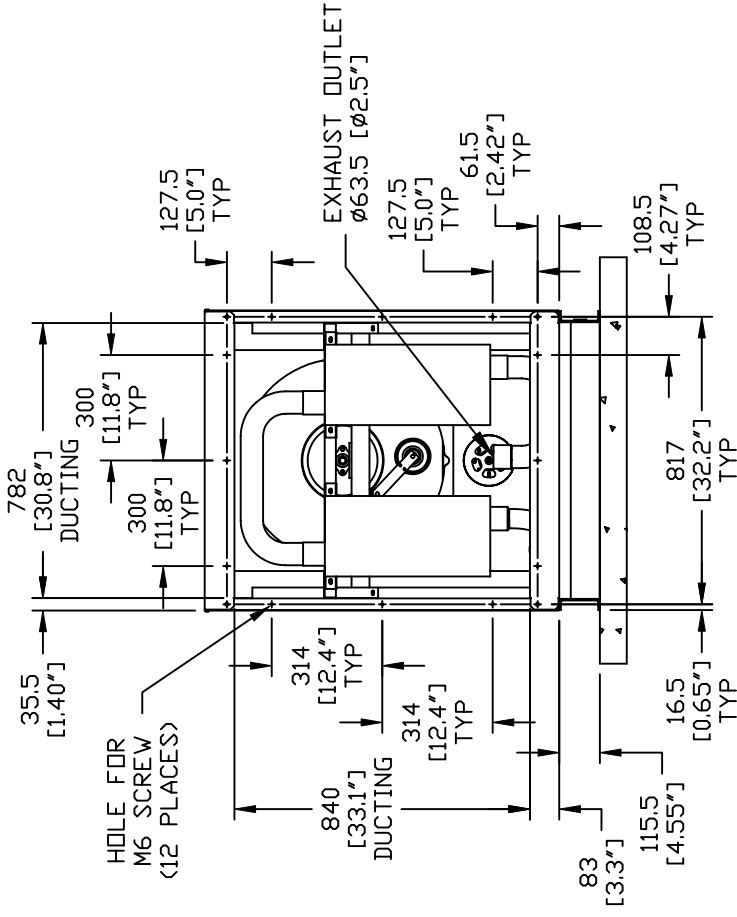

FRONT VIEW

WEIGHT DATA	
2. 4L 25KW 528KG (1,163 LB)	
WOODEN SHIPPING SKIDS INCREASE	
OVERALL WEIGHT 42KG (98LB)	


EXPLODED VIEW:
INSTALL 2.4L IND C2 OPEN
DRAWING #: 0G2833

GROUP G

SERVICE ITEM ACCESSIBILITY CHART

SERVICE ITEM	2. 4L
OIL FILL CAP	EITHER SIDE
OIL DIP STICK	RIGHT SIDE
OIL FILTER	RIGHT SIDE
OIL DRAIN HOSE	RIGHT SIDE
RADIATOR DRAIN HOSE	LEFT SIDE
AIR CLEANER ELEMENT	EITHER SIDE
SPARK PLUGS	RIGHT SIDE
MUFFLERS	SEE NOTE 6
FAN BELT	EITHER SIDE
BATTERY	LEFT SIDE
AC OUTLET(S)	RIGHT SIDE

REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS

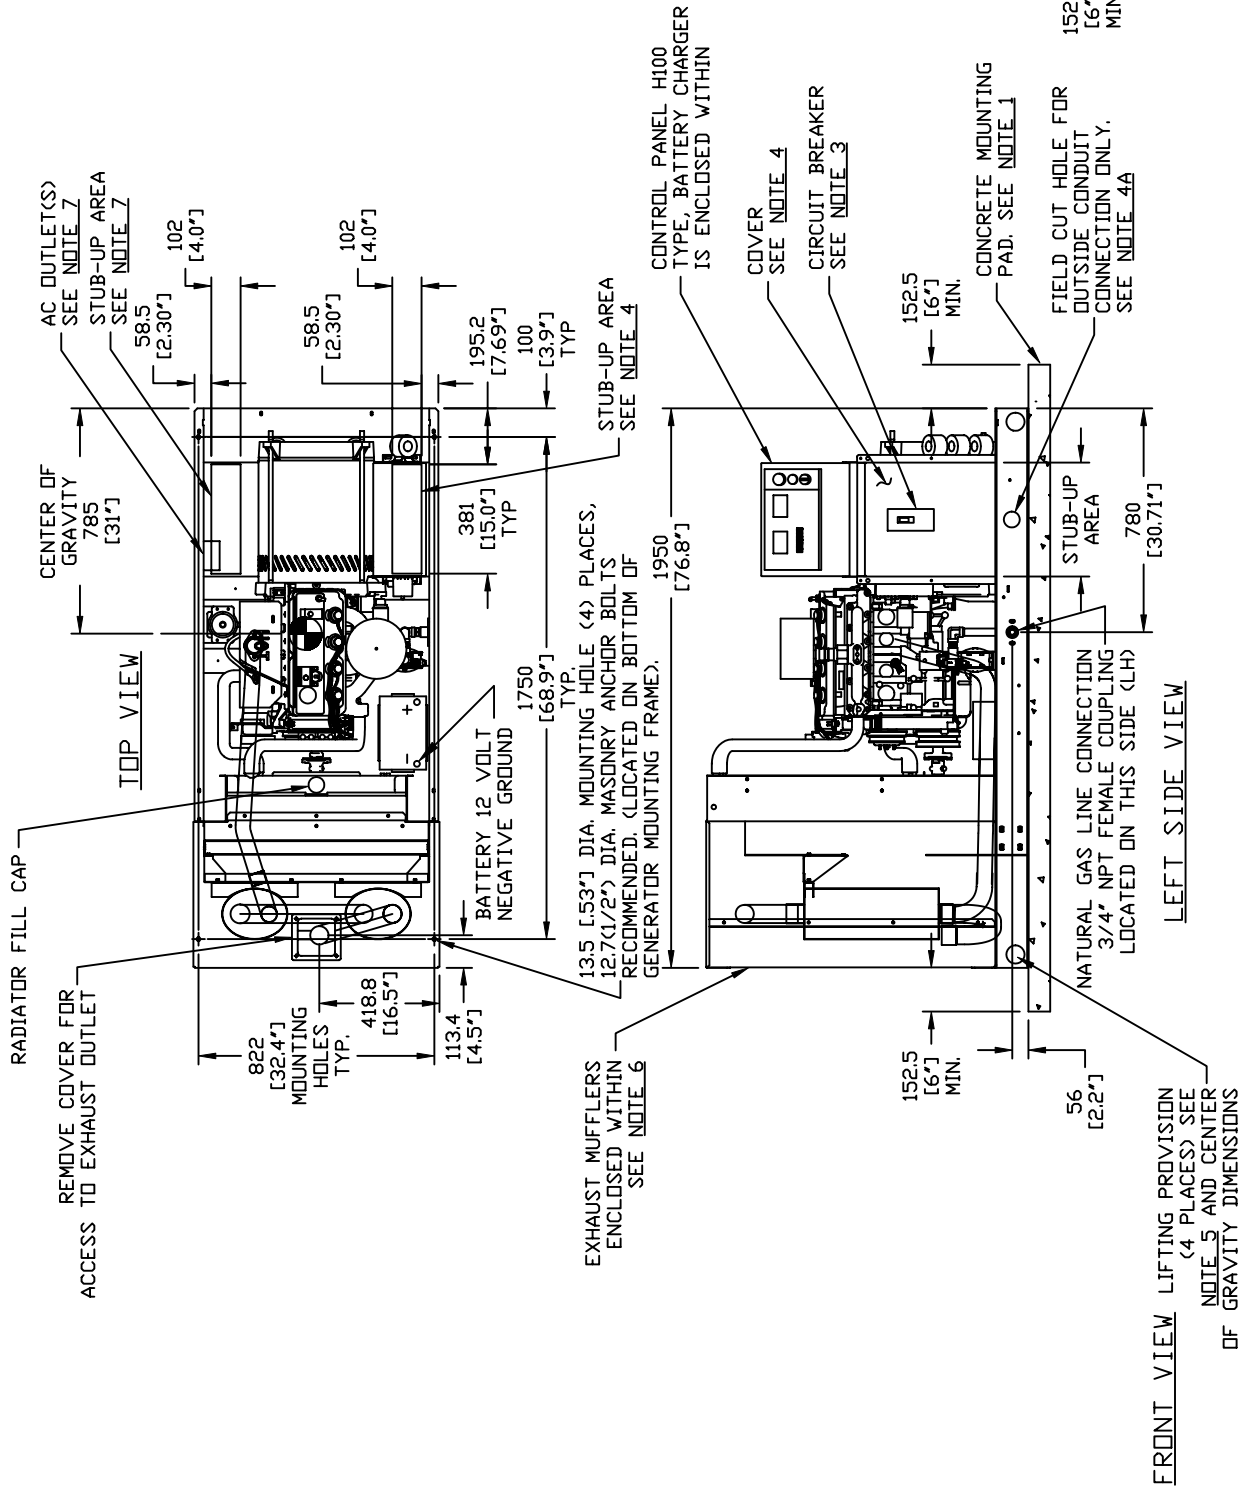

EXPLODED VIEW:
INSTALL 2.4L IND C2 OPEN
DRAWING #: 0G2833