


## COMPONENTS LOCATED ON ENGINE

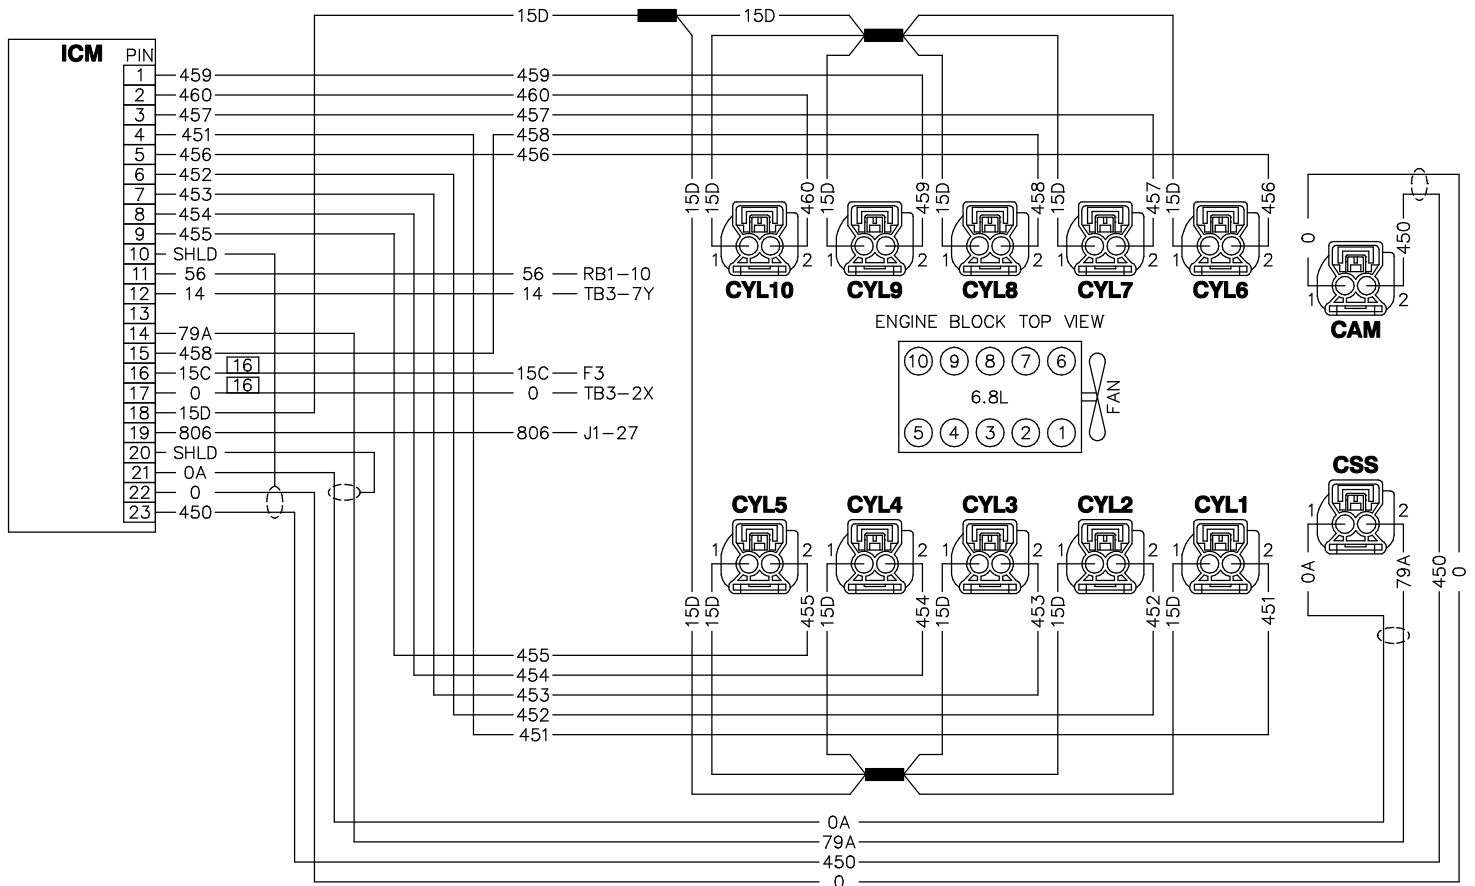



NOTE: ALL WIRES 18 AWG  
300V UL LISTED UNLESS  
SHOWN OTHERWISE

AWG SIZE


S1, S2 & S3 ARE 600V  
UL LISTED

OPTION NOT  
AVAILABLE  
ON CPL UNITS

**OTS1**

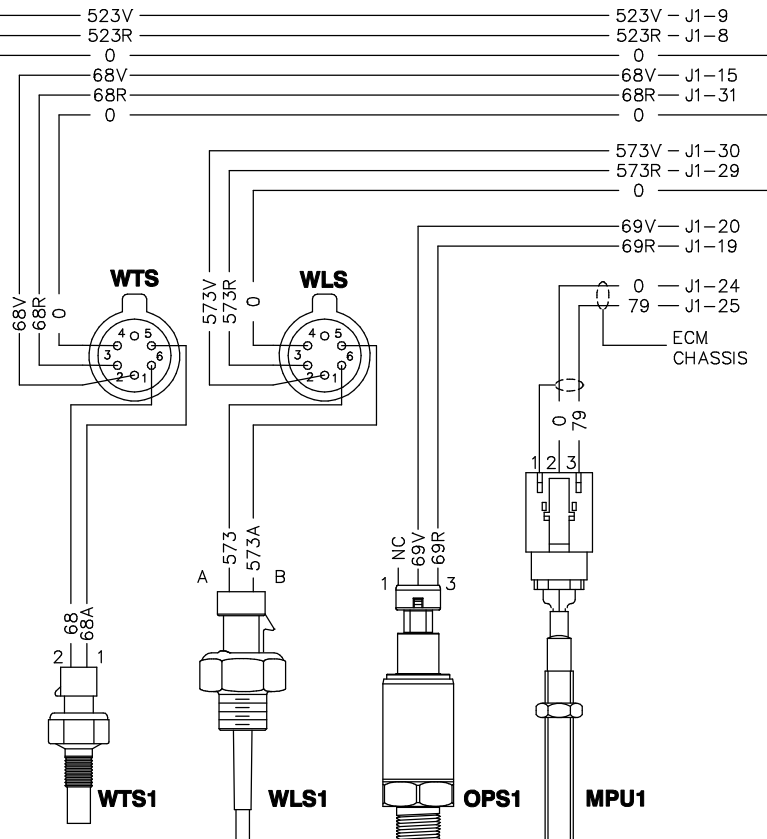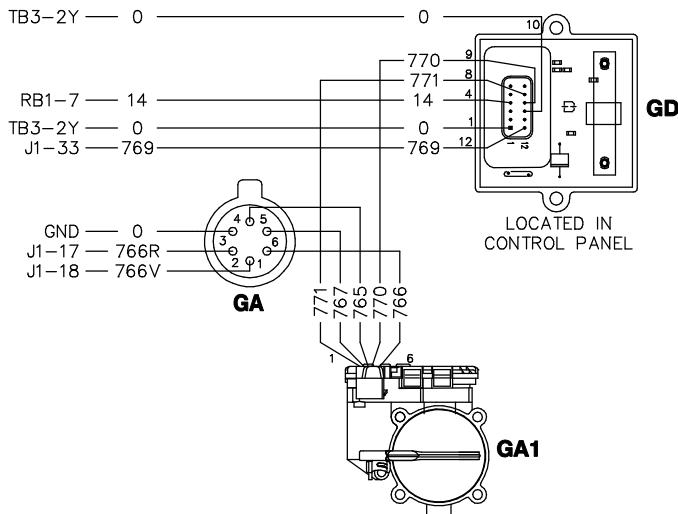



## COMPONENTS LOCATED ON ENGINE

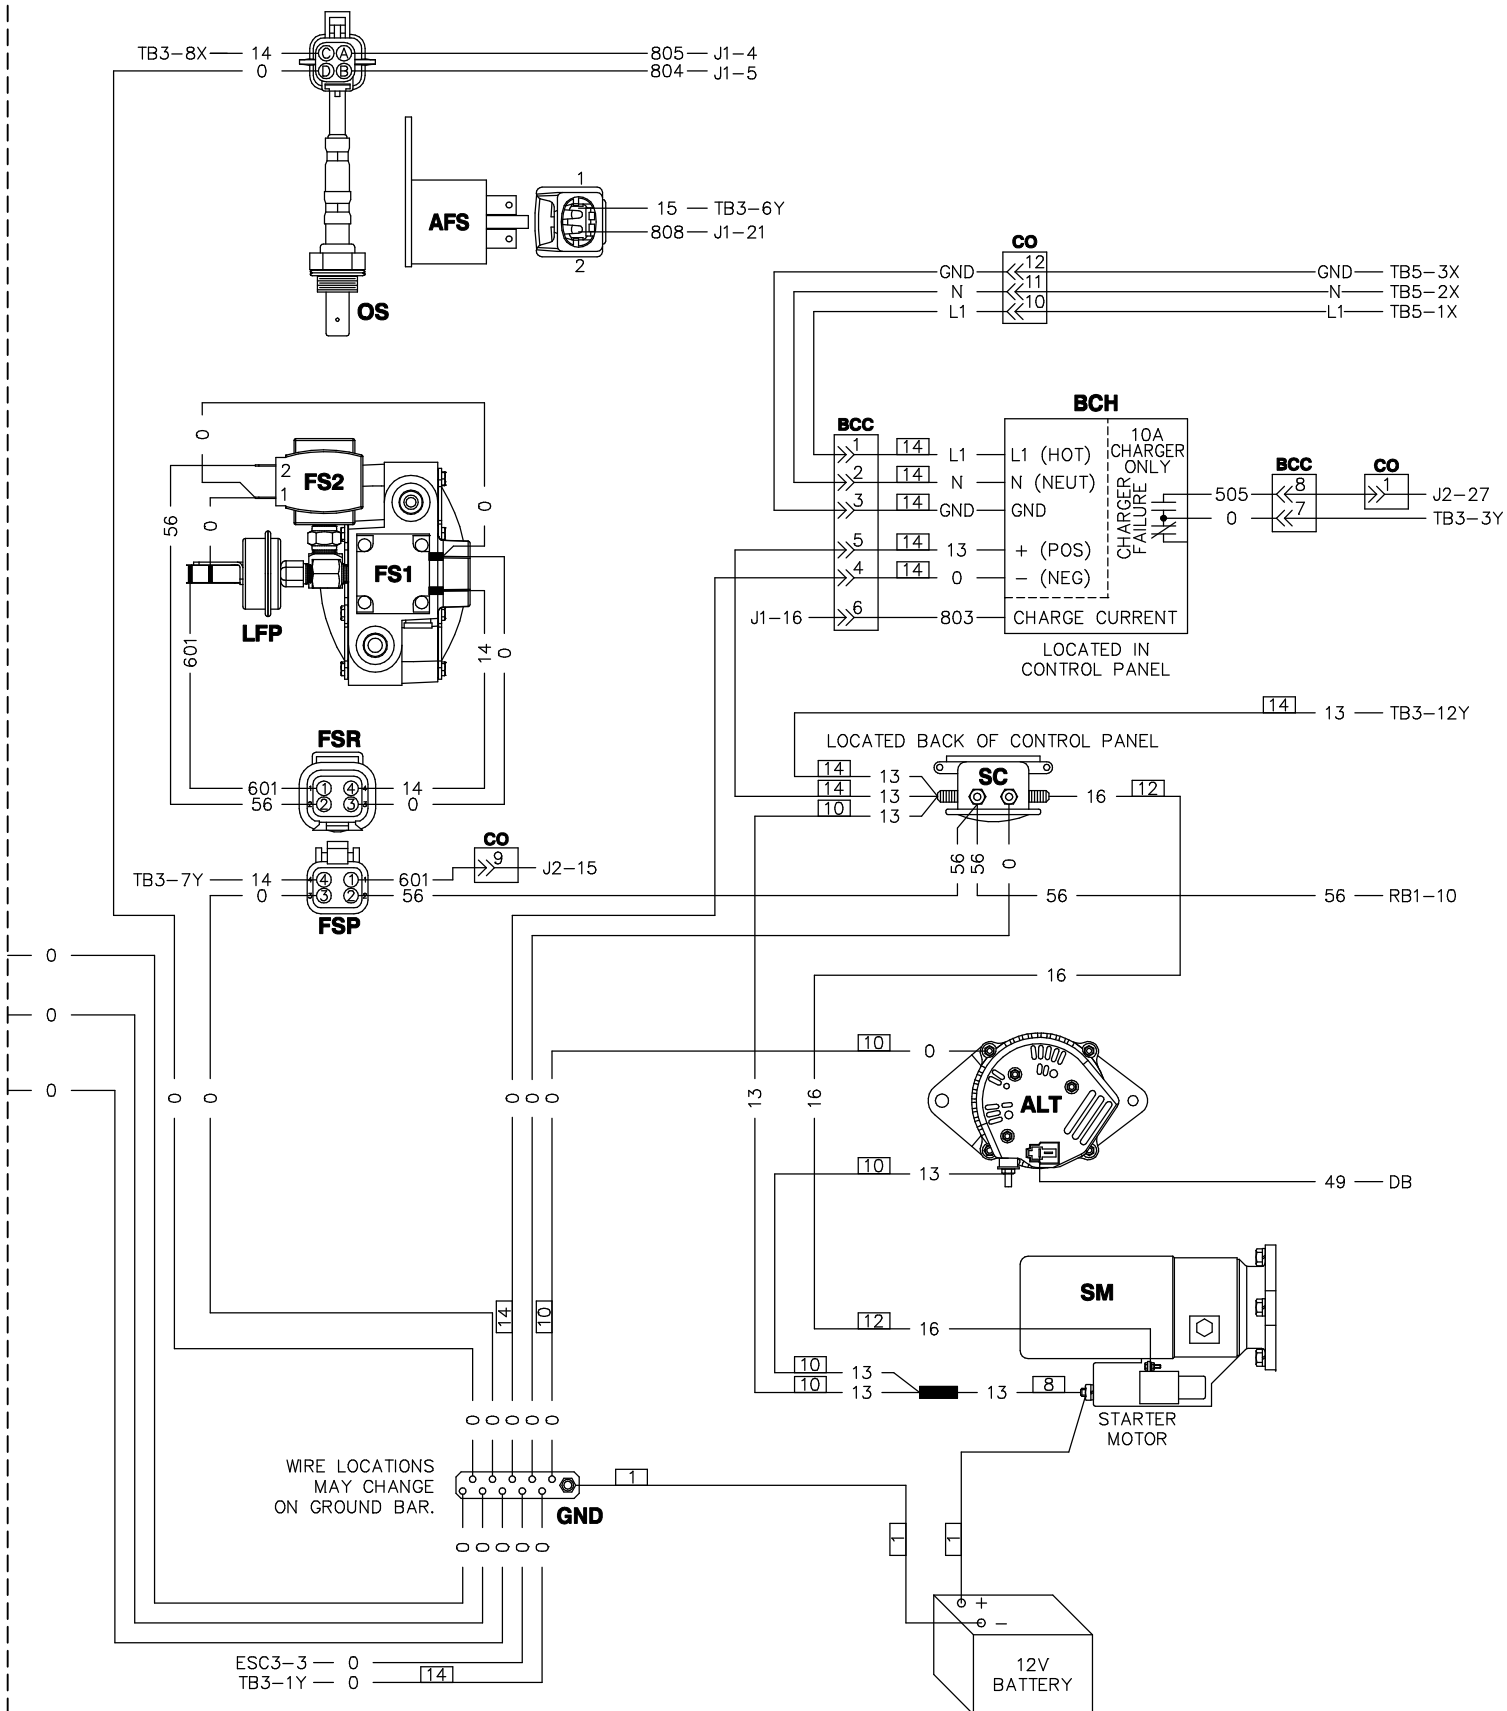

## COMPONENTS LOCATED IN CIRCUIT BREAKER STAND




### CONNECTIONS FOR 1Ø UNIT

### CONNECTIONS FOR 3Ø UNIT

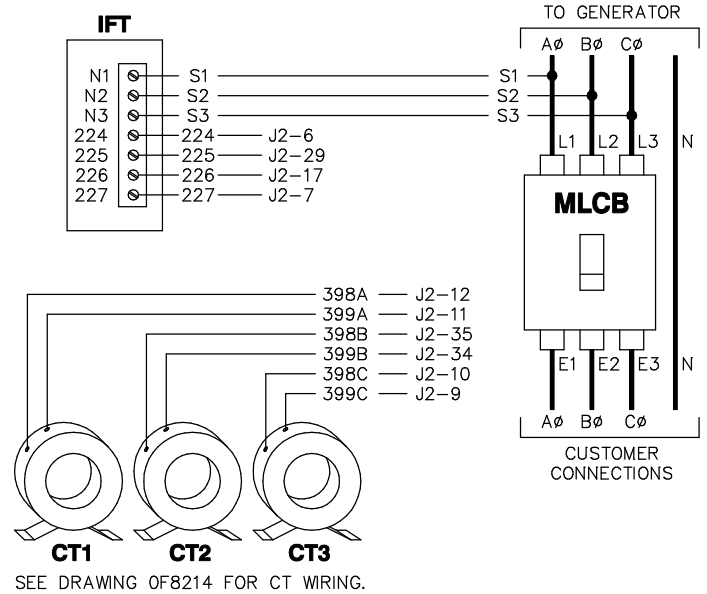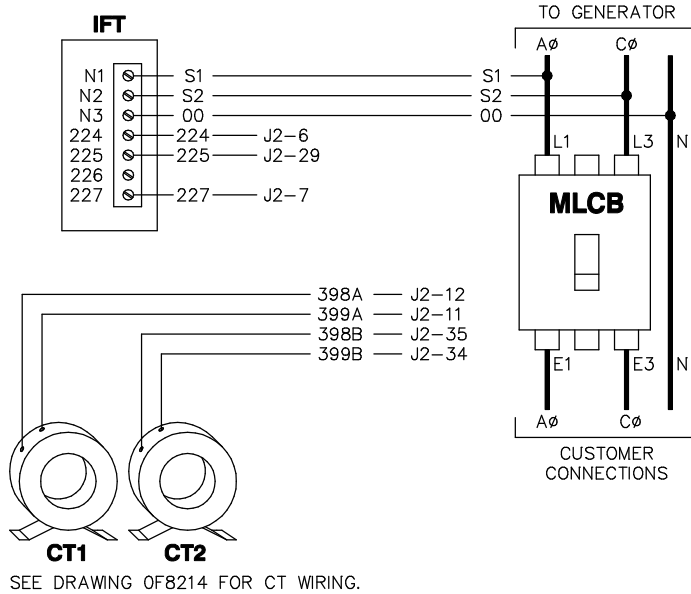

## COMPONENTS LOCATED IN CIRCUIT BREAKER STAND

## COMPONENTS LOCATED IN EXCITER SHIELD

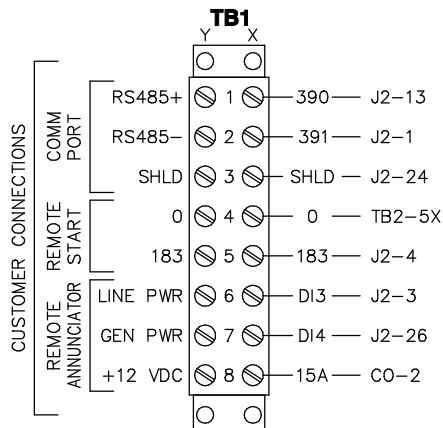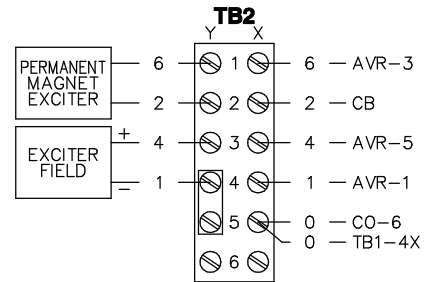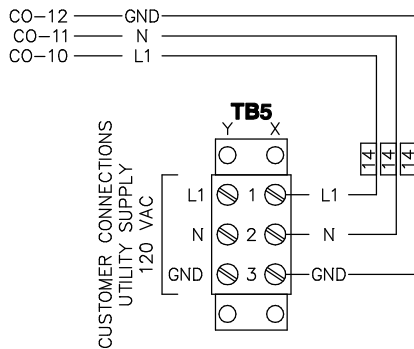

### COMPONENTS LOCATED IN CONTROL PANEL

**MOD**