


ENGINE/KW	WEIGHT DATA			
	ENCLOSURE MATERIAL	WEIGHT (GENSET ONLY) KG [LBS]	WEIGHT (WOODEN SHIPPING CRATE/SKID) KG [LBS]	SHIPPING WEIGHT (SKID AND GENSET) KG [LBS]
4, 6L/80KW	STEEL	1020 [2249]	79 [175]	1100 [2424]
	ALUMINUM	941 [2075]	79 [175]	1021 [2250]


NOTES:

- 1) MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1241 (49") WIDE X 3231 (127.25') LONG. REFERENCE INSTALLATION GUIDE SUPPLIED WITH UNIT FOR CONCRETE PAD GUIDELINES.
- 2) ALLOW SUFFICIENT ROOM ON ALL SIDES OF GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA37, NFPA70 STANDARDS AND ANY OTHER FEDERAL, STATE AND LOCAL CODES FOR MINIMUM DISTANCES FROM OTHER STRUCTURES.
- 3) CIRCUIT BREAKER INFORMATION: SEE SPECIFICATION SHEET WITHIN OWNERS MANUAL.
- 4) INSIDE STUB-UP AREA FOR AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION, BATTERY CHARGER 120 VOLT AC (5 AMP MAX.) CONNECTION, AND ACCESS TO TRANSFER SWITCH CONTROL WIRES. REMOVE FRONT COVER FOR ACCESS.
- 4A) FIELD CUT HOLE IS ONLY REQUIRED FOR MOUNTING OF GENERATOR ON AN EXISTING PAD.
- 5) REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
- 6) REMOVE EITHER LEFT OR RIGHT HAND SIDE PANEL TO ACCESS EXHAUST MUFFLERS AND FAN BELT.

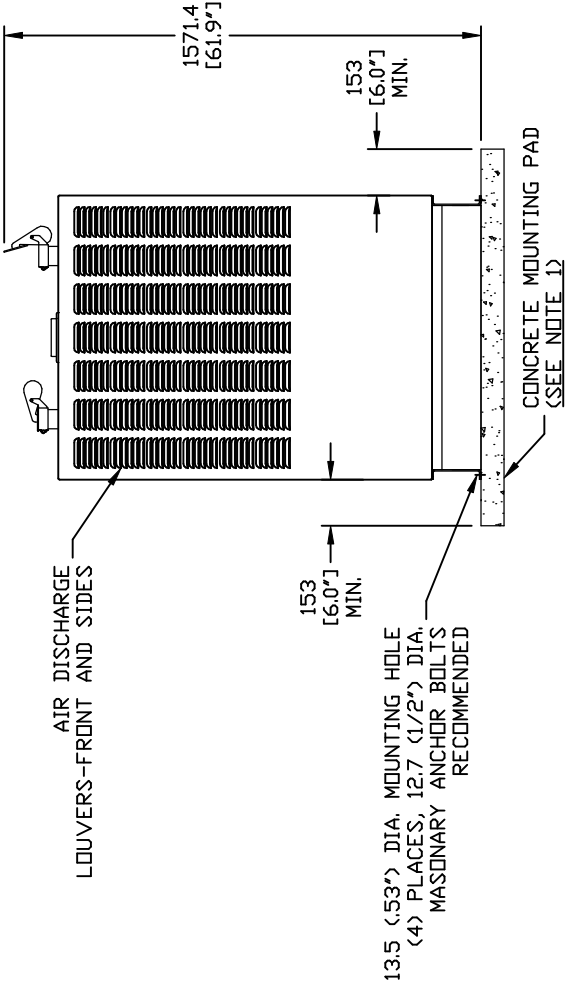


EXPLODED VIEW:
INSTALLATION DRAWING 4.6L 80KW
DRAWING #: 0G1088

GROUP G

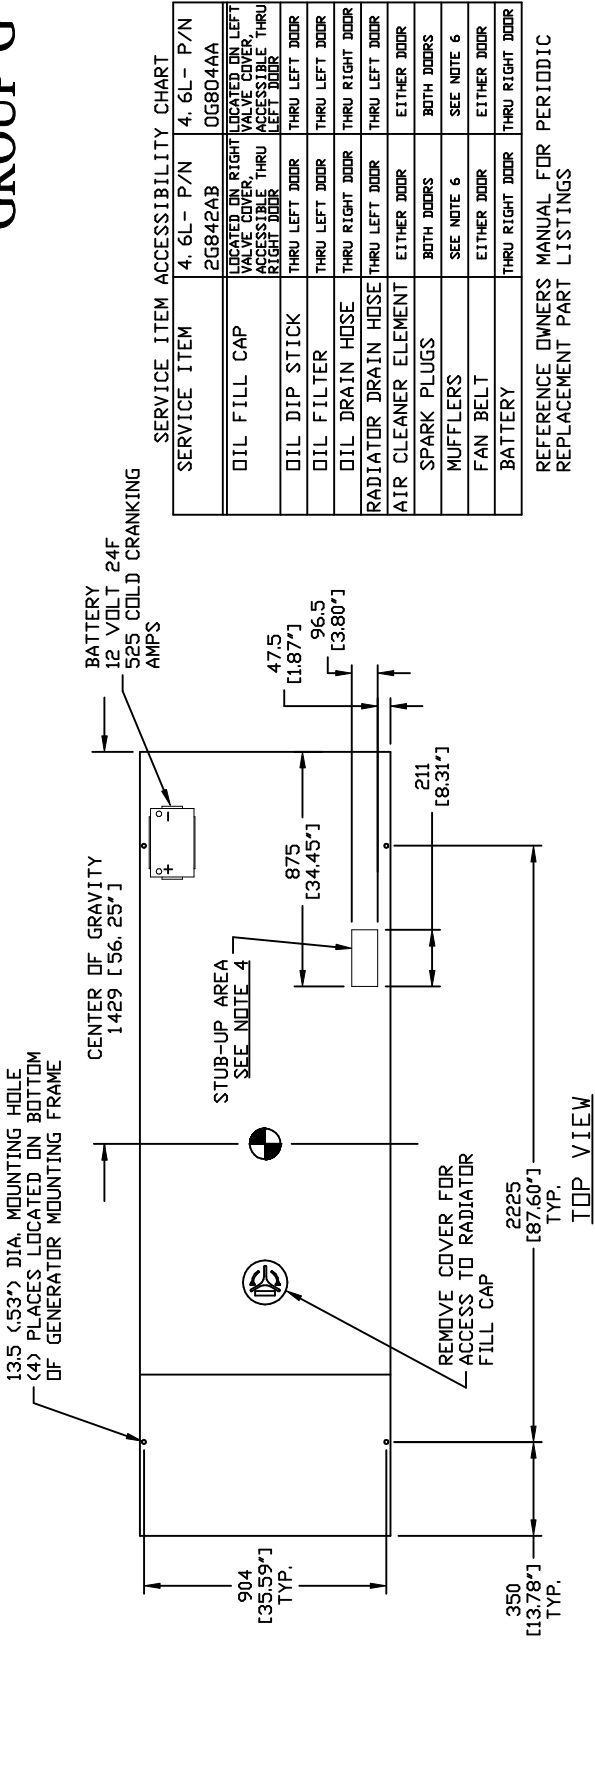

SERVICE ITEM ACCESSIBILITY CHART			
SERVICE ITEM	4. 6L- P/N	4. 6L- P/N	4. 6L- P/N
OIL FILL CAP	2G842AB	OG804AA	
	LOCATED ON RIGHT VALVE COVER, ACCESSIBLE THRU RIGHT DOOR		
OIL DIP STICK	THRU LEFT DOOR	THRU LEFT DOOR	
OIL FILTER	THRU LEFT DOOR	THRU LEFT DOOR	
OIL DRAIN HOSE	THRU RIGHT DOOR	THRU RIGHT DOOR	
RADIATOR DRAIN HOSE	THRU LEFT DOOR	THRU LEFT DOOR	
AIR CLEANER ELEMENT	EITHER DOOR	EITHER DOOR	
SPARK PLUGS	BOTH DOORS	BOTH DOORS	
MUFFLERS	SEE NOTE 6	SEE NOTE 6	
FAN BELT	EITHER DOOR	EITHER DOOR	
BATTERY	THRU RIGHT DOOR	THRU RIGHT DOOR	

REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS

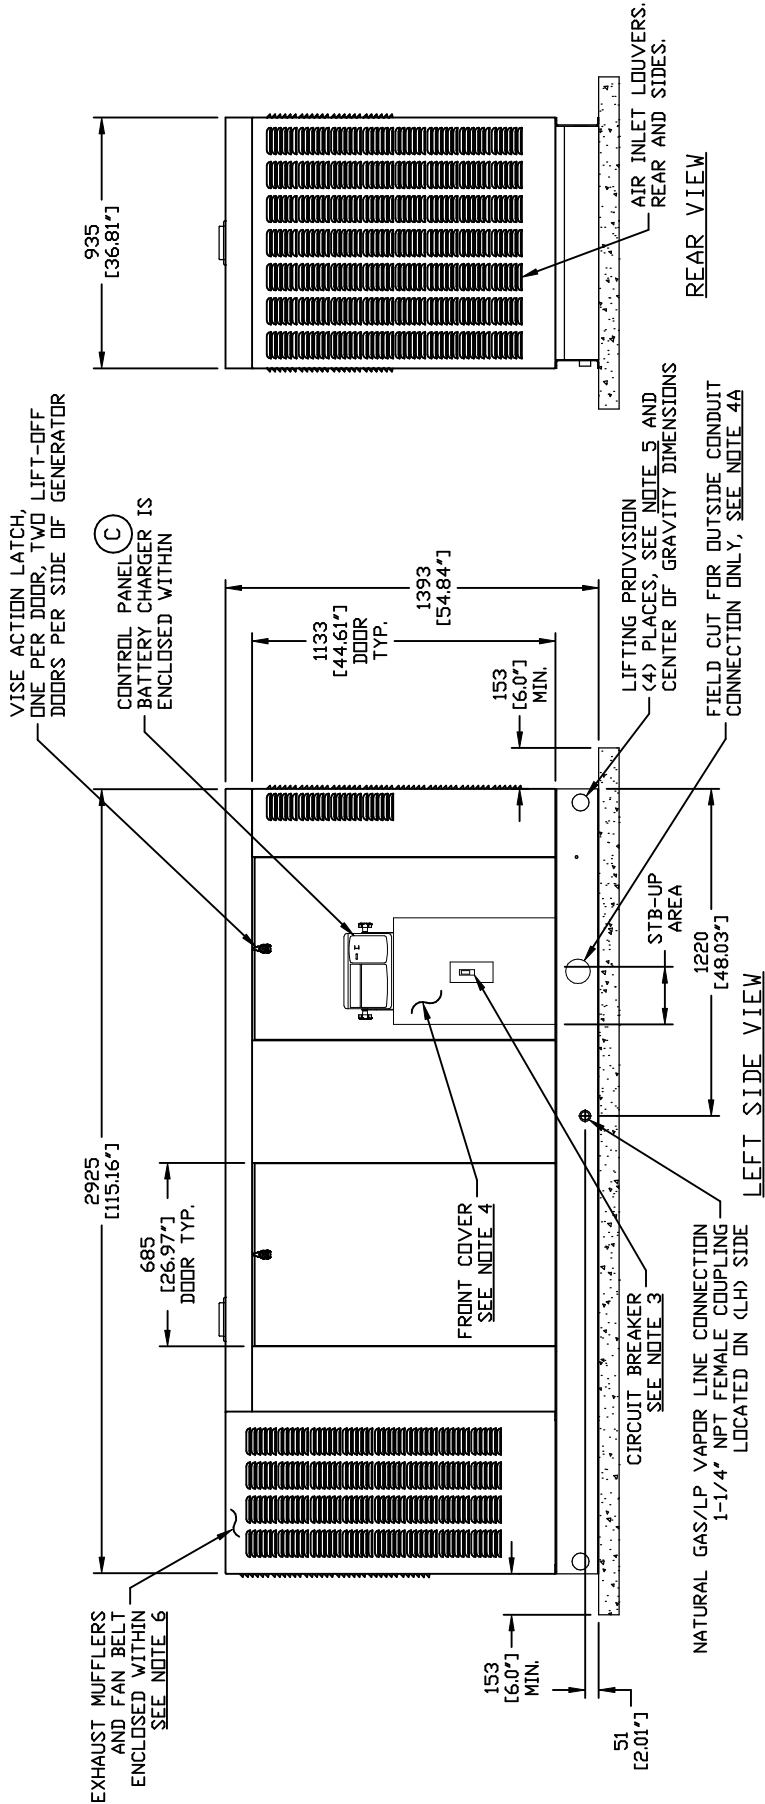

EXPLODED VIEW:
INSTALLATION DRAWING 4.6L 80KW
DRAWING #: 0G1088