



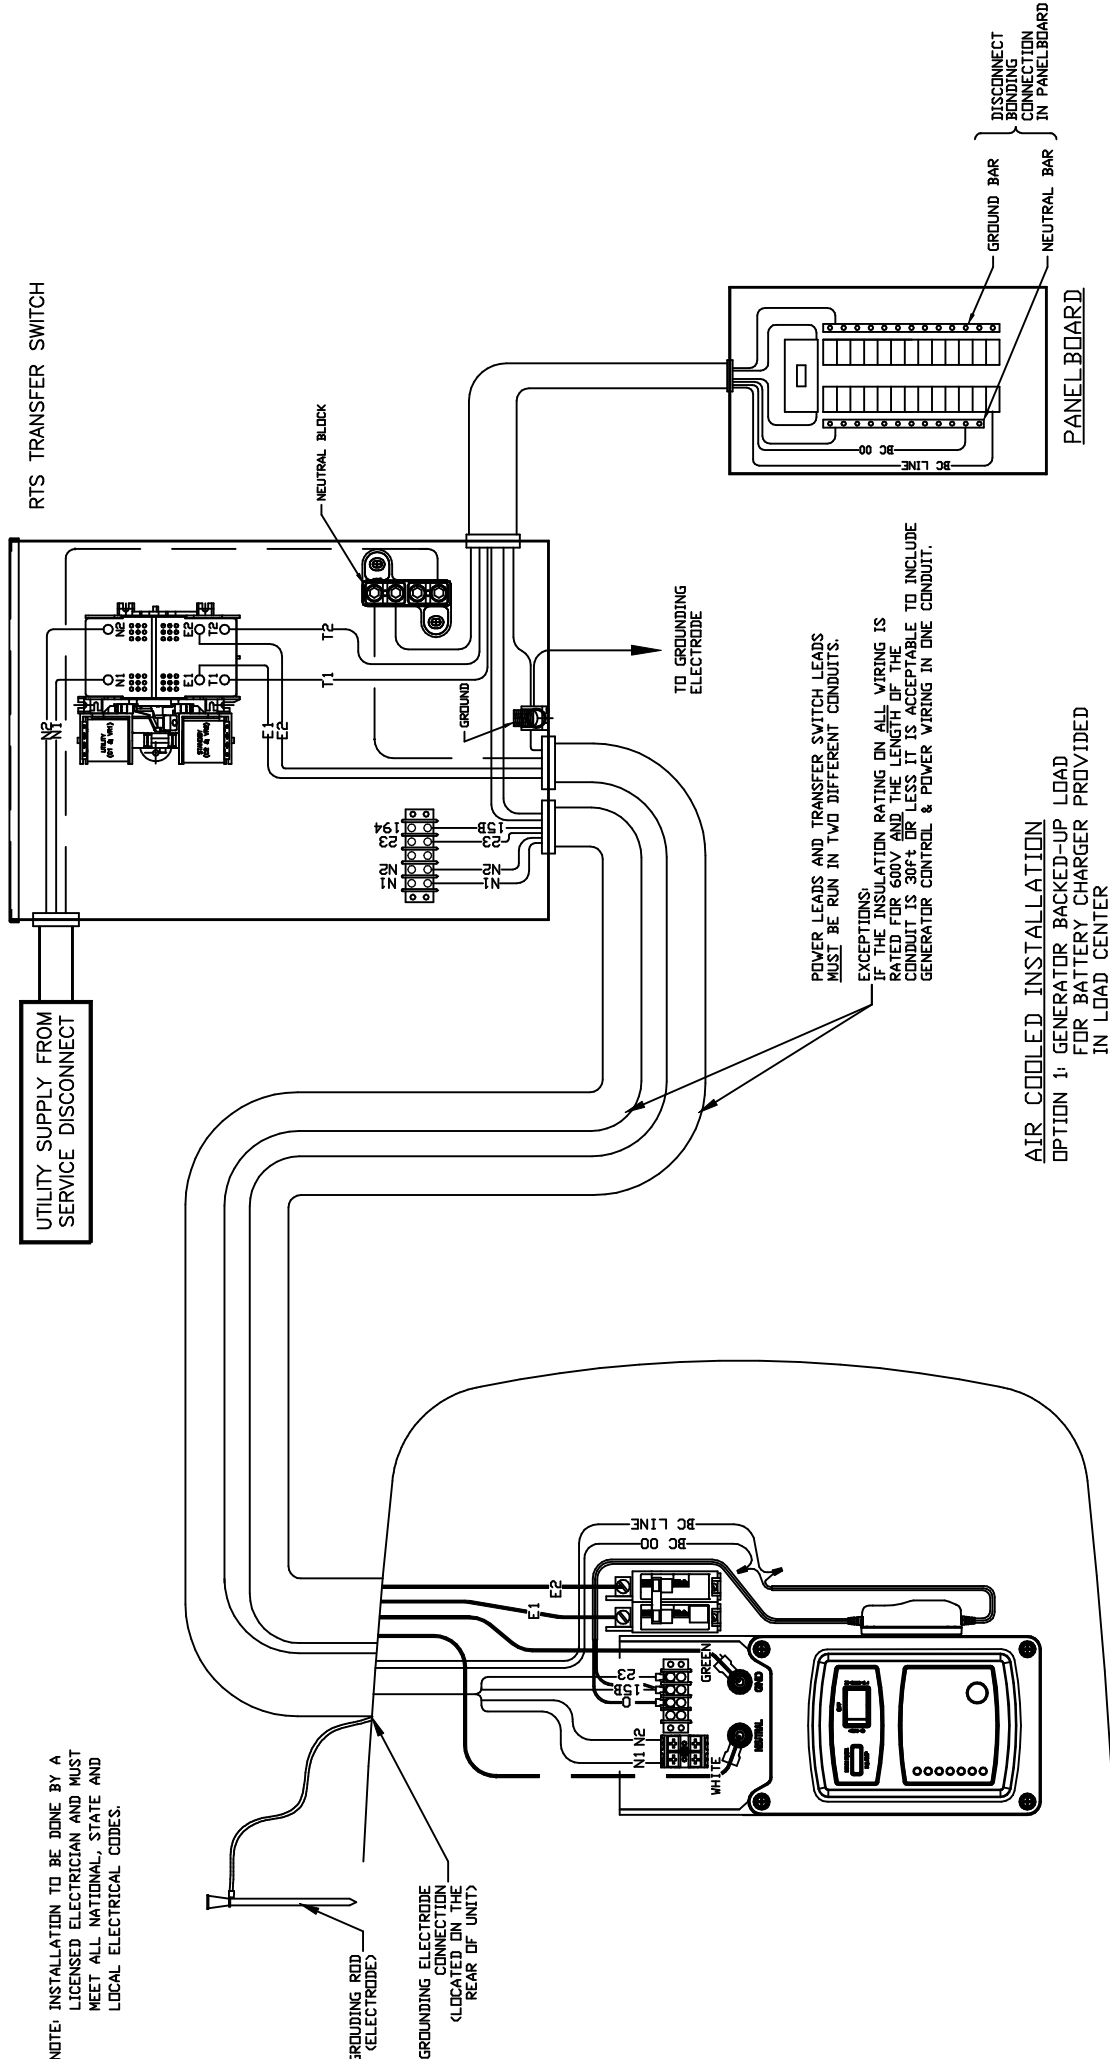

2008 AND LATER AIR-COOLED HSB GENERATORS

GROUP G

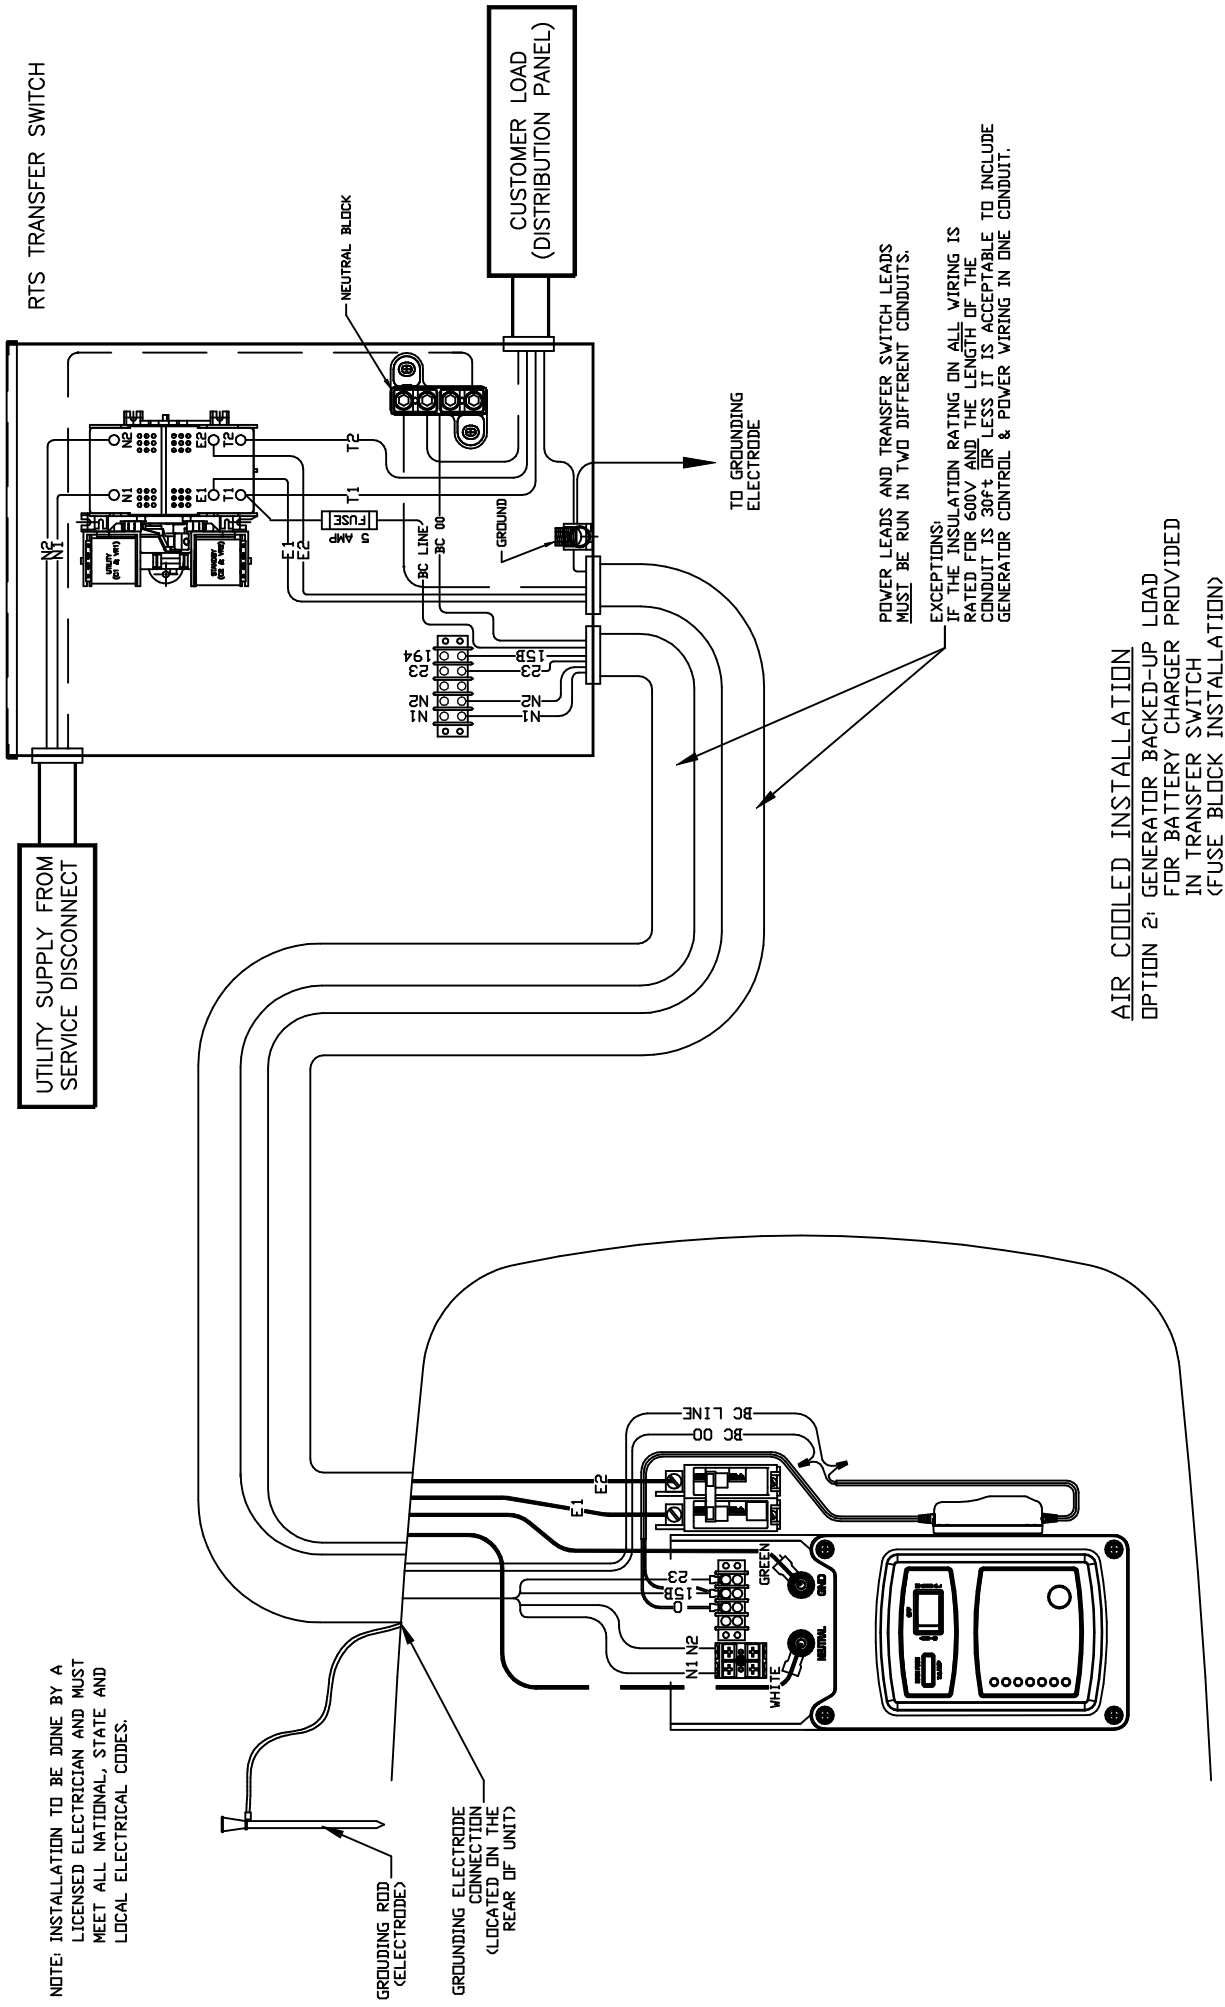

NOTE: INSTALLATION TO BE DONE BY A LICENSED ELECTRICIAN AND MUST MEET ALL NATIONAL, STATE AND LOCAL ELECTRICAL CODES.

POWER LEADS AND TRANSFER SWITCH LEADS MUST BE RUN IN TWO DIFFERENT CONDUITS.
EXCEPTIONS:
IF THE INSULATION RATING ON ALL WIRING IS RATED FOR 600V AND THE LENGTH OF THE CONDUIT IS 30ft OR LESS IT IS ACCEPTABLE TO INCLUDE GENERATOR CONTROL & POWER WIRING IN ONE CONDUIT.

AIR COOLED INSTALLATION
OPTION 2: GENERATOR BACKED-UP LOAD FOR BATTERY CHARGER PROVIDED IN TRANSFER SWITCH (FUSE BLOCK INSTALLATION)

2008 AND LATER AIR-COOLED HSB GENERATORS