


COMPONENTS LOCATED ON ENGINE

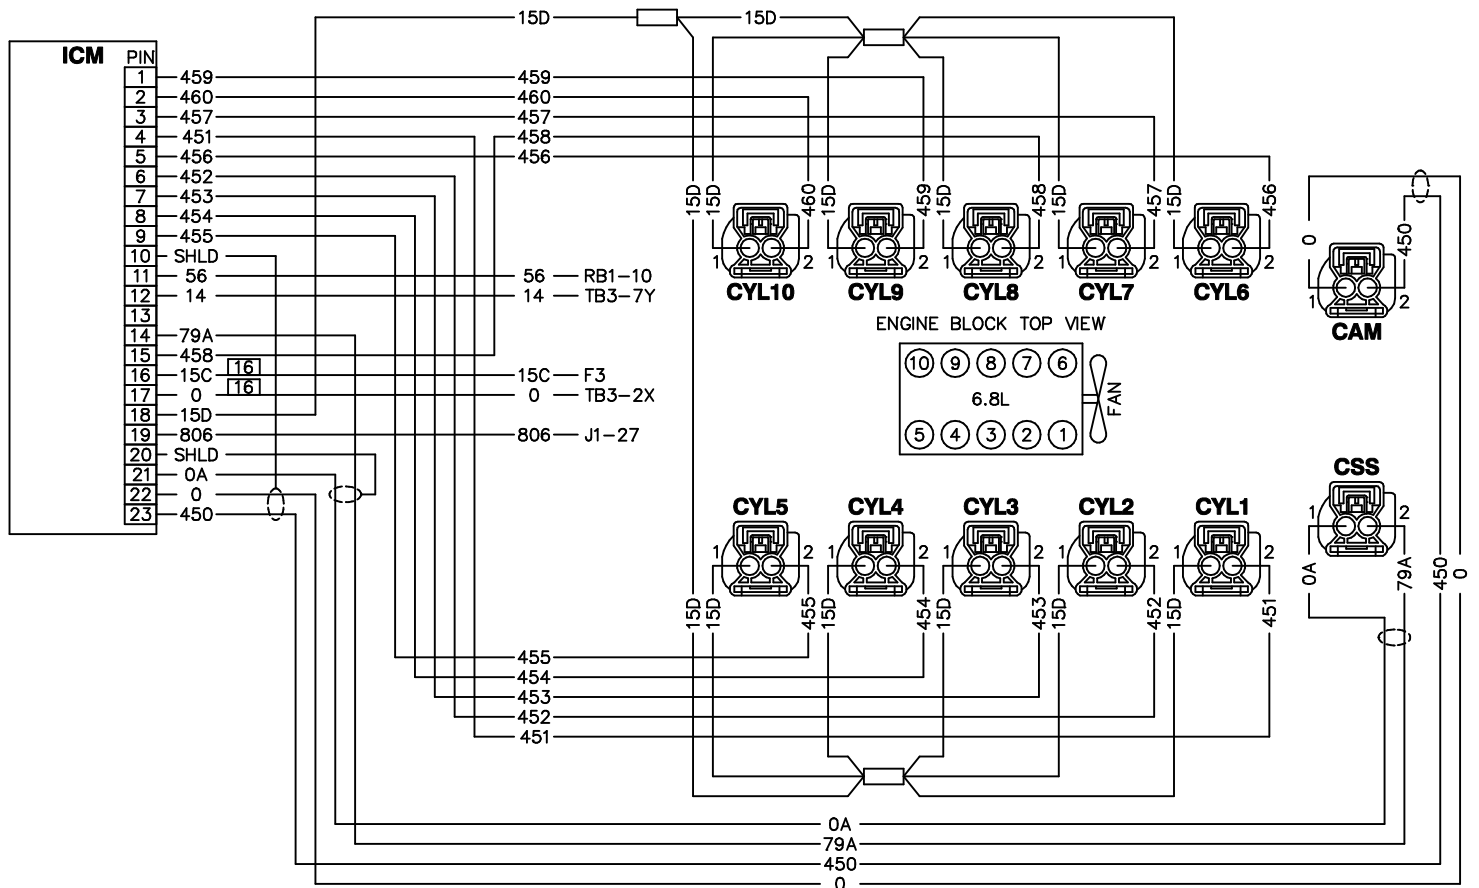



NOTE: ALL WIRES 18 AWG
300V UL LISTED UNLESS
SHOWN OTHERWISE

12


S1, S2 & S3 ARE 600V
UL LISTED

OPTION NOT
AVAILABLE
ON CPL UNITS

OTS1

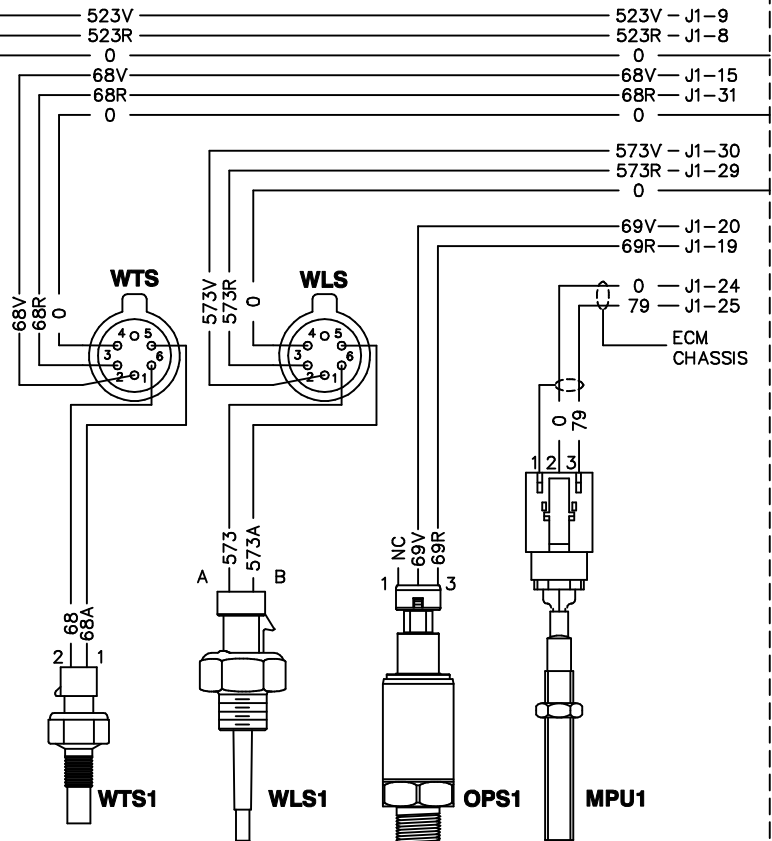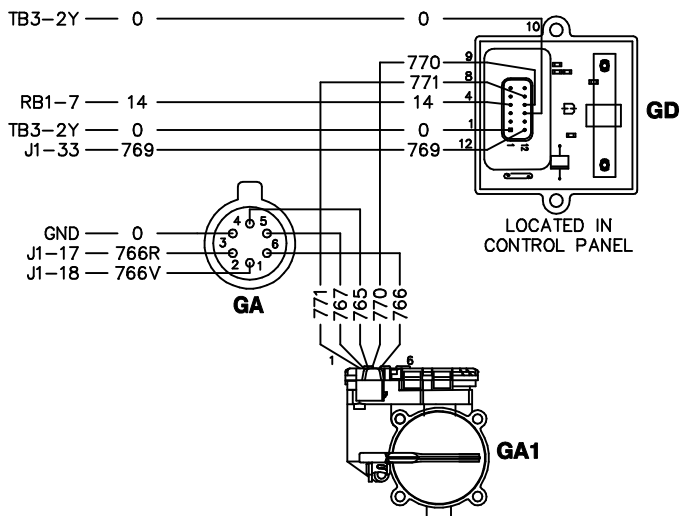



COMPONENTS LOCATED ON ENGINE

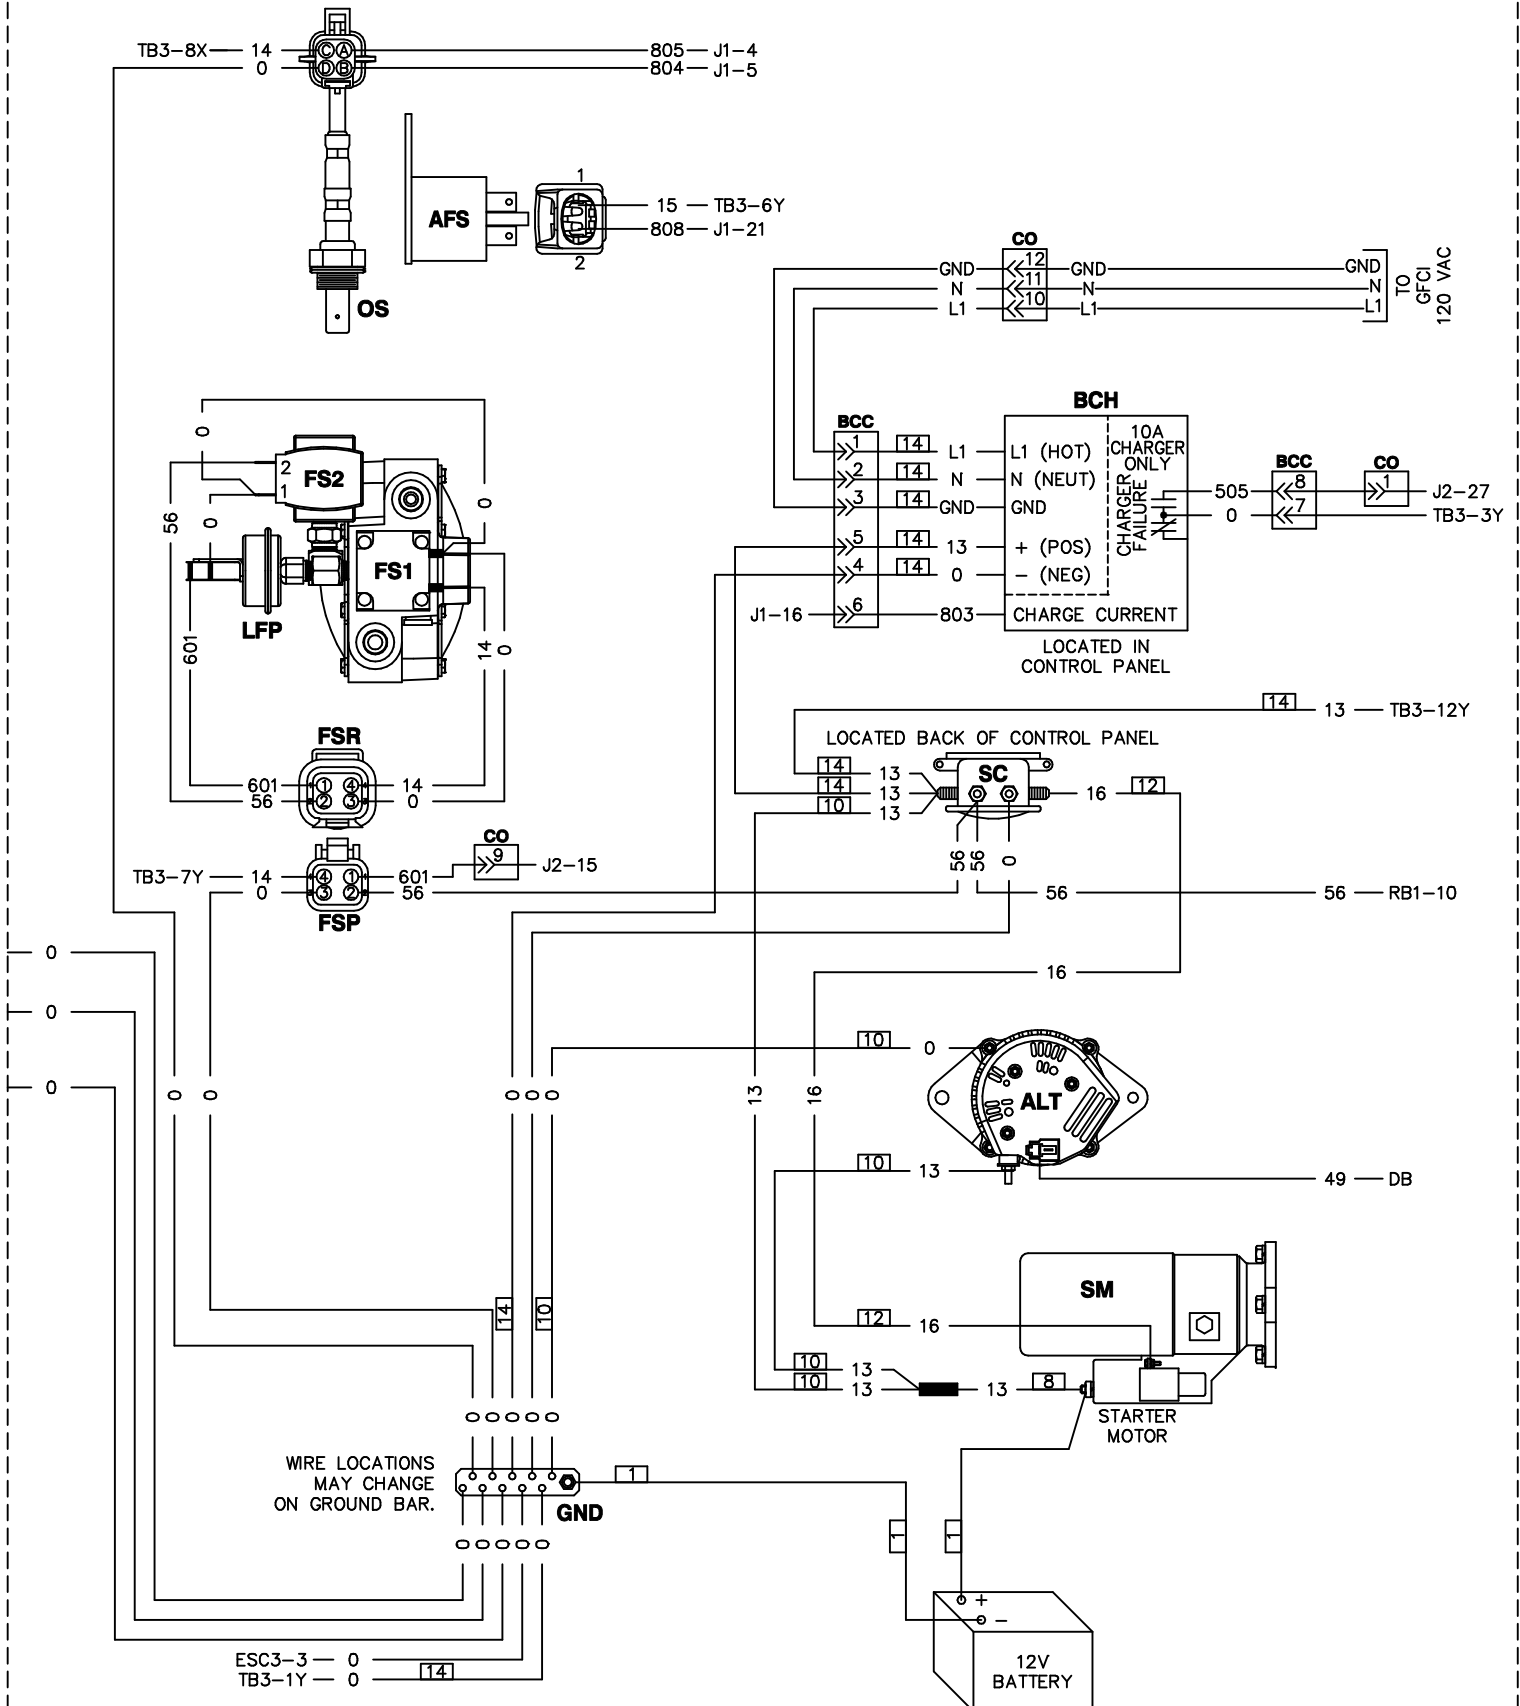

COMPONENTS LOCATED IN CIRCUIT BREAKER STAND



CONNECTIONS FOR 1Ø UNIT

CONNECTIONS FOR 3Ø UNIT

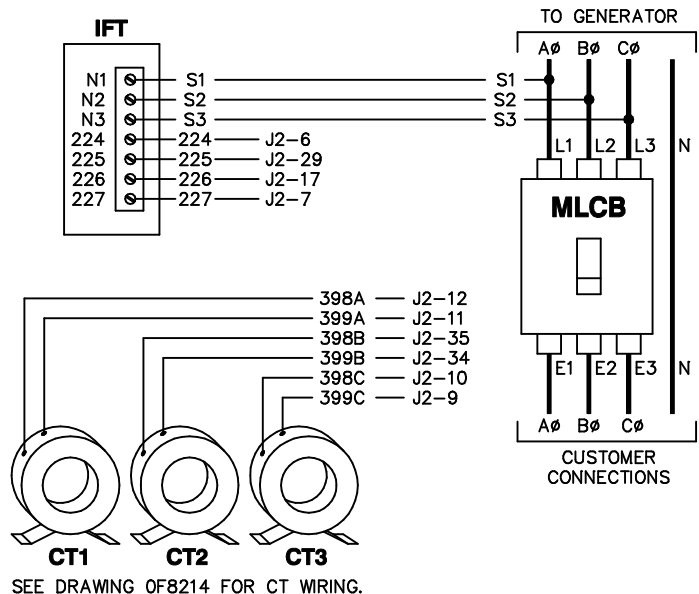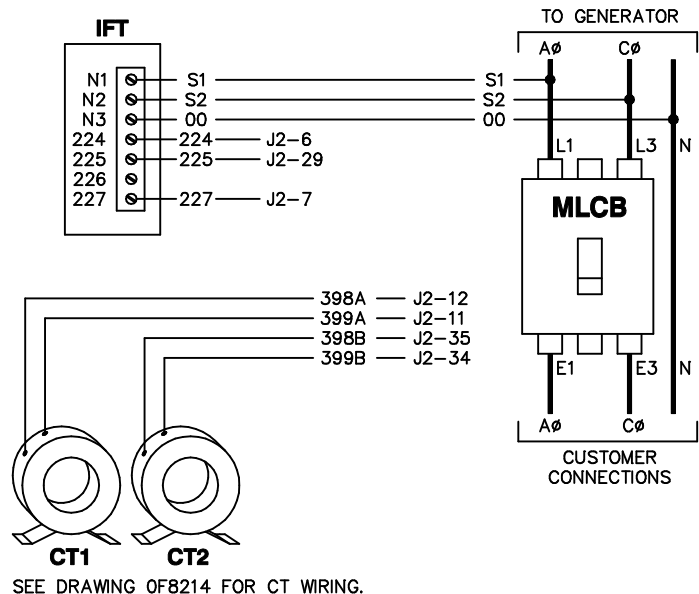

COMPONENTS LOCATED IN CIRCUIT BREAKER STAND

COMPONENTS LOCATED IN EXCITER SHIELD

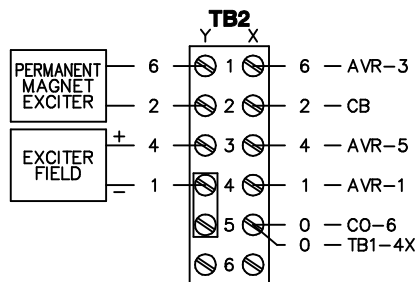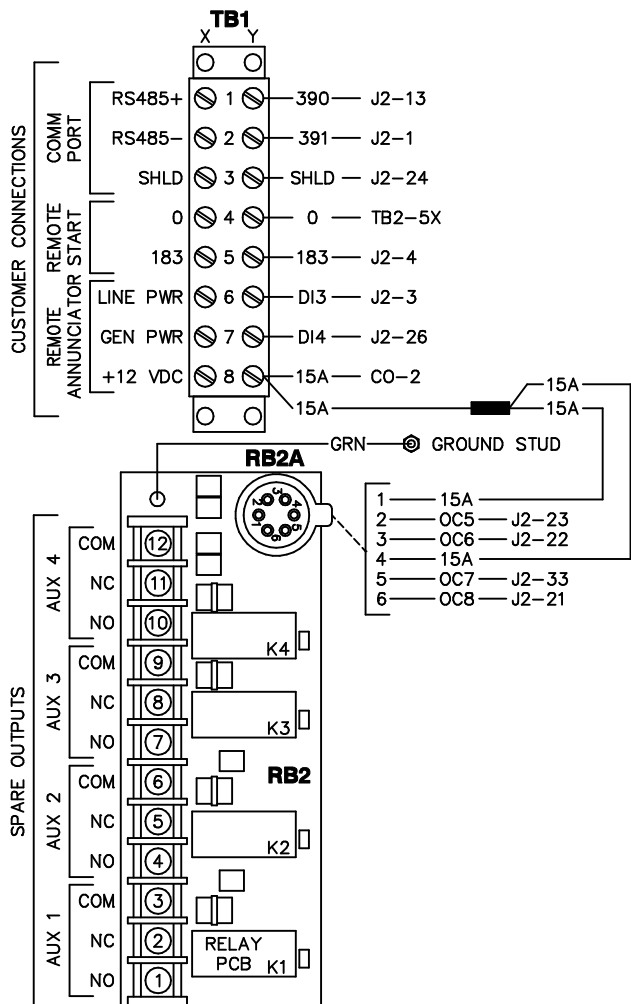

COMPONENTS LOCATED RIGHT SIDE OF ALT. CONN BOX ON THE FRAME RAIL

