


OG1408


NOTES:

- 1) MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1240 (48.8') WIDE X 3230 (127.2') LONG.
- 2) GENERATOR MUST BE LOCATED A MINIMUM DISTANCE OF 5 FEET FROM A WALL OR FENCE. ALLOW A 5 FOOT MINIMUM PERIMETER OF OPEN SPACE AROUND THE ENTIRE GENERATOR.
- 3) CIRCUIT BREAKER INFORMATION:
SEE SPECIFICATION SHEET WITHIN OWNERS MANUAL.
- 4) INSIDE STUB-UP AREA FOR AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION, AUXILARY OUTPUT RELAYS, AND ACCESS TO TRANSFER SWITCH CONTROL WIRES. REMOVE COVER FOR ACCESS.
- 4A) FIELD CUT HOLE IS ONLY REQUIRED FOR MOUNTING OF GENERATOR ON AN EXISTING PAD.
- 5) REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
- 6) REMOVE EITHER LEFT OR RIGHT HAND SIDE PANEL TO ACCESS EXHAUST MUFFLERS AND FAN BELT.
- 7) INSIDE ACCESS TO 120VAC 20A GFCI OUTLET PRE-WIRED TO SUPPLY POWER TO BATTERY CHARGER.
5.4L ONLY: 15A, 240VAC OUTLET FOR ENGINE BLOCK HEATER.
6.8L ONLY: USE 20A GFCI OUTLET FOR ENGINE BLOCK HEATER.

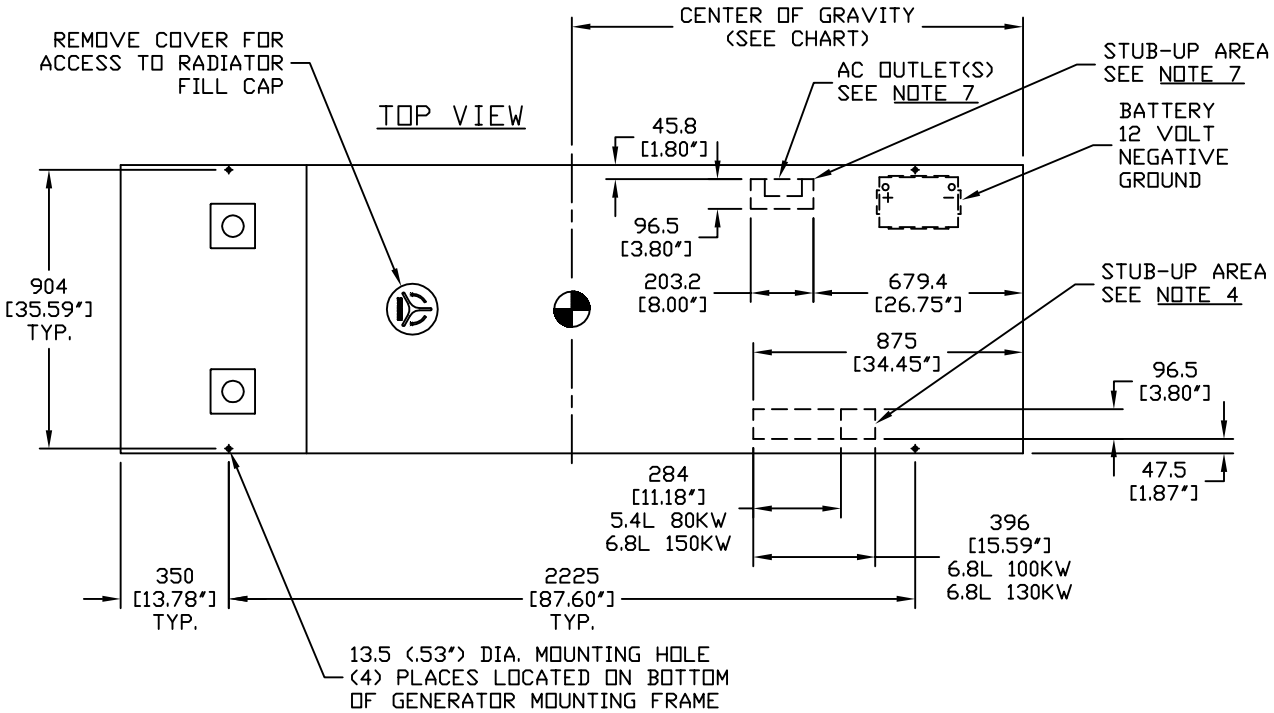

SERVICE ITEM	ACCESS			
	80KW 5.4L	100KW 6.8L	130KW 6.8L	150KW 6.8L
OIL FILL CAP	THRU RIGHT FRONT DOOR			
OIL DIP STICK	THRU LEFT FRONT DOOR			
OIL FILTER	THRU LEFT FRONT DOOR			
OIL DRAIN HOSE	THRU RIGHT FRONT DOOR			
RADIATOR DRAIN HOSE	THRU LEFT FRONT DOOR			
AIR CLEANER ELEMENT	EITHER FRONT DOORS			
SPARK PLUGS	BOTH FRONT DOORS			
MUFFLERS	SEE NOTE 6			
FAN BELT	SEE NOTE 6			
BATTERY	THRU RIGHT REAR DOOR			
AC OUTLET(S)	THRU RIGHT REAR DOOR			
*GEARBOX FILL & DRAIN	THRU RIGHT REAR DOOR			

*NOTE: EXCLUDING 6.8L 150KW UNIT
REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS

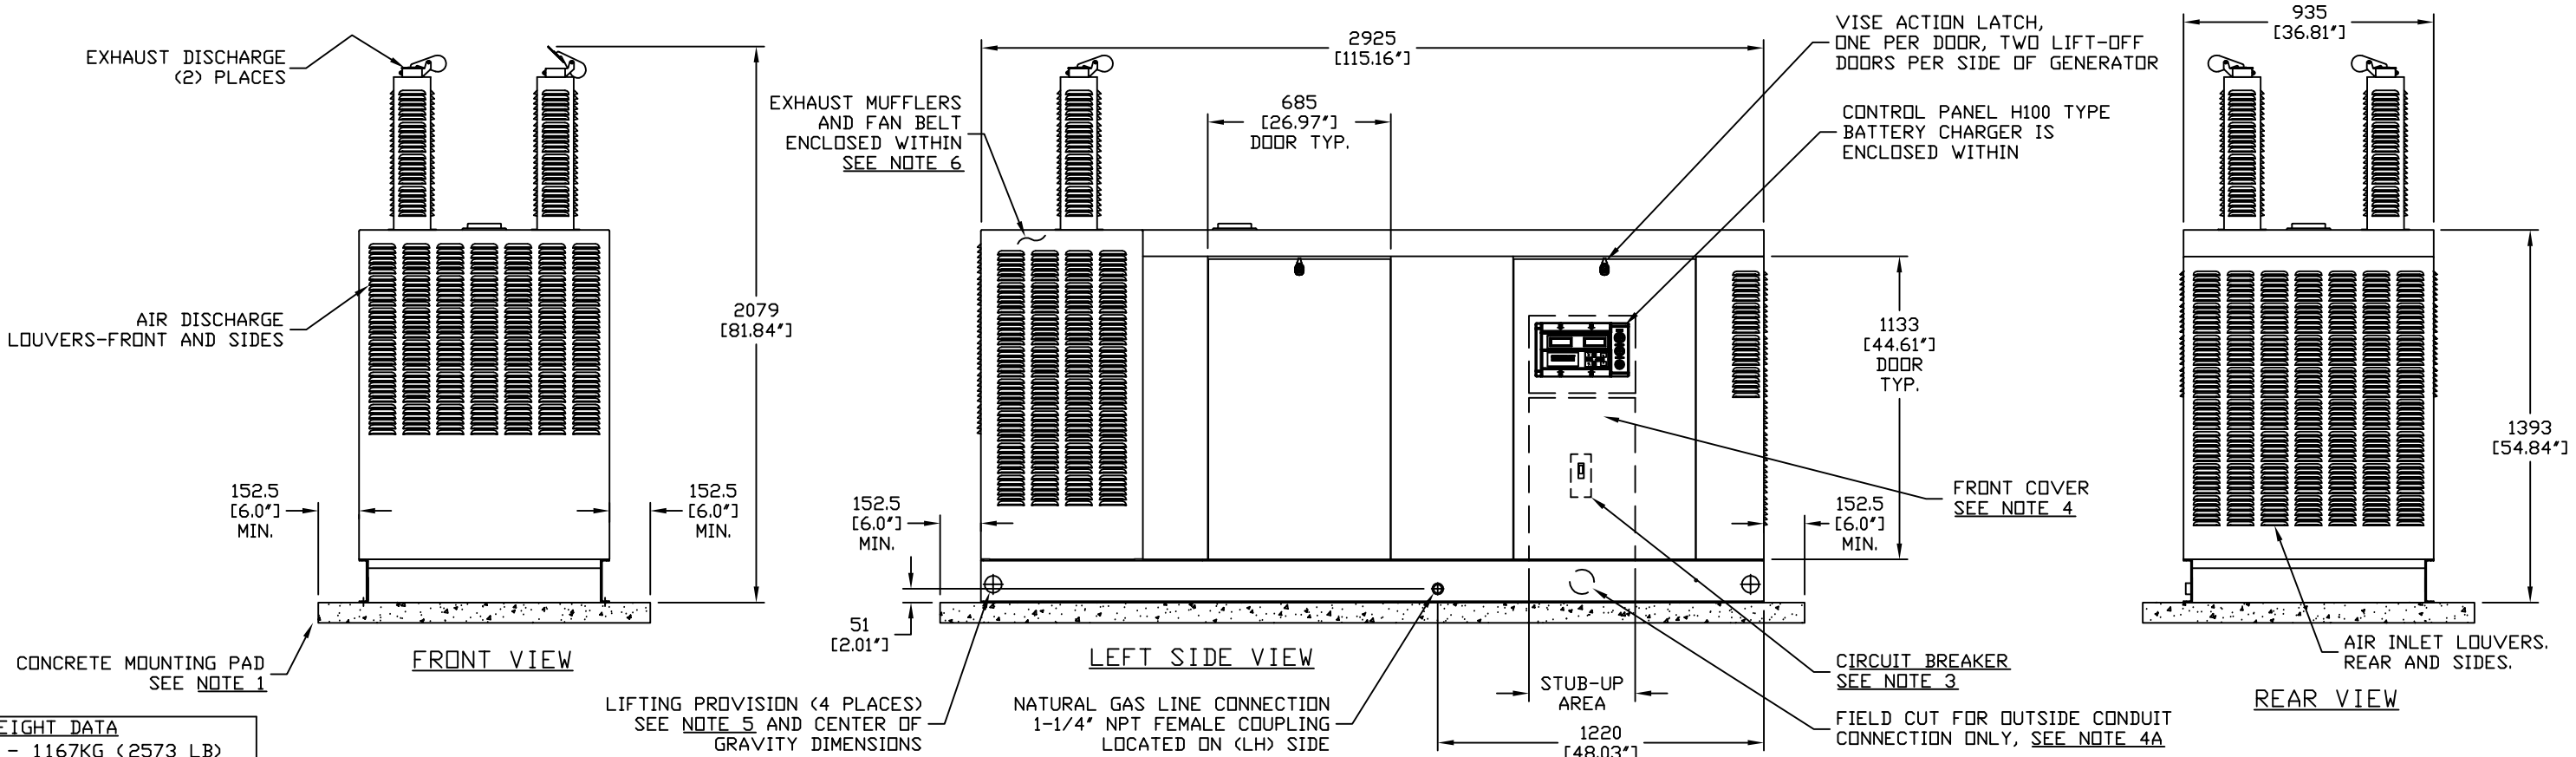

WEIGHT DATA

5.4L 80KW - 1167KG (2573 LB)
6.8L 100KW - 1227KG (2705 LB)
6.8L 130KW - 1303KG (2873 LB)
6.8L 150KW - 1209KG (2666 LB)

WOODEN SHIPPING SKIDS INCREASE
OVERALL WEIGHT 79KG (175 LB)

CENTER OF GRAVITY

1310 (51.6') - 80KW 5.4L
1275 (50.2') - 100KW 6.8L
1230 (48.4') - 130KW 6.8L
1315 (51.8') - 150KW 6.8L

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS.

© GENERAC POWER SYSTEMS 2001

QTA80, QTA100, QTA130 & QTA150

5.4L (80KW) - G3

EPA EXEMPT 6.8L(100, 130 & 150)-G3

ENCLOSURE - C5

ISSUE DATE 5-2-06

GENERAC POWER
SYSTEMS

Waukesha

P.O. BOX 8
WAUKESHA, WIS. 53187

FILE NAME OG1408-B.DWG SIZE B

SCALE 1 = 25 FIRST USE INDUSTRIAL QT SERIES

DWG NO. REV

OG1408

B

INSTALLATION DRAWING