


GROUP G


OPTION 1 - SINGLE PHASE, H-100 CONTROL PANEL

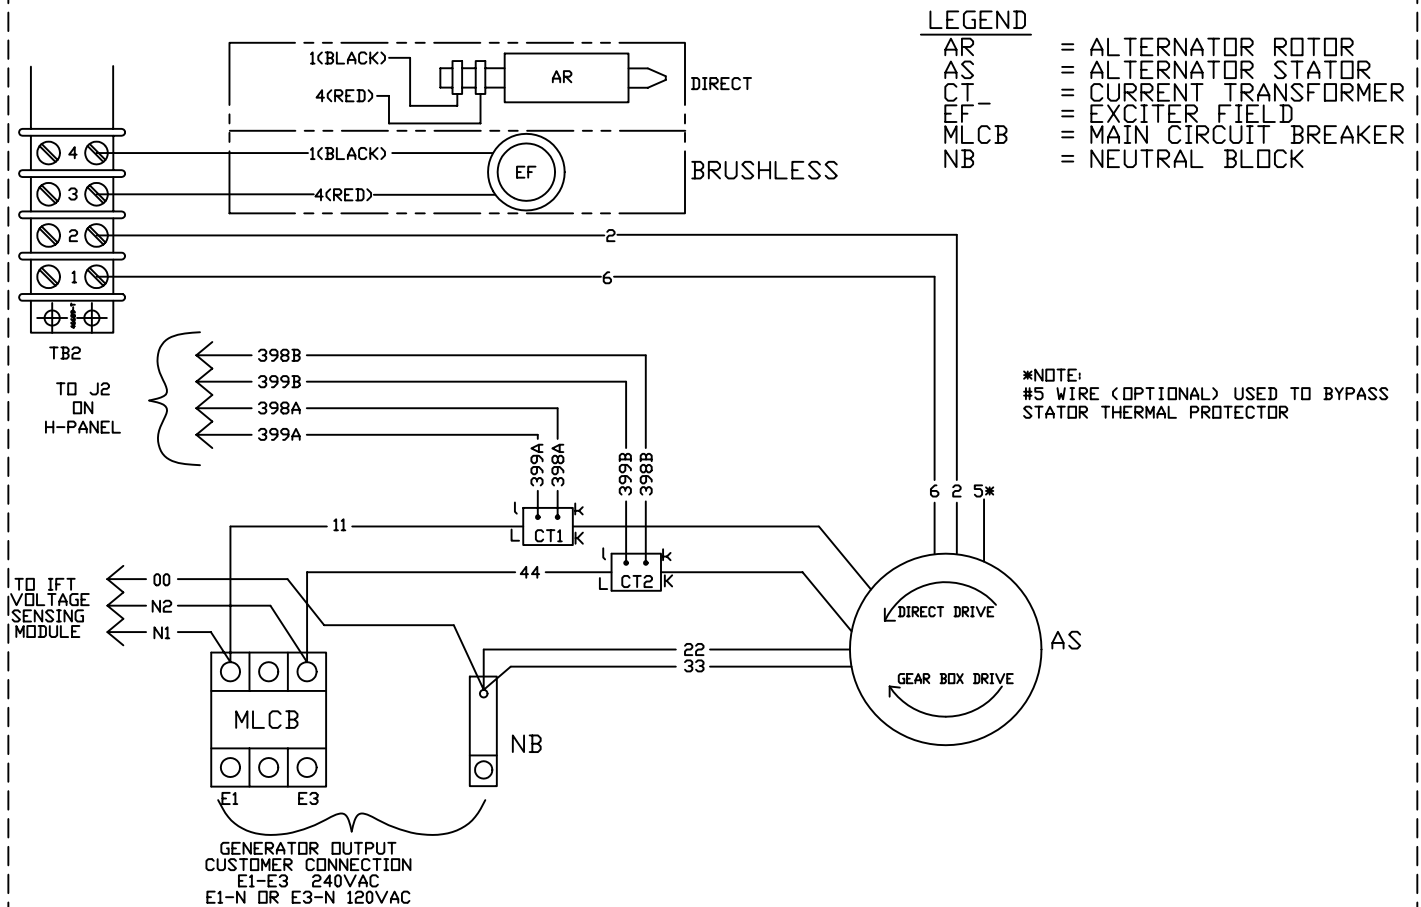

PAGE 1 OF 4

LEGEND

AR = ALTERNATOR ROTOR
AS = ALTERNATOR STATOR
CT = CURRENT TRANSFORMER
EF = EXCITER FIELD
MLCB = MAIN CIRCUIT BREAKER
NCB = NEUTRAL BLOCK

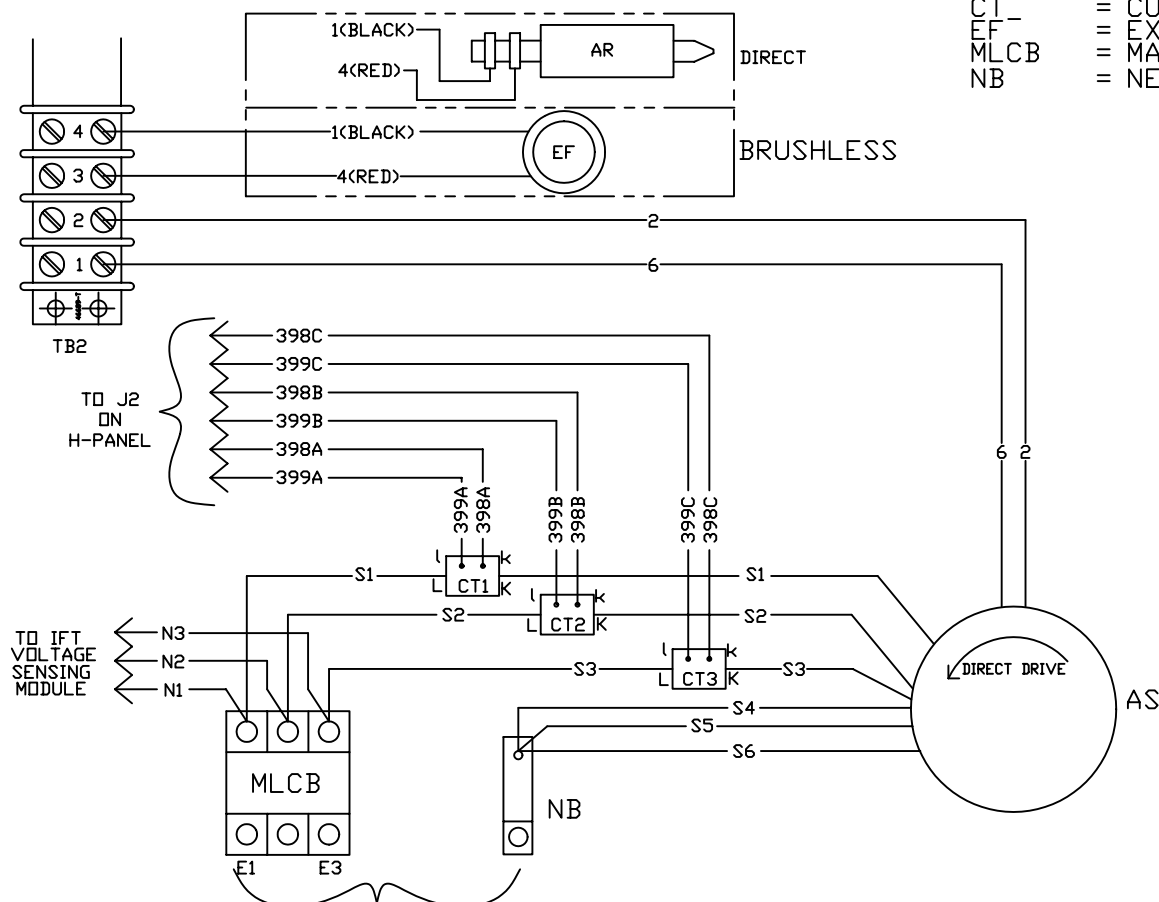

GENERATOR OUTPUT CUSTOMER CONNECTION

E1 TO E2
 E2 TO E3 } *208 OR 480VAC
 E1 TO E3


E1, E2, OR E3 TO NB = * 120 OR 277VAC

*NOTE: THE 8th DIGIT OF THE MODEL NUMBER SPECIFIES OUTPUT VOLTAGE

'G' = 120/208VAC

'K' = 277/480VAC


OPTION 3 - THREE PHASE, H-100 CONTROL PANEL GEAR BOX (REVERSE ROTATION)

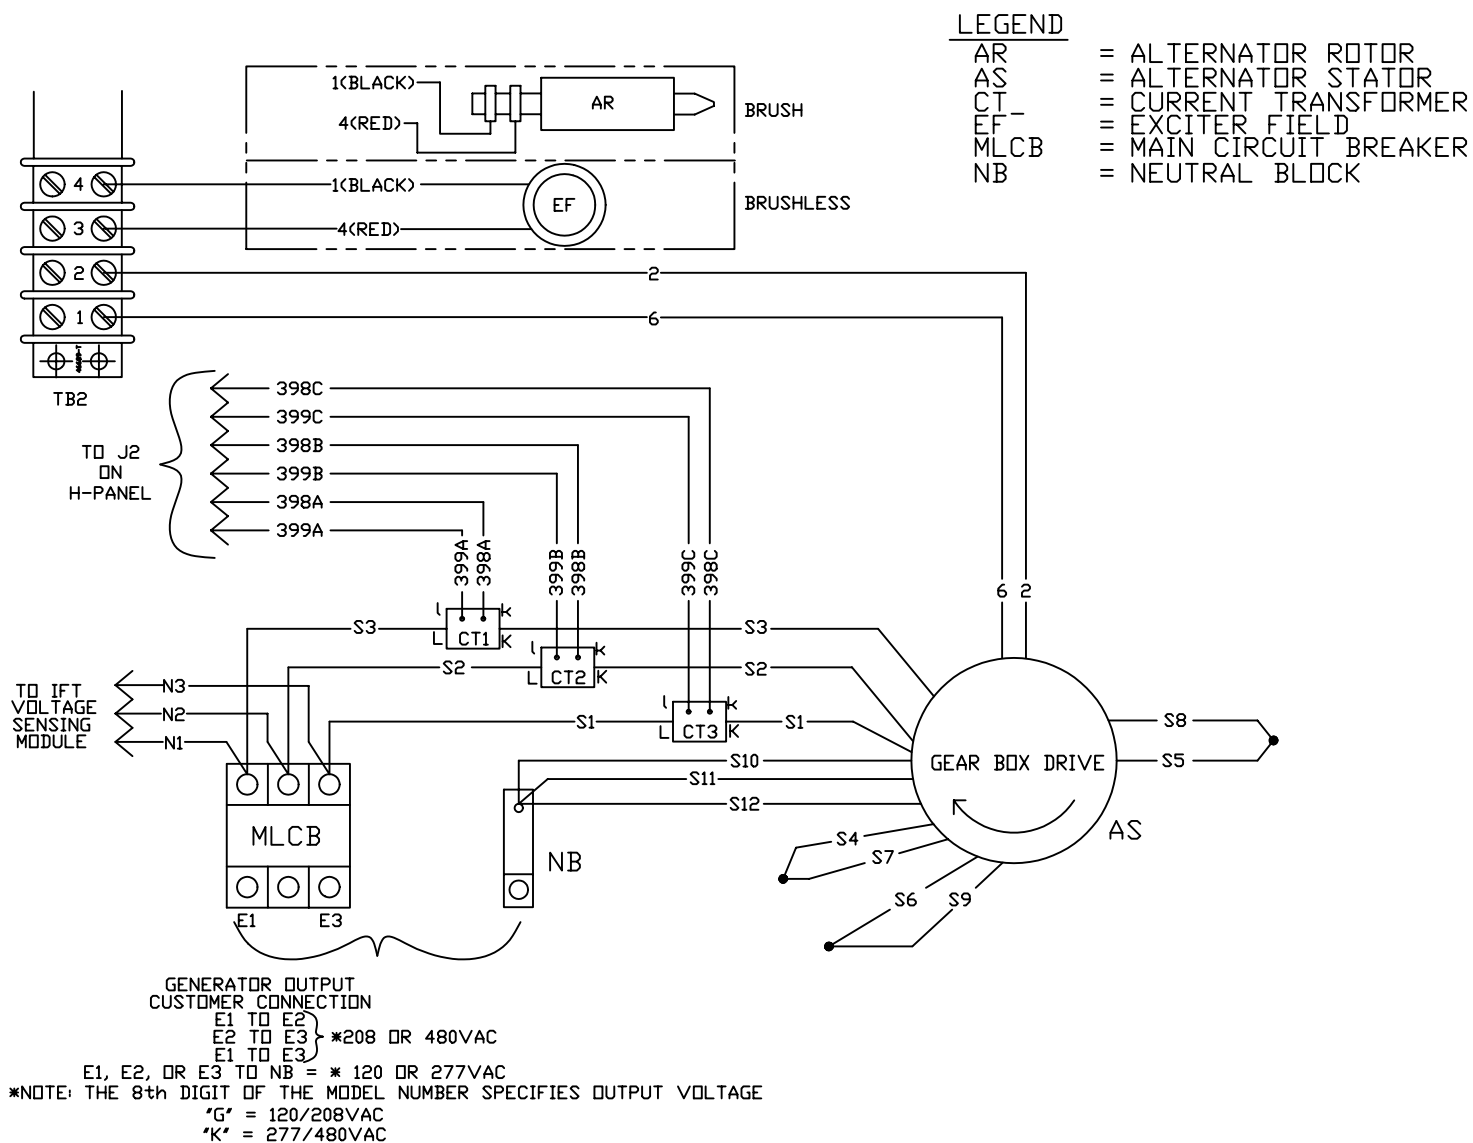

OPTION 4 - THREE PHASE DELTA, H-100 CONTROL PANEL DIRECT DRIVE, 7 LEAD

LEGEND

AR	= ALTERNATOR ROTOR
AS	= ALTERNATOR STATOR
CT	= CURRENT TRANSFORMER
EF	= EXCITER FIELD
MLCB	= MAIN CIRCUIT BREAKER
NB	= NEUTRAL BLOCK

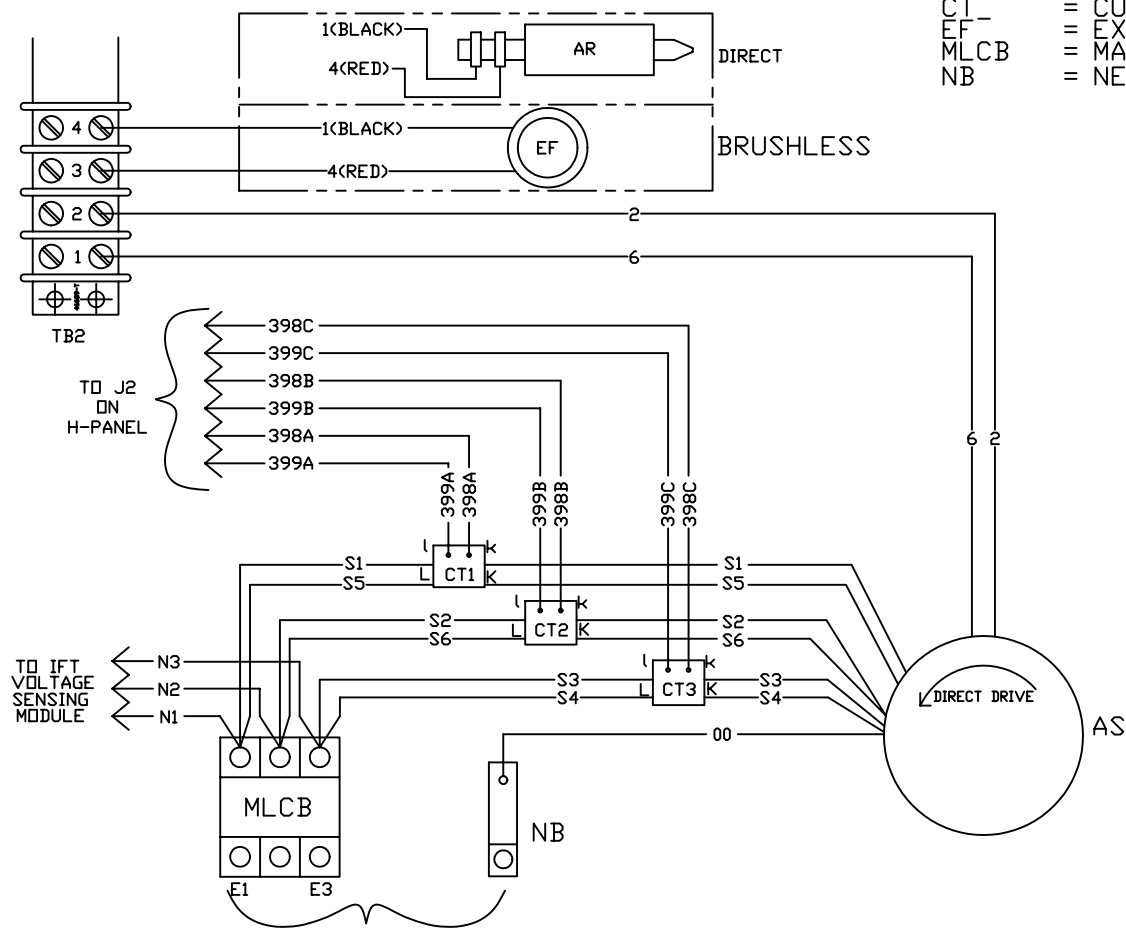

GENERATOR OUTPUT
CUSTOMER CONNECTION
E1 TO E2 } 240VAC
E2 TO E3 }
E1 TO E3 }

E1-N OR E3-N = 120VAC

*NOTE: THE 8th DIGIT OF THE MODEL NUMBER SPECIFIES OUTPUT VOLTAGE
J = 120/240VAC