

NOTES:

1. MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1092 (43") WIDE X 1887 (74.3") LONG. REFERENCE INSTALLATION GUIDE SUPPLIED WITH UNIT FOR CONCRETE PAD GUIDELINES.
2. ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE, AND LOCAL CODES.
3. CONTROL PANEL / CIRCUIT BREAKER INFORMATION:

- SEE SPECIFICATION SHEET OR OWNERS MANUAL


- ACCESSIBLE THROUGH CUSTOMER ACCESS ASSEMBLY DOOR ON REAR OF GENERATOR.
4. REMOVE THE REAR TANK AND REAR ENCLOSURE COVER PANEL TO ACCESS THE STUB-UP AREAS AS FOLLOWS:

- HIGH VOLTAGE CONNECTION INCLUDING AC LOAD LEAD CONDUIT CONNECTION NEUTRAL CONNECTION, BATTERY CHARGER 120 VOLT AC (0.5 AMP MAX) CONNECTION.


- LOW VOLTAGE CONNECTION INCLUDING TRANSFER SWITCH CONTROL WIRES AND ACCESSORY RELAY CONNECTION (QTY 4)
5. CENTER OF GRAVITY AND WEIGHT MAY CHANGE DUE TO UNIT OPTIONS.
6. BOTTOM OF GENERATOR SET MUST BE ENCLOSED TO PREVENT PEST INTRUSION AND RECIRCULATION OF DISCHARGE AIR AND/OR IMPROPER COOLING AIR FLOW.
7. EXHAUST SYSTEM MAXIMUM BACK PRESSURE: 24 INCHES H2O.
8. REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
9. MOUNTING BOLTS OR STUDS TO MOUNTING SURFACE SHALL BE 5/8-11 GRADE 5 (USE STANDARD SAE TORQUE SPECS)

SERVICE ITEM	2.3L	WEIGHT DATA WITH EMPTY BASETANK (SEE NOTE 5)	
OIL FILL CAP	RIGHT SIDE	GENERATOR AS SHOWN (STEEL ENCL)	581 [1281]
OIL DIP STICK	RIGHT SIDE	WITH WODDEN SHIPPING SKID	621 [1369]
OIL FILTER	RIGHT SIDE	WEIGHT: KG [LBS] DIMENSIONS: MM [INCH]	
OIL DRAIN HOSE	RIGHT SIDE		
RADIATOR DRAIN HOSE	LEFT SIDE		
AIR CLEANER ELEMENT	EITHER SIDE		
MUFFLER	FRONT		
FAN BELT	EITHER SIDE		
BATTERY	LEFT SIDE		


REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS.

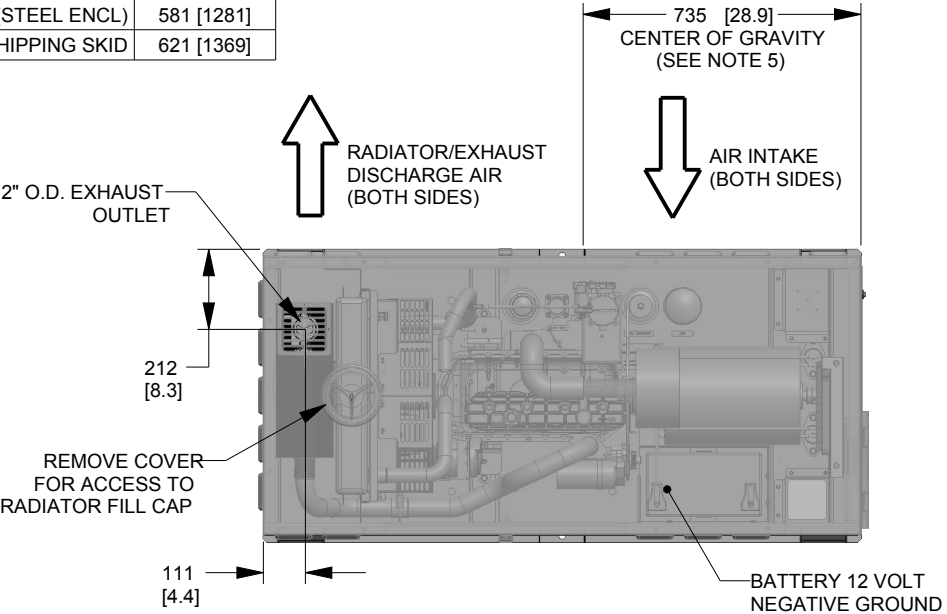

TOP VIEW

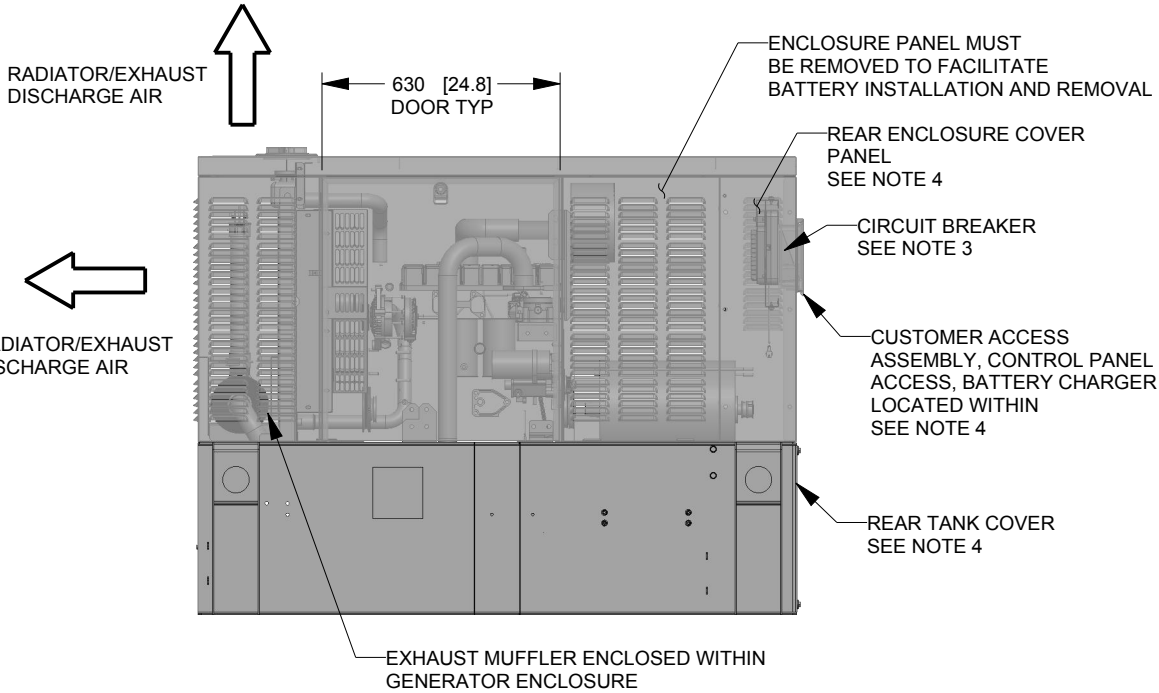

LEFT SIDE VIEW

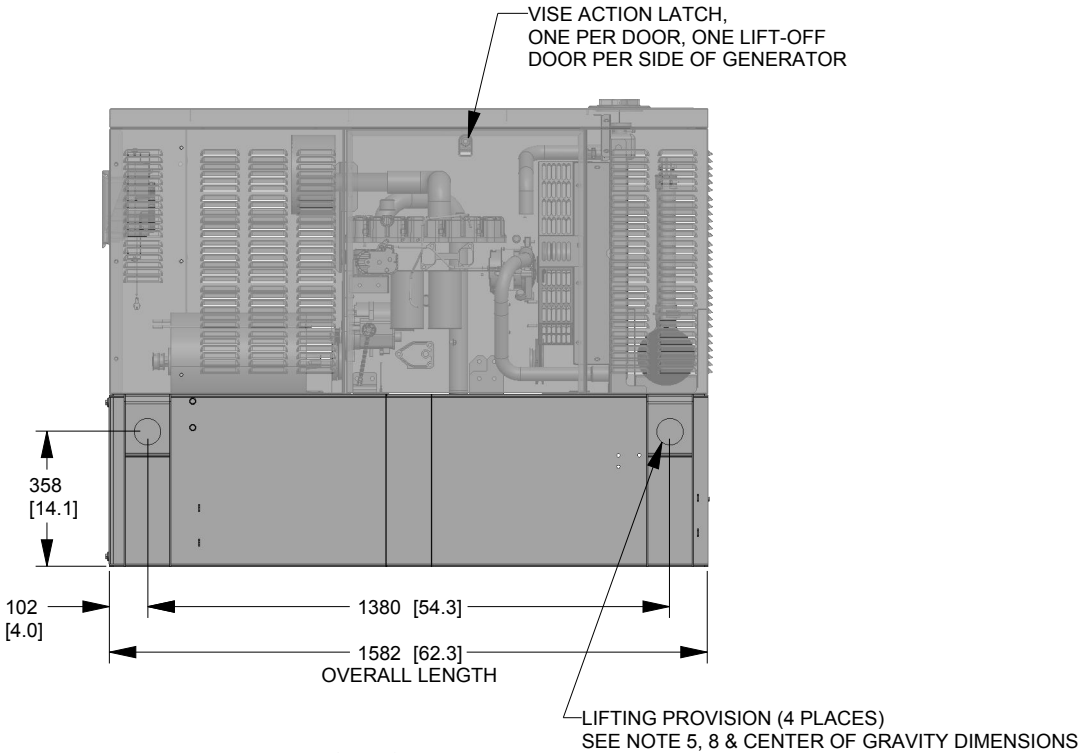

FRONT VIEW

RIGHT SIDE VIEW

DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. ©GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED
INSIDE WINDCHILL



TITLE

INSTALL PROTECTOR D2.3L G16 SW

ISSUE DATE: 1/2014

SIZE
B

CAGE NO
N/A

DWG NO

0K4894A

REV

SCALE

0.050

WT-KG


SEE ABOVE

SHEET

1 of 2

B

B


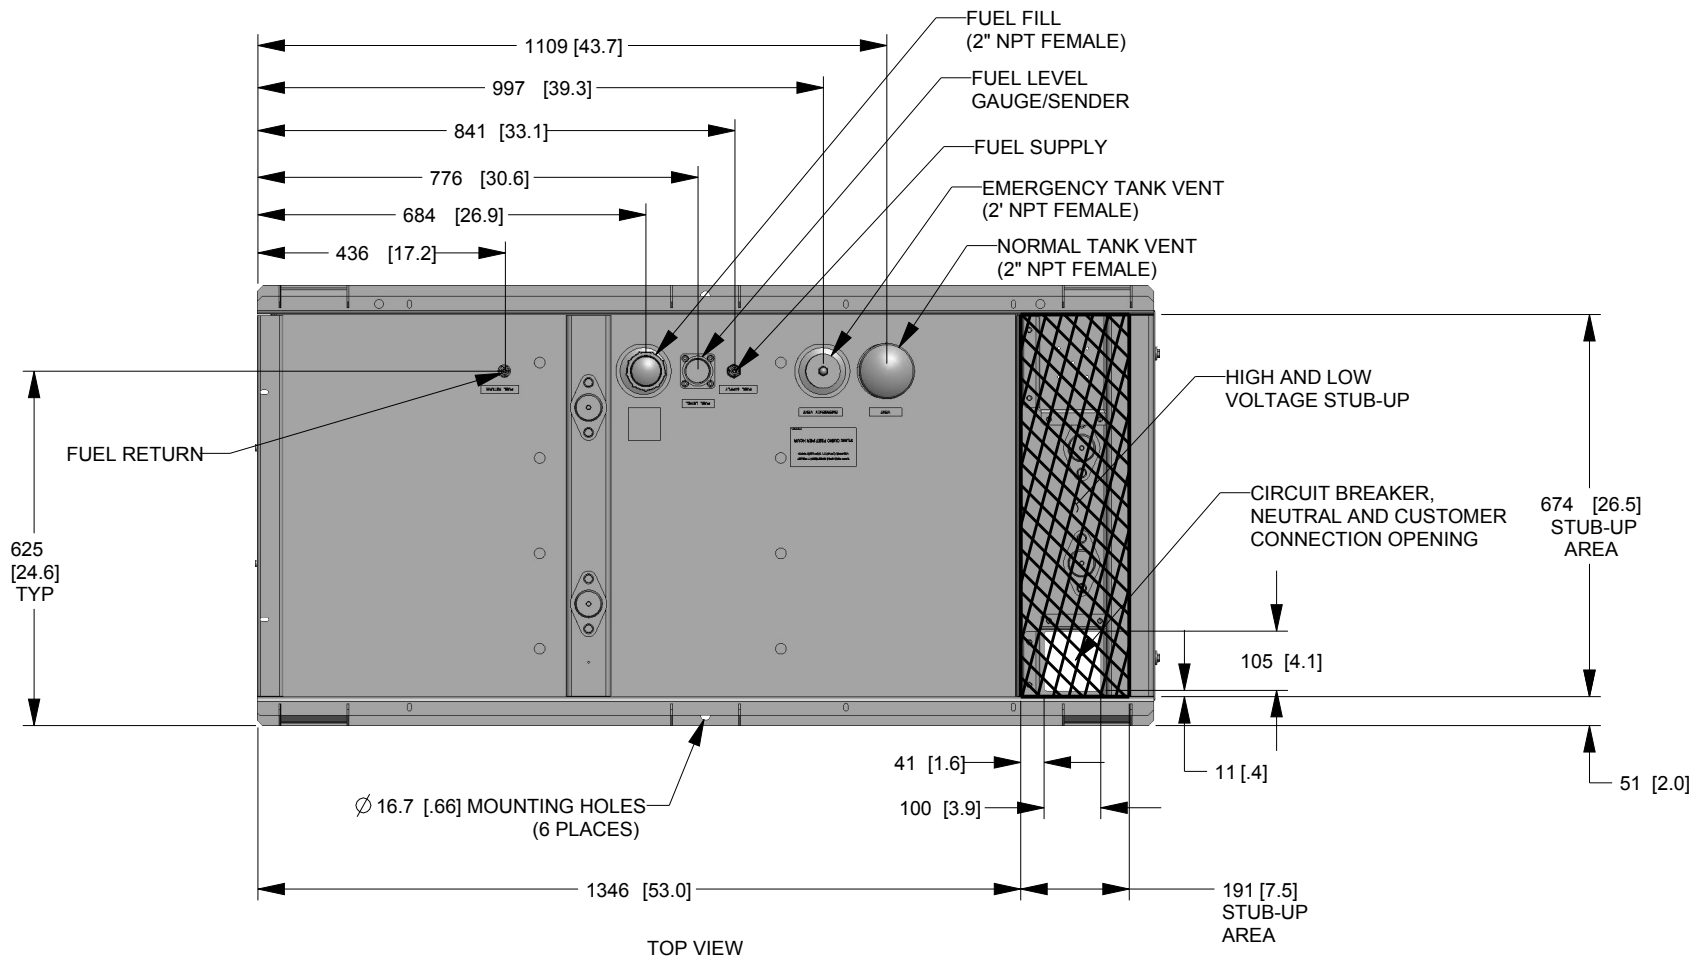


FUEL TANK	
TOTAL CAPACITY	169 [44]
USABLE CAPACITY	151 [40]

CAPACITY: LITER [GALLONS]
DIMENSIONS: MM [INCH]

A

A

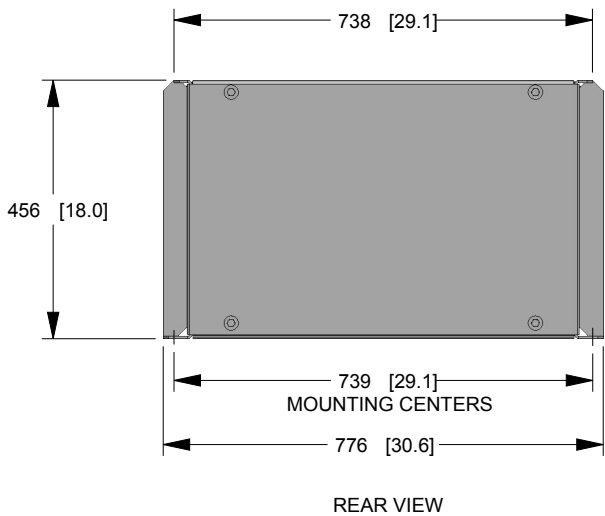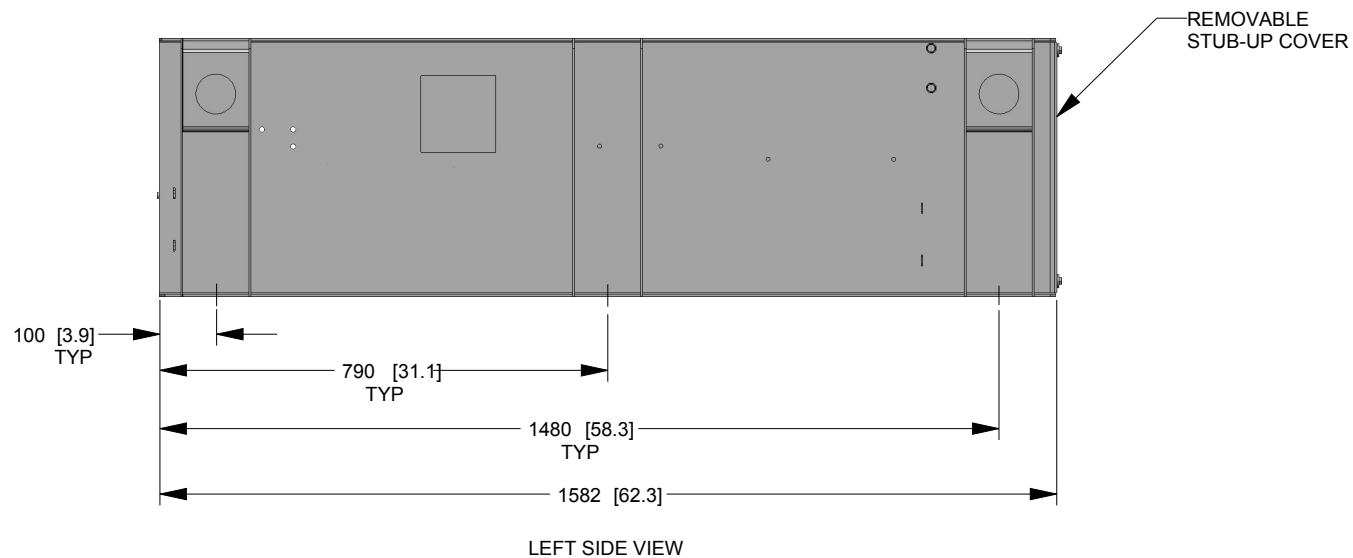

DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. ©GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED
INSIDE WINDCHILL



TITLE
INSTALL STUB-UP VIEW PROTECTOR D2.3L
SINGLE WALL TANK

ISSUE DATE:		1/2014	
SIZE B	CAGE NO	DWG NO OK4894A	REV
SCALE	0.075	WT-KG	SEE SHEET 1
SHEET		2 of 2	