


0K2438

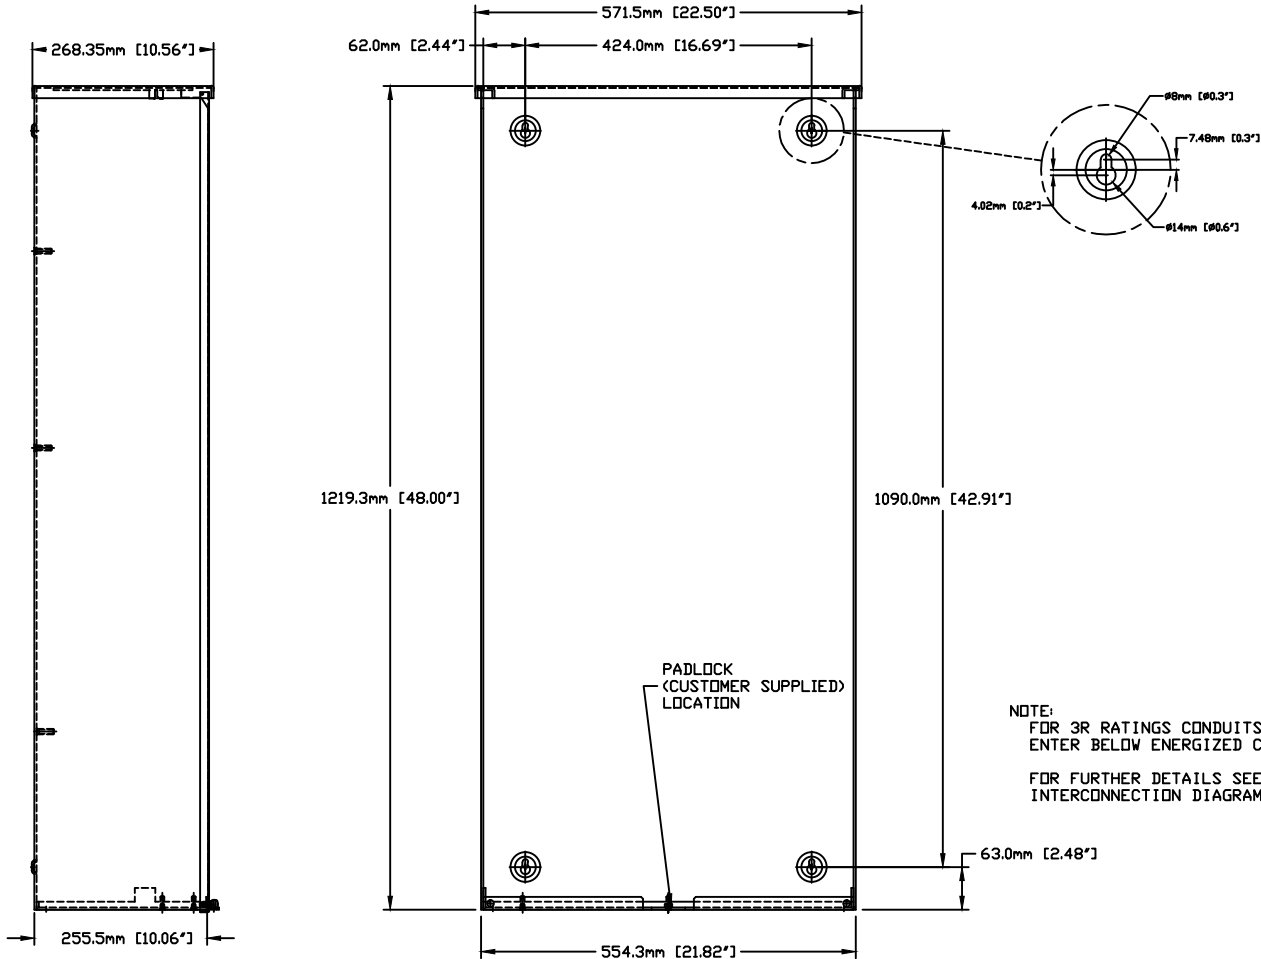

NOTE:  
FOR 3R RATINGS CONDUITS MUST  
ENTER BELOW ENERGIZED COMPONENTS  
FOR FURTHER DETAILS SEE  
INTERCONNECTION DIAGRAM IN THIS MANUAL.

-A-	RELEASED FOR PRODUCTION

GENRAC POWER SYSTEMS  
11430N-1984

EST. VT.

FINAL VT.

DO NOT SCALE

ALL DIMENSIONS AND  
TOLERANCES PER  
ASME Y14.5M-1994

UNLESS OTHERWISE  
SPECIFIED

ALL DIMENSIONS ARE IN MM

ALL DIMENSIONS ARE IN INCHES

ALL DIMENSIONS ARE IN MILLIMETERS

DRAWING TITLE  
INSTALLATION DRAWING  
400A SERVICE ENTRANCE

GENRAC POWER  
SYSTEMS  
Waukesha

P.O. BOX #  
WAUKESHA, WIS. 53187

MATERIAL  
N/A

DATE 3/6/13

DATE 3/10/13

DATE 3/12/13

DATE 3/10/13

FILE NAME  
0K2438.DWG

SCALE  
1 = 5

DATE  
2013 RTSY

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

DATE  
3/10/13

THIS PAGE IS LEFT INTENTIONALLY BLANK

