


GROUP G

NOTE: INSTALLATION MUST MEET ALL NATIONAL, STATE AND LOCAL ELECTRICAL CODES.

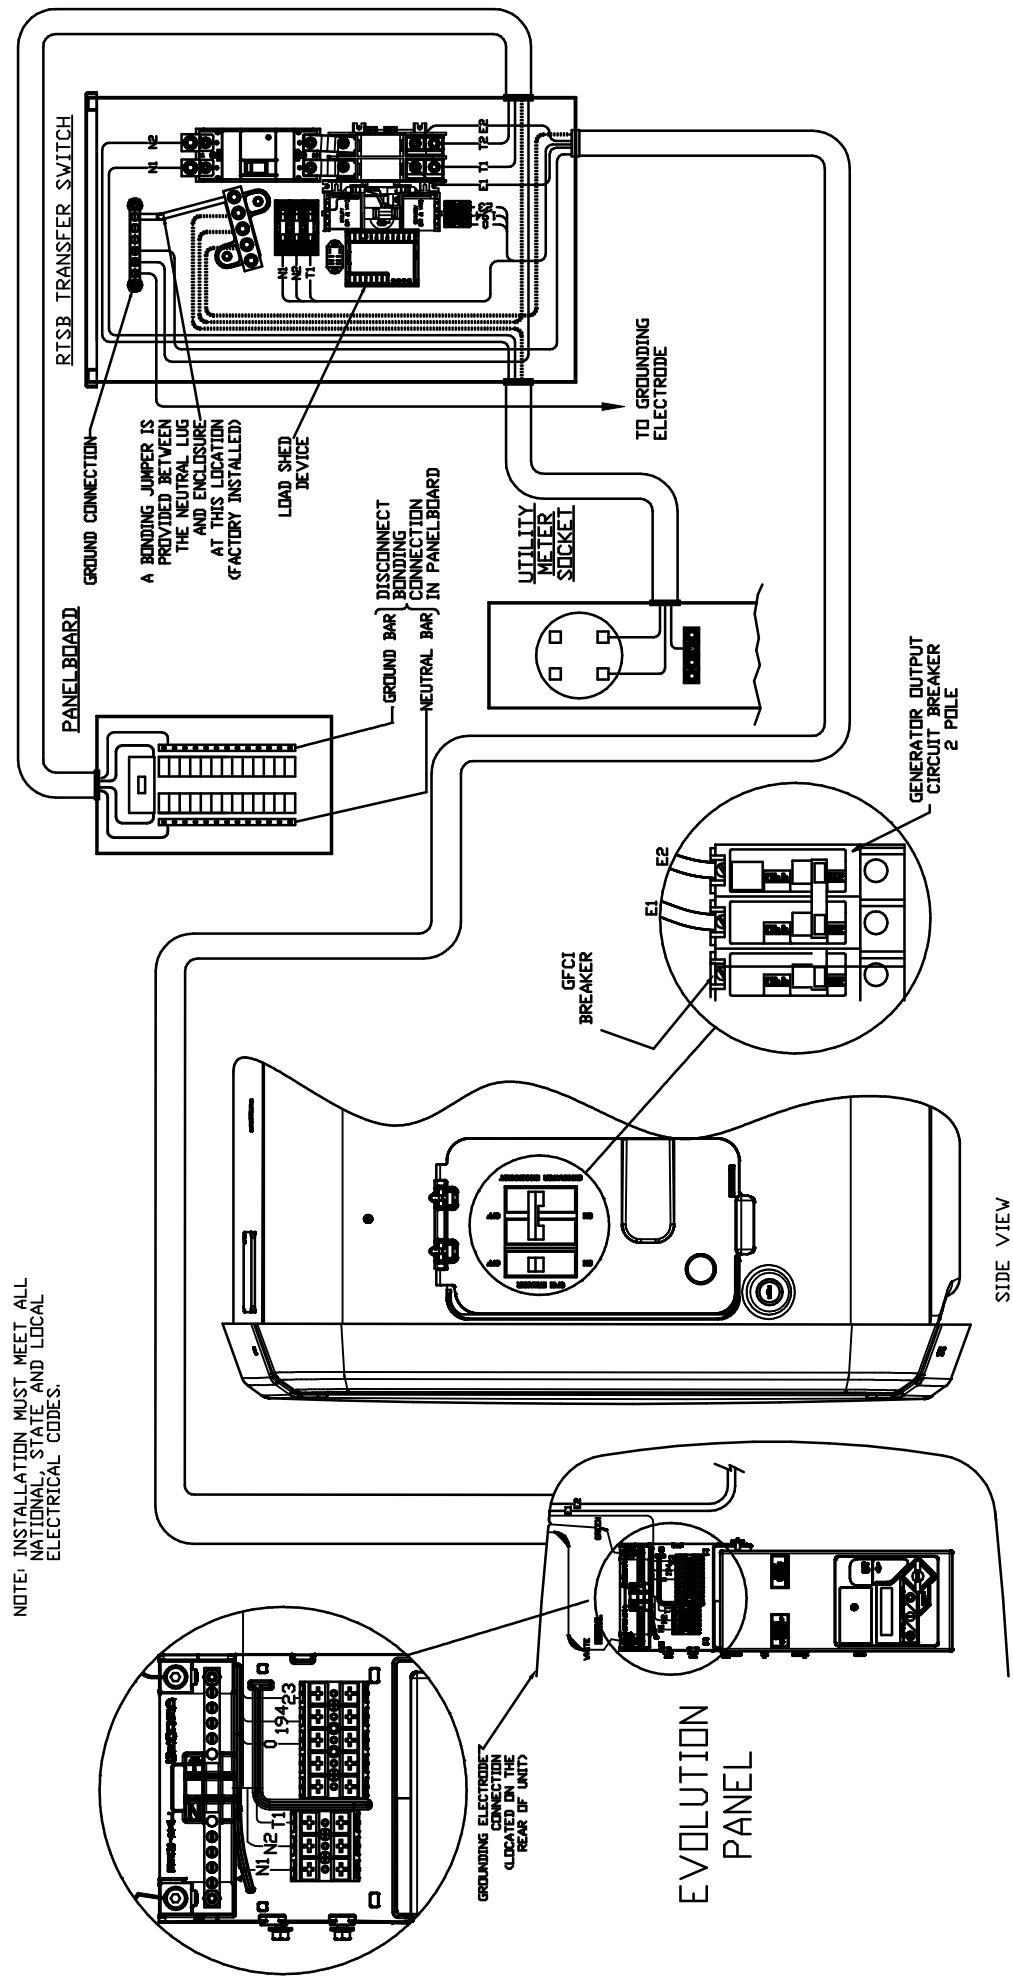

EXPLODED VIEW:
INTERCONN.200A SE XFER SWITCH
DRAWING #0K7643

REVISION:-A-
DATE: 02/17/14

THIS PAGE IS LEFT INTENTIONALLY BLANK