

NOTES:

1. MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1194 (47") WIDE X 2261 (89") LONG. REFERENCE INSTALLATION GUIDE SUPPLIED WITH UNIT FOR CONCRETE PAD GUIDELINES
2. ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE AND LOCAL CODES.
3. CONTROL PANEL / CIRCUIT BREAKER INFORMATION:

- SEE SPECIFICATION SHEET OR OWNERS MANUEL


- ACCESSIBLE THROUGH CUSTOMER ACCESS ASSEMBLY DOOR ON REAR OF GENERATOR
4. REMOVE THE REAR TANK AND REAR ENCLOSURE COVER PANEL TO ACCESS THE STUB-UP AREAS AS FOLLOWS:

-HIGH VOLTAGE CONNECTION INCLUDING AC LOAD LEAD CONDUIT CONNECTION NEUTRAL CONNECTION, BATTERY CHARGER 120 VOLT AC (0.5 AMP MAX) CONNECTION.





-LOW VOLTAGE CONNECTIONS INCLUDE TRANSFER SWITCH CONTROL WIRES AND ACCESSORY RELAY CONNECTION (QTY 4)
5. CENTER OF GRAVITY AND WEIGHT MAY CHANGE DUE TO UNIT OPTIONS.
6. ENGINE SERVICE CONNECTIONS

OIL DRAIN: 3/8" NPT

EXHAUST OUTLET: 2" O.D.
7. BOTTOM OF GENERATOR SET MUST BE ENCLOSED TO PREVENT PEST INTRUSION AND RECIRCULATION OF DISCHARGE AIR AND/OR IMPROPER COOLING AIR FLOW.
8. EXHAUST SYSTEM MAXIMUM BACK PRESSURE: 35 INCHES H2O.
9. REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
10. MOUNTING BOLTS OR STUDS TO CONCRETE PAD SHALL BE 5/8-11 GRADE 5

SERVICE ITEM	3.4L	WEIGHT DATA WITH EMPTY BASETANK (SEE NOTE 6)	
OIL FILL CAP	RIGHT SIDE	GENERATOR AS SHOWN (STEEL ENCL)	873 [1925]
OIL DIP STICK	RIGHT SIDE		
OIL FILTER	RIGHT SIDE	WITH WOODEN SHIPPING SKID	909 [2005]
OIL DRAIN HOSE	LEFT SIDE	<div>RADIATOR/EXHAUST DISCHARGE AIR</div> <div></div>	
RADIATOR DRAIN HOSE	LEFT SIDE		
AIR CLEANER ELEMENT	RIGHT SIDE		
MUFFLER	FRONT		
FAN BELT	EITHER SIDE		
BATTERY	LEFT SIDE		

REFERENCE OWNERS MANUAL FOR PERIODIC REPLACEMENT PART LISTINGS.

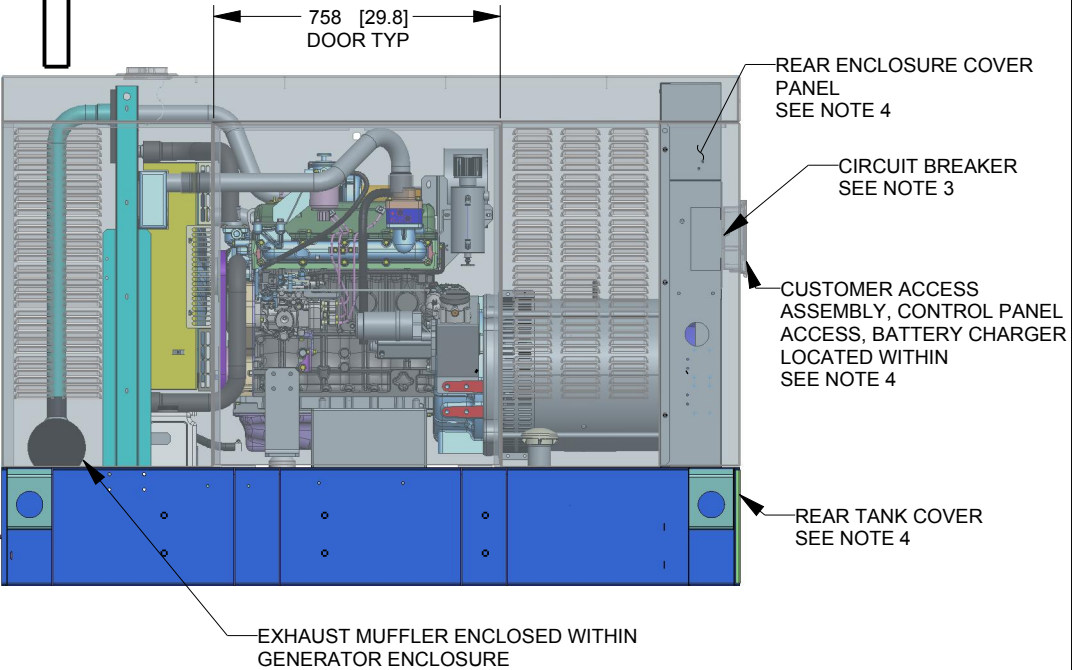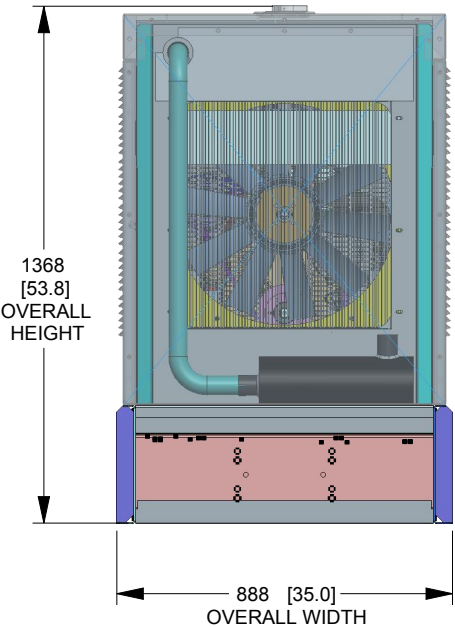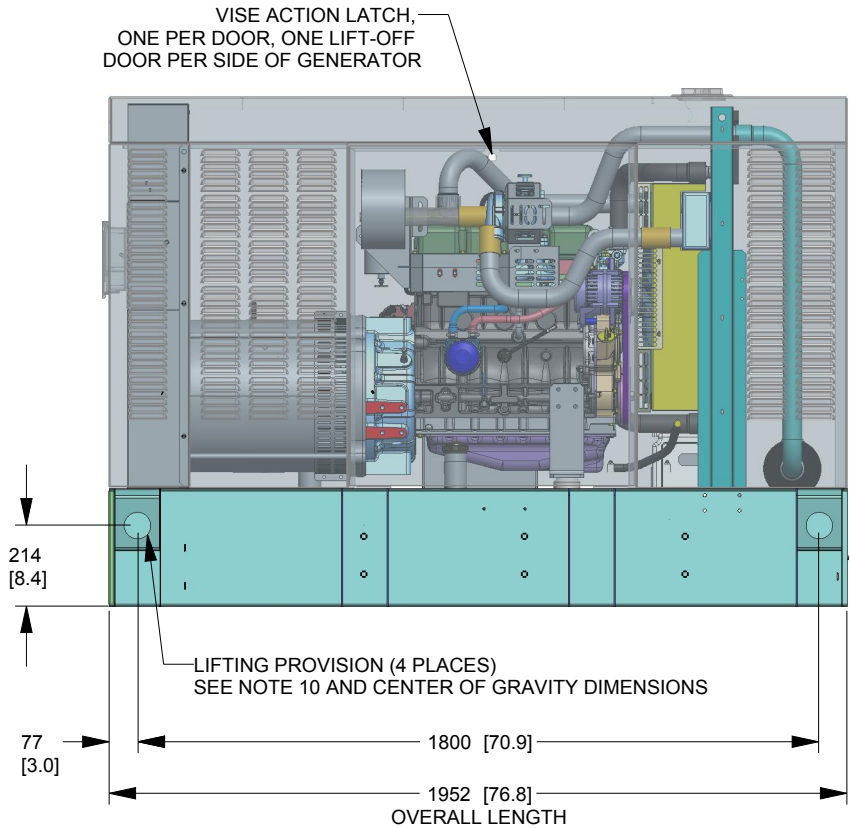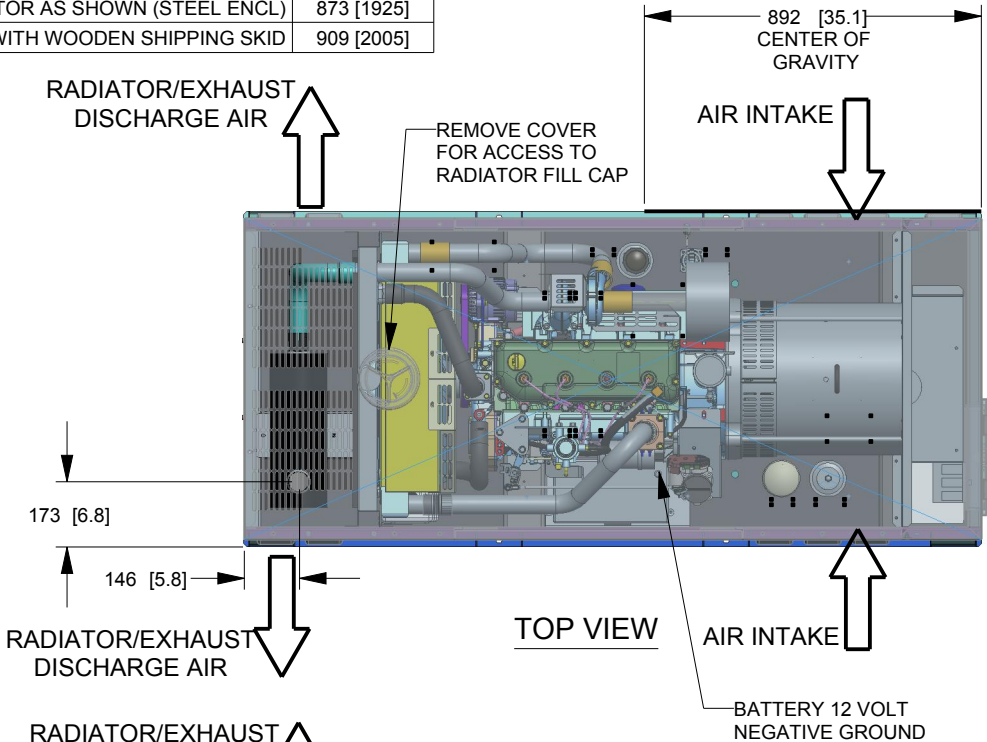

DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

RIGHT SIDE VIEW

FRONT VIEW

LEFT SIDE VIEW

INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. ©GENERAC POWER SYSTEMS 2013


ELECTRONICALLY APPROVED  
INSIDE WINDCHILL



TITLE				
INSTALL CPL PROT D3.4L SW				
ISSUE DATE:				
SIZE B	CAGE NO	DWG NO 0K3529A	REV A	
SCALE	0.050	WT-KG	SHEET	1 of 2

B

B

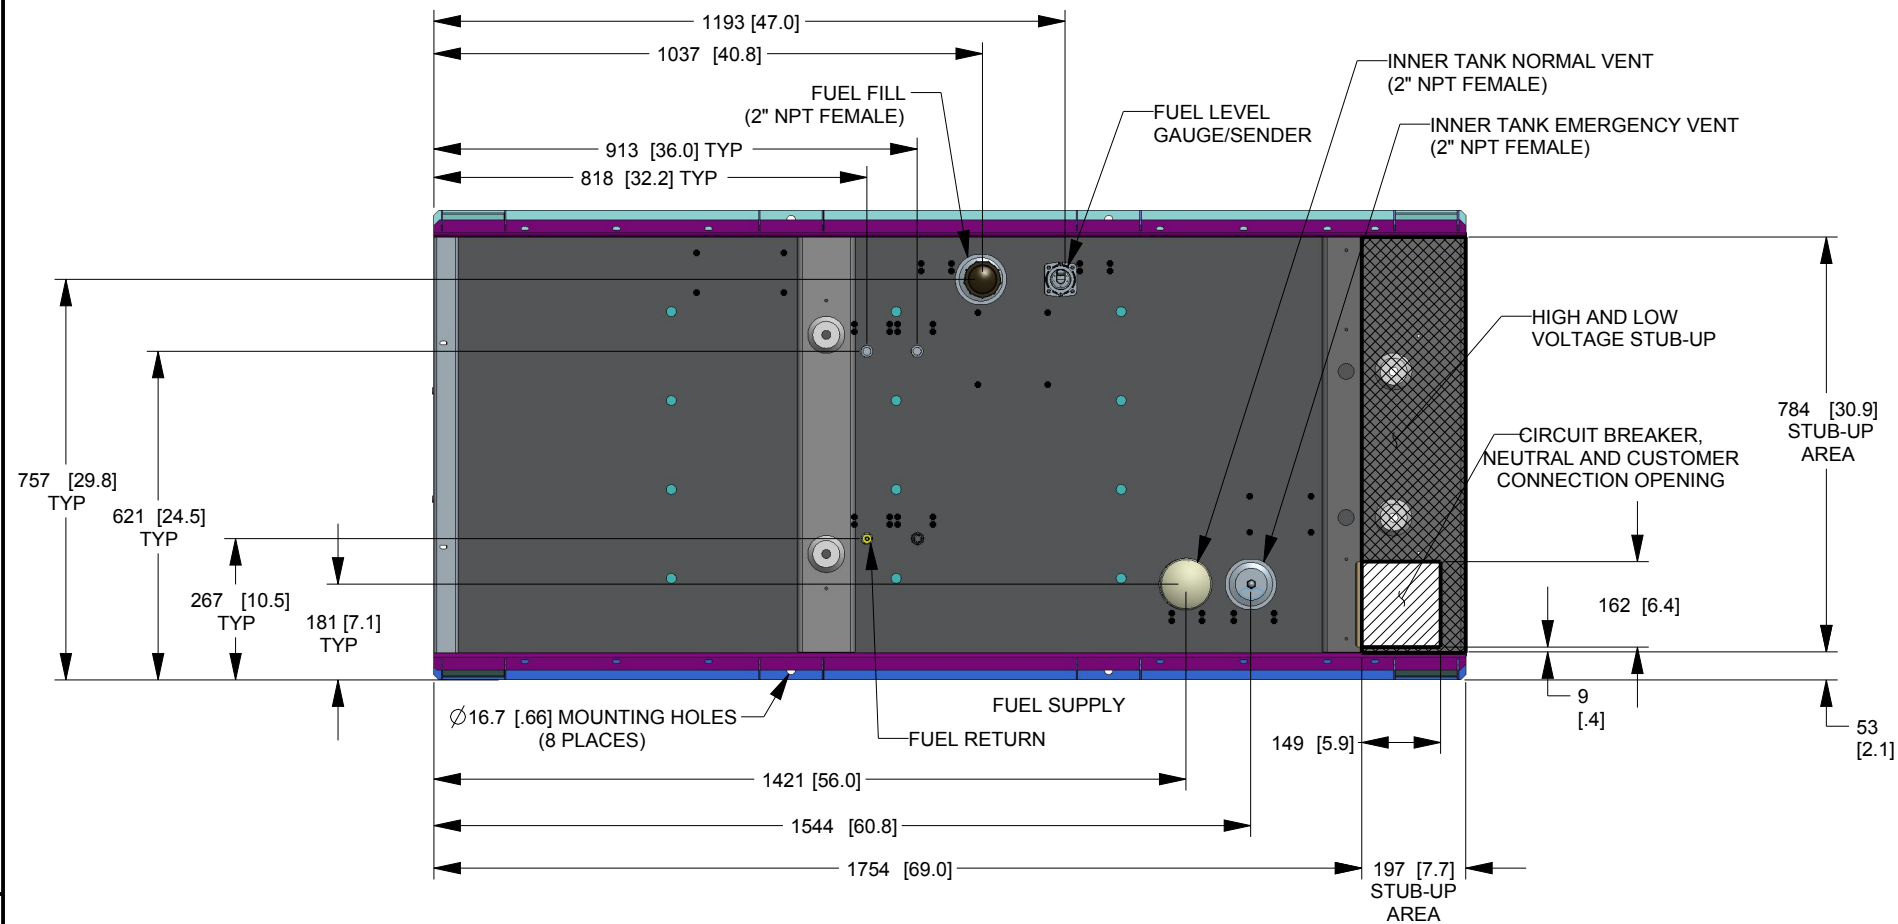



TANK P/N	0K39150ST03
TOTAL CAPACITY	
USABLE CAPACITY	227 [60]

CAPACITY: LITER [GALLONS]  
DIMENSIONS: MM [INCH]

UL 142 LISTED

A

A

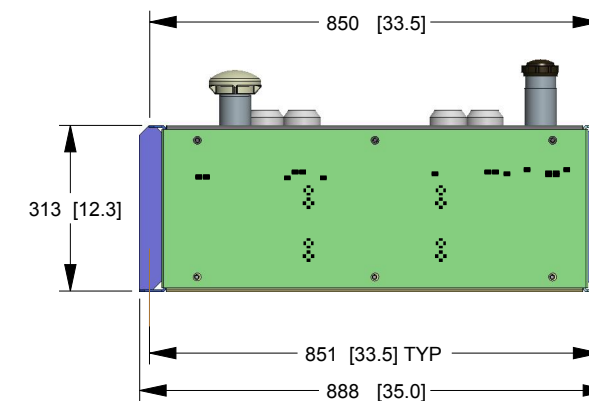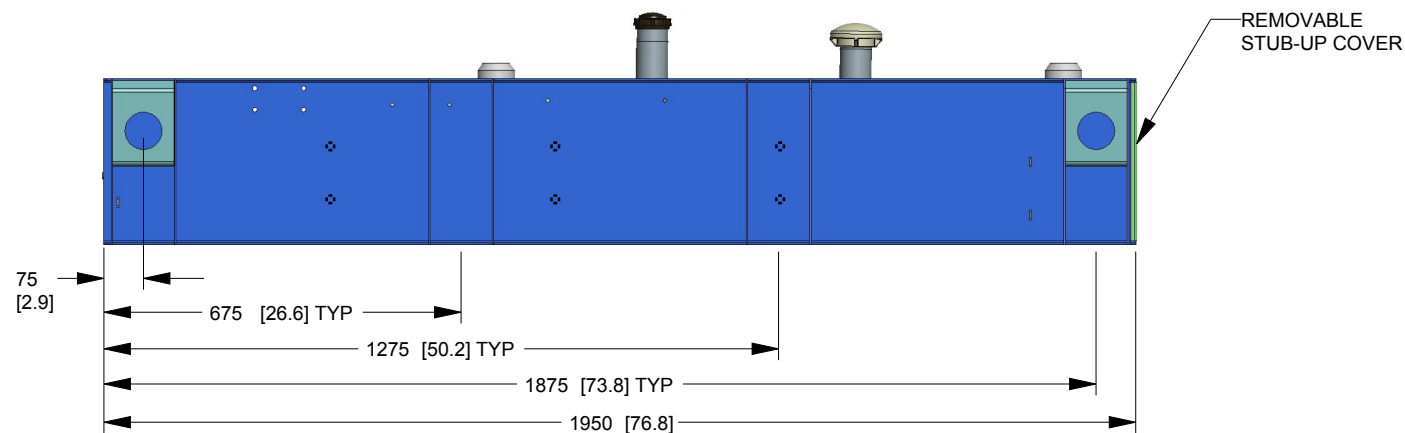

DRAWING CREATED FROM PRO/ENGINEER 3D FILE. ECO MODIFICATION TO BE APPLIED TO SOLID MODEL ONLY.

# INSTALLATION DRAWING

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. ©GENERAC POWER SYSTEMS 2013

ELECTRONICALLY APPROVED  
INSIDE WINDCHILL



TITLE  
INSTALL STUP-UP VIEW CPL PROT G3.4L  
EXTENDED TANK

ISSUE DATE:

SIZE B	CAGE NO	DWG NO 0K3529A	REV A
SCALE	0.029	WT-KG	SHEET 2 of 2