



NOTE: INSTALLATION MUST MEET ALL
NATIONAL, STATE AND LOCAL
ELECTRICAL CODES.

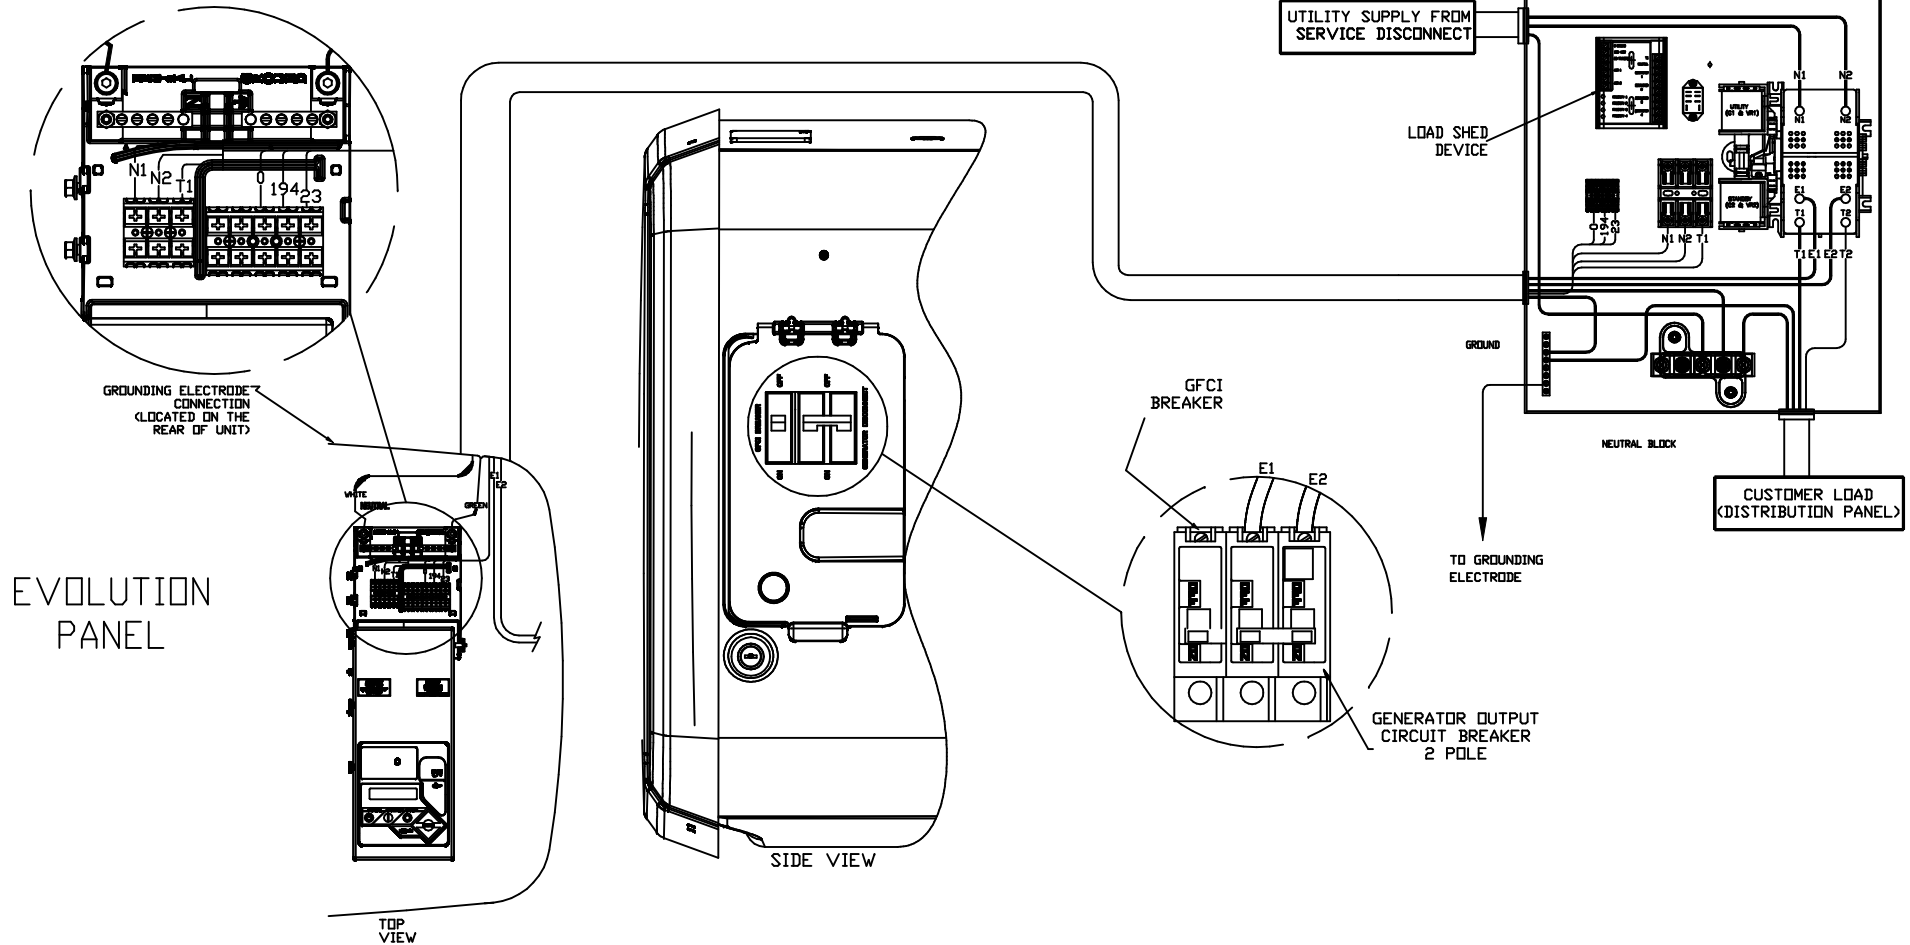

EXPLODED VIEW:
NON SERVICE ENTRANCE ATS
DRAWING #0K2516

NOTE: INSTALLATION MUST MEET ALL
NATIONAL, STATE AND LOCAL
ELECTRICAL CODES.

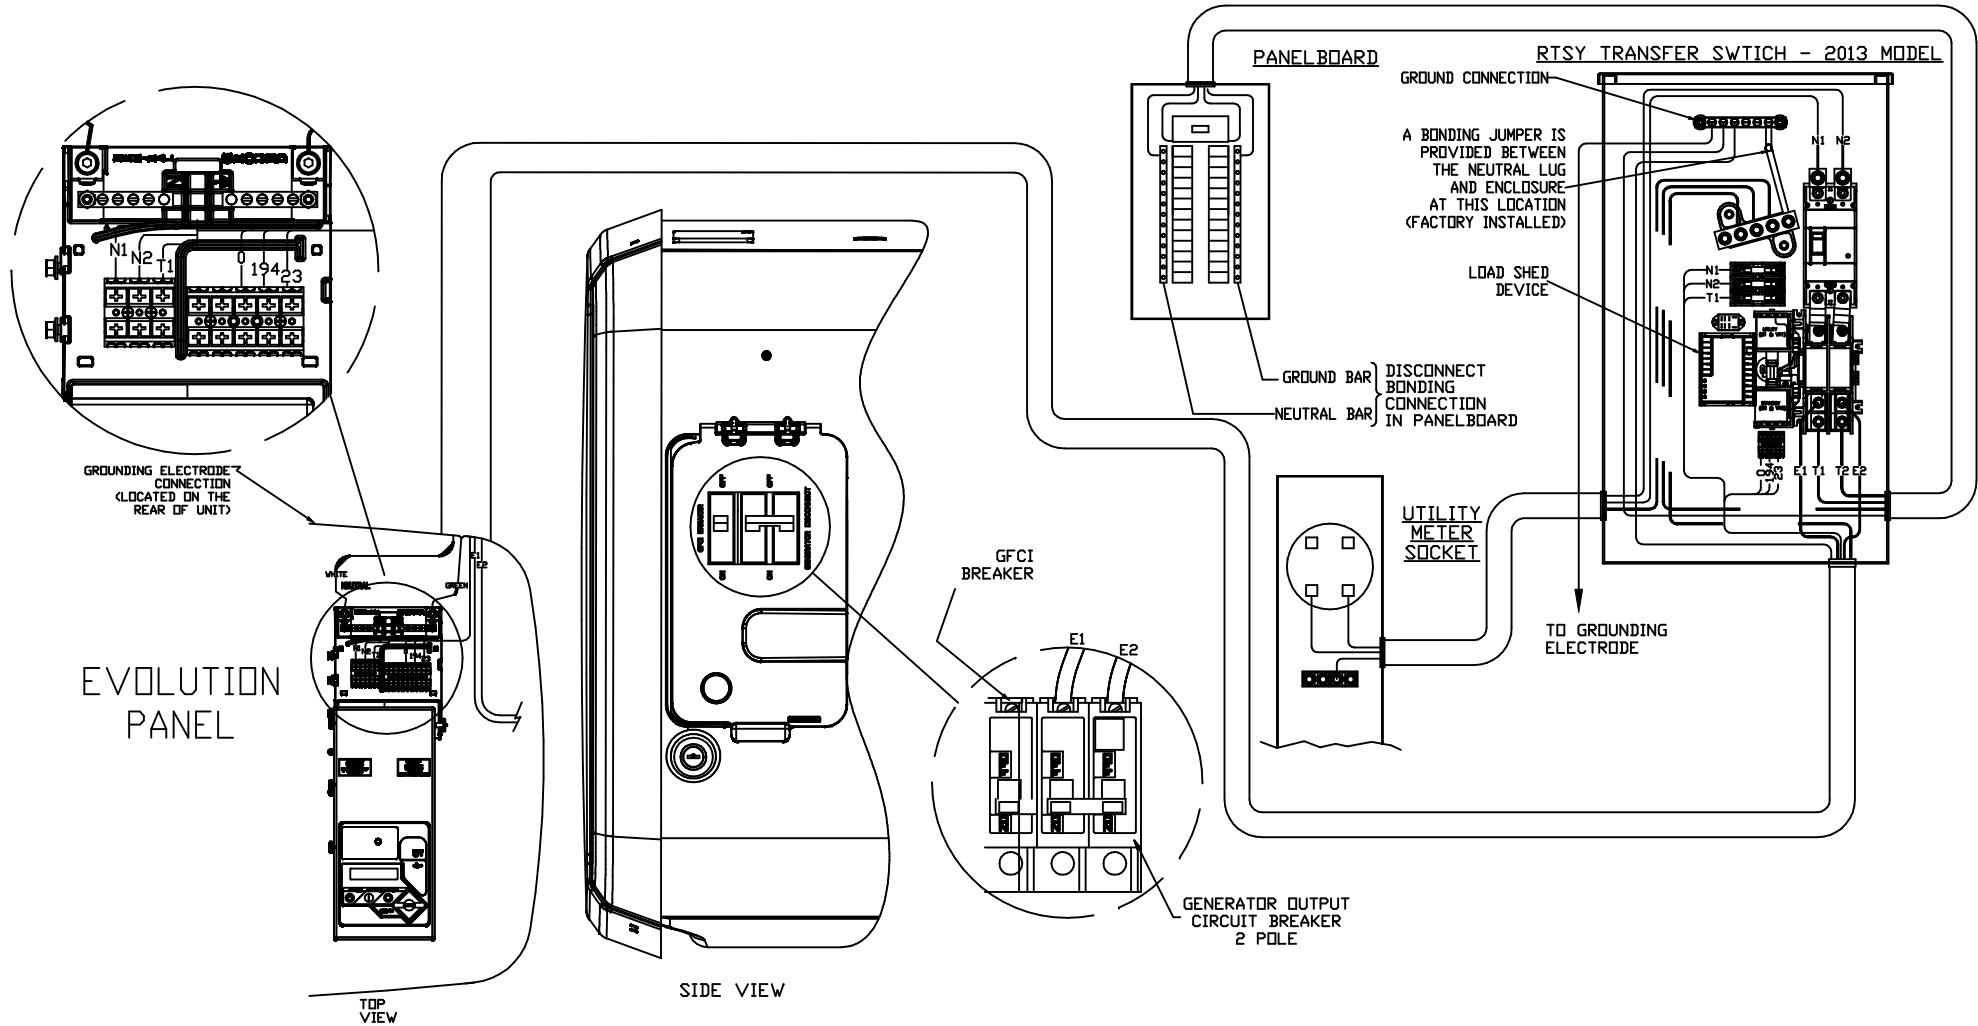

EXPLODED VIEW:
NON SERVICE ENTRANCE ATS
DRAWING #0K2516