


Bl	Black
R	Red
W	White
GRN/YEL	Green/Yellow
Br	Brown
Bu	Blue
O	Orange
Bl/W	Black/White

REVISIONS				
REV	ECO/ENG	DESCRIPTION	DATE	BY
0	0879/DAB	RELEASED	2/11/2015	LFL
A	CN-1361	RELEASED AT GENERAC	6/6/2016	NSK

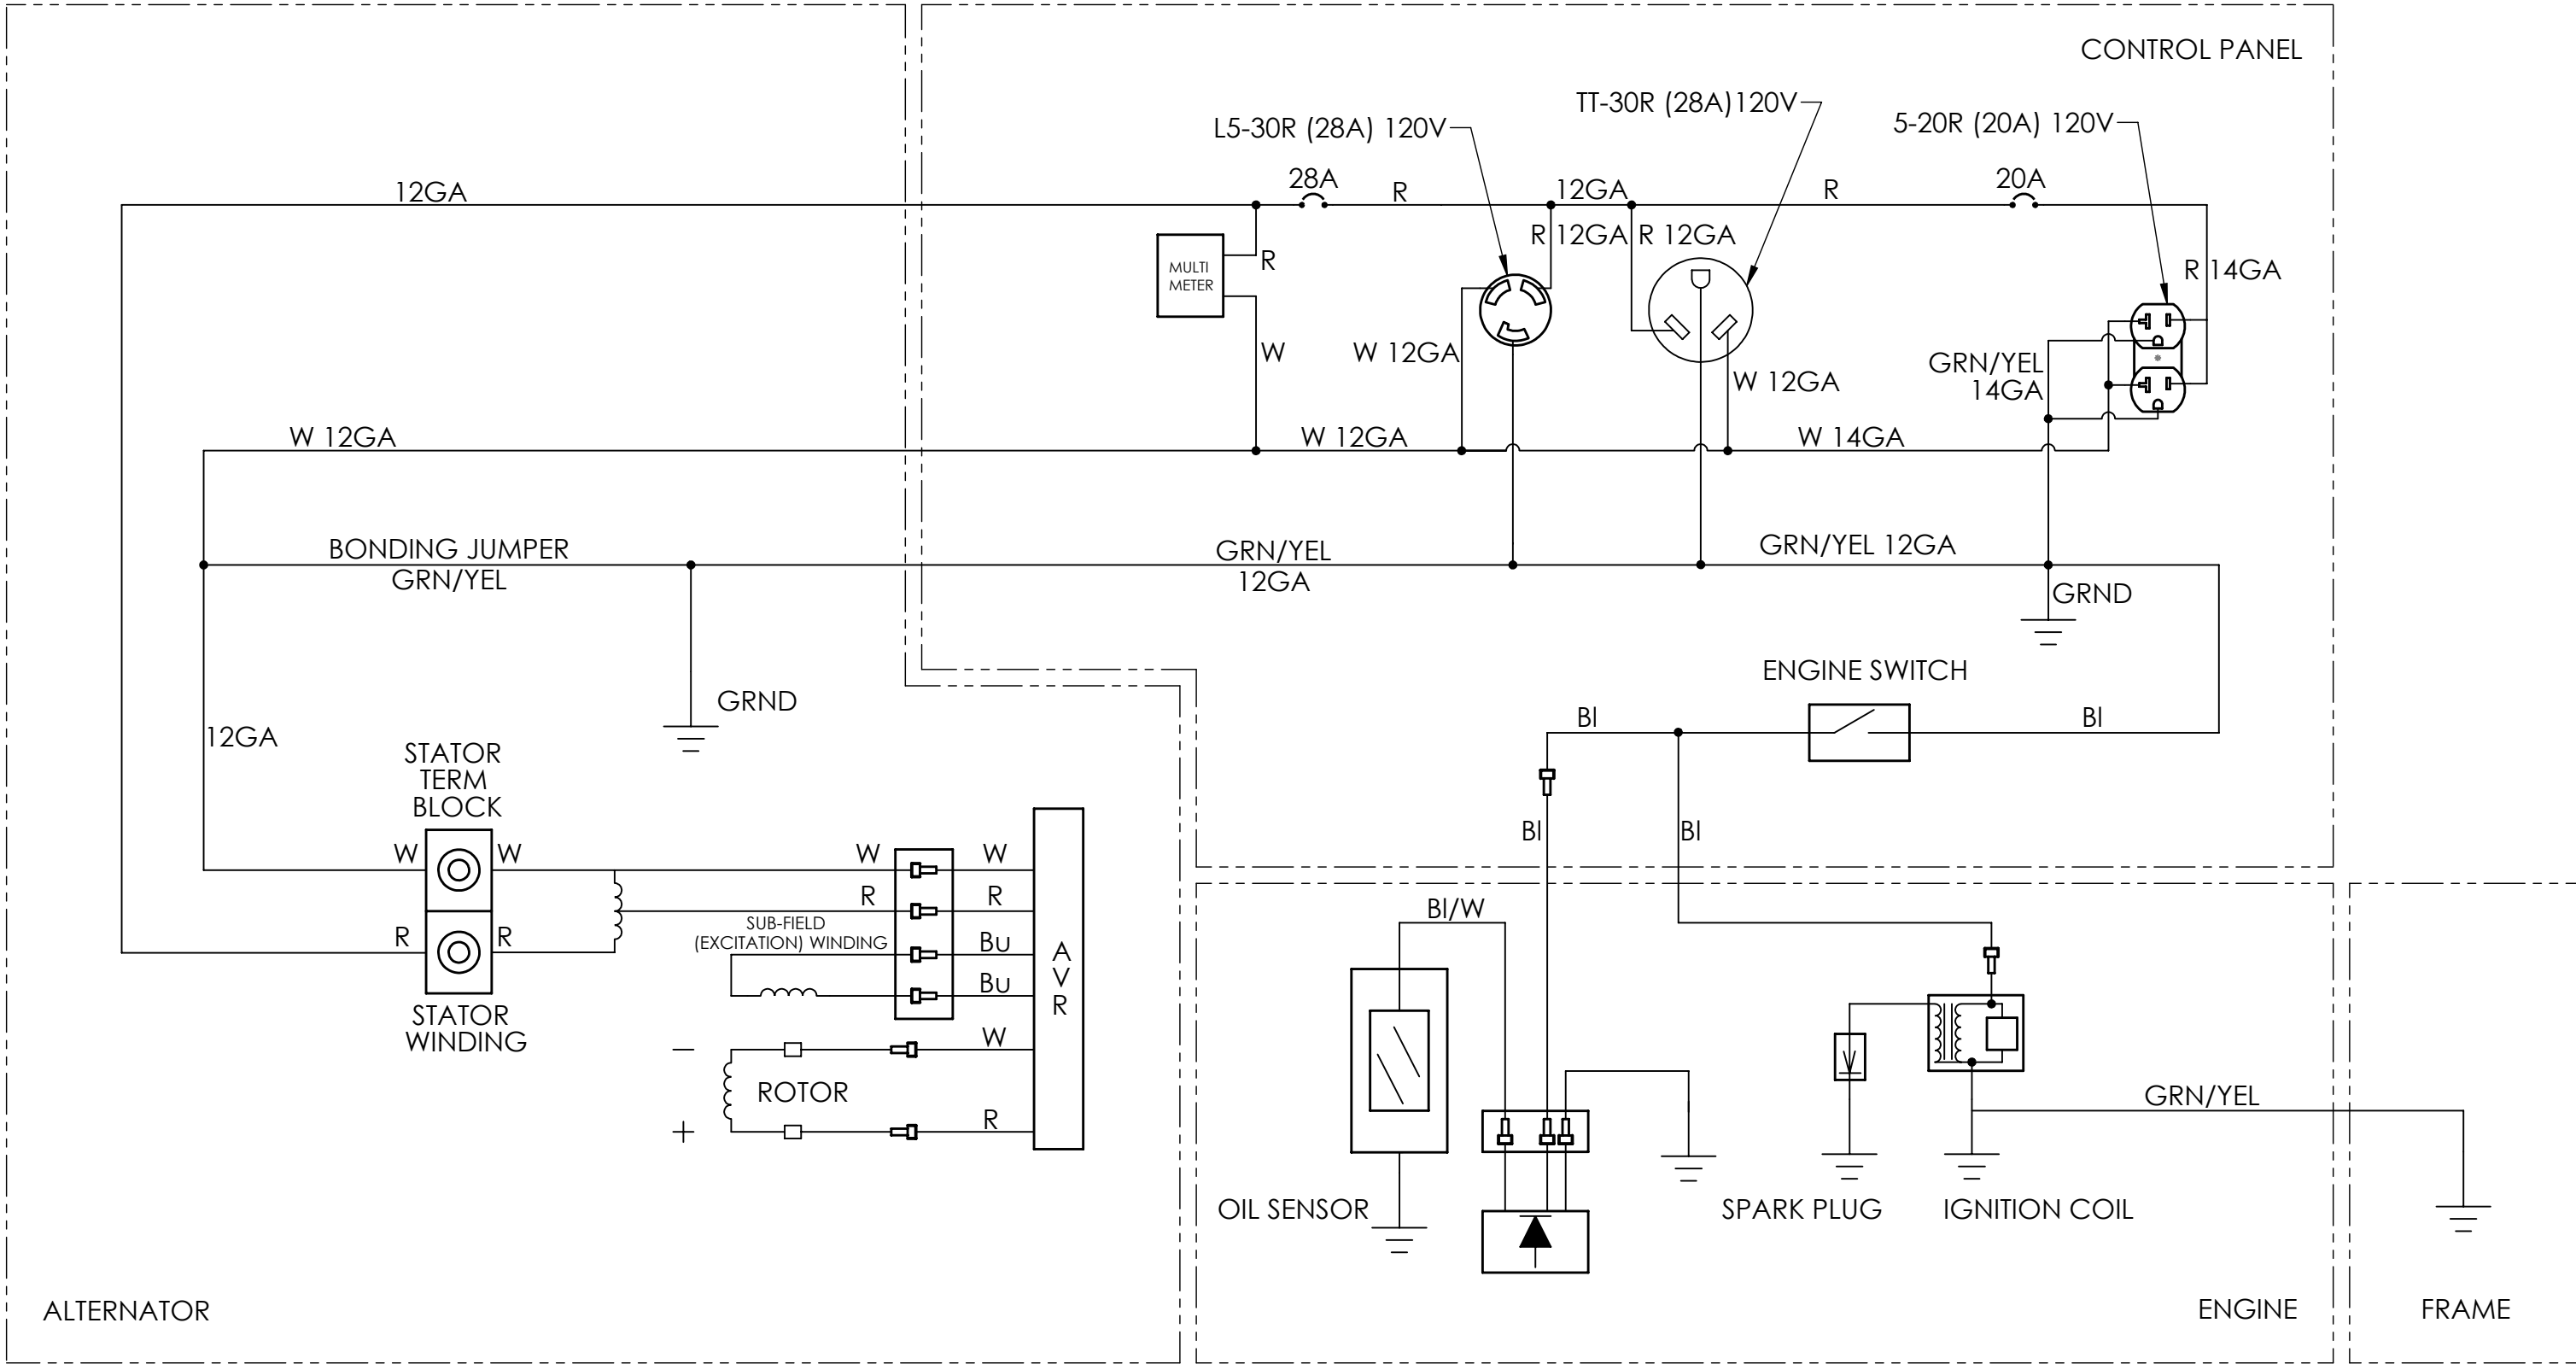

- NOTES:
1. ALL RECEPTACLES TO BE CSA OR cUL APPROVED
 2. ALL CIRCUIT BREAKERS TO BE CSA OR cUL APPROVED
 3. WIRES TO BE CSA OR cUL APPROVED
 4. WIRES SHOULD BE INSULATED STRANDED COPPER WIRE RATED FOR 105° AND 600V
 5. WIRE GAUGE: AS MARKED, (FOR ALL WIRES IN CONTROL PANEL EXCEPT FOR HOUR METER AND ENGINE SWITCH)

GROUNDING SYSTEM: NEUTRAL BONDED TO FRAME

(A)

<div>NOTICE</div> <div>GENERAC POWER SYSTEMS, INC HAS GIVEN YOU USE OF THIS PRINT FOR THE PURPOSE OF PERMITTING YOU TO QUOTE ON OR FILL AN ORDER FOR US. IT IS YOUR DUTY TO KEEP THIS CONFIDENTIAL, AND NOT PERMIT DUPLICATION. THANK YOU</div>	<div>DO NOT SCALE</div> <div>DIMENSIONS ARE IN INCHES UNLESS OTHERWISE SPECIFIED</div> <div>TOL ON DECIMALS: .XX ± .03</div> <div> </div>
---	--