


0K2438

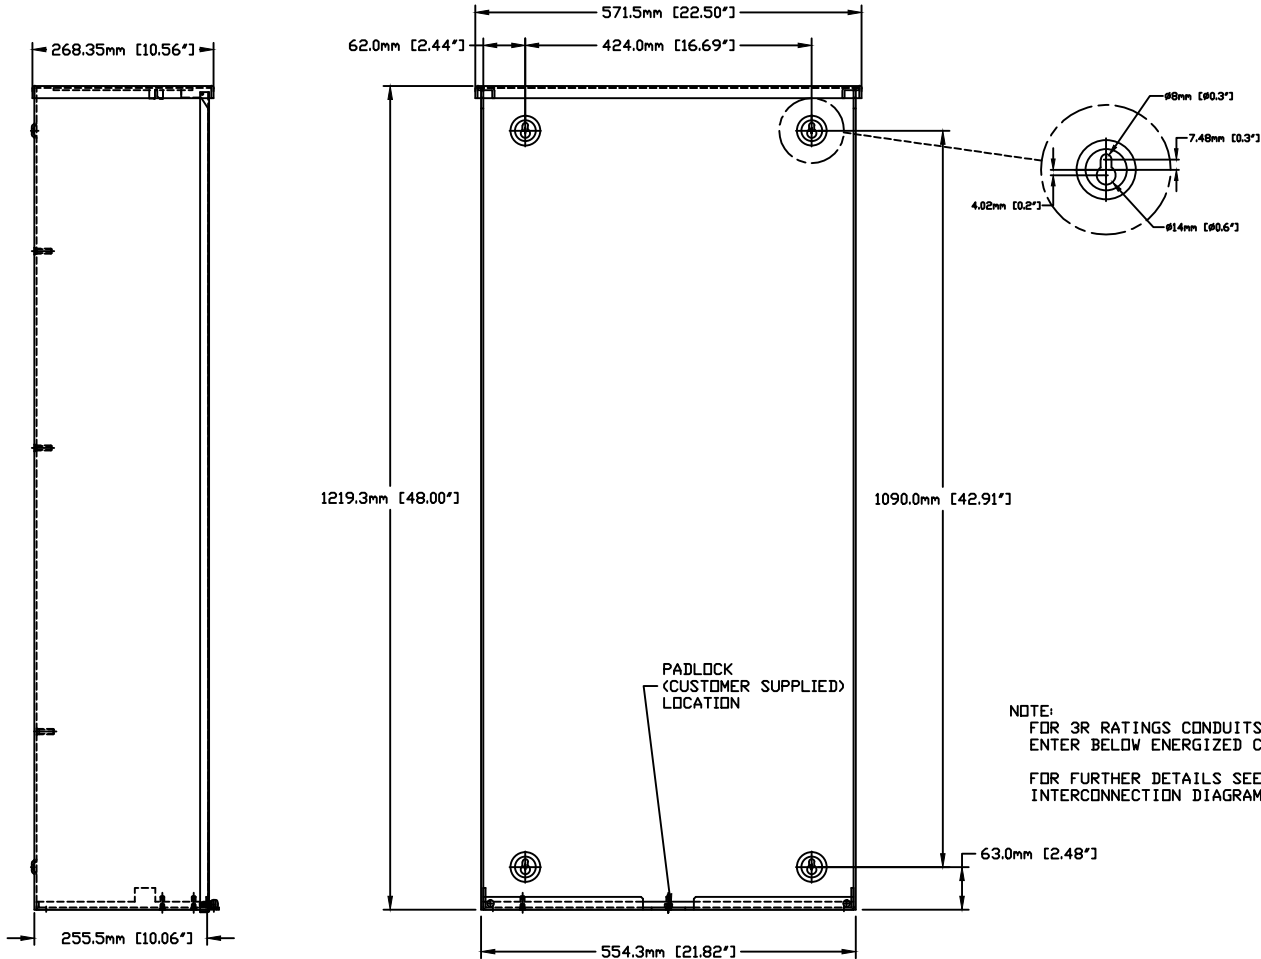

NOTE:
FOR 3R RATINGS CONDUITS MUST
ENTER BELOW ENERGIZED COMPONENTS
FOR FURTHER DETAILS SEE
INTERCONNECTION DIAGRAM IN THIS MANUAL.

-A-	RELEASED FOR PRODUCTION

GENRAC POWER SYSTEMS
11430N-1984

EST. VT.

FINAL VT.

DO NOT SCALE

ALL DIMENSIONS AND
TOLERANCES PER
ASME Y14.5M-1994

UNLESS OTHERWISE
SPECIFIED

ALL DIMENSIONS
ALL DIMENSIONS
ALL DIMENSIONS

DRAWING TITLE

INSTALLATION DRAWING

400A SERVICE ENTRANCE

MATERIAL

N/A

DATE

3/6/13

DATE

3/10/13

DATE

3/12/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

DATE

3/10/13

GENRAC POWER

SYSTEMS

Waukesha, WI 53187

P.O. BOX 8

Waukesha, WI 53187

SCALE

1 = 5

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

DATE


2013 RTSY

DATE

2013 RTSY

DATE

2013 RTSY

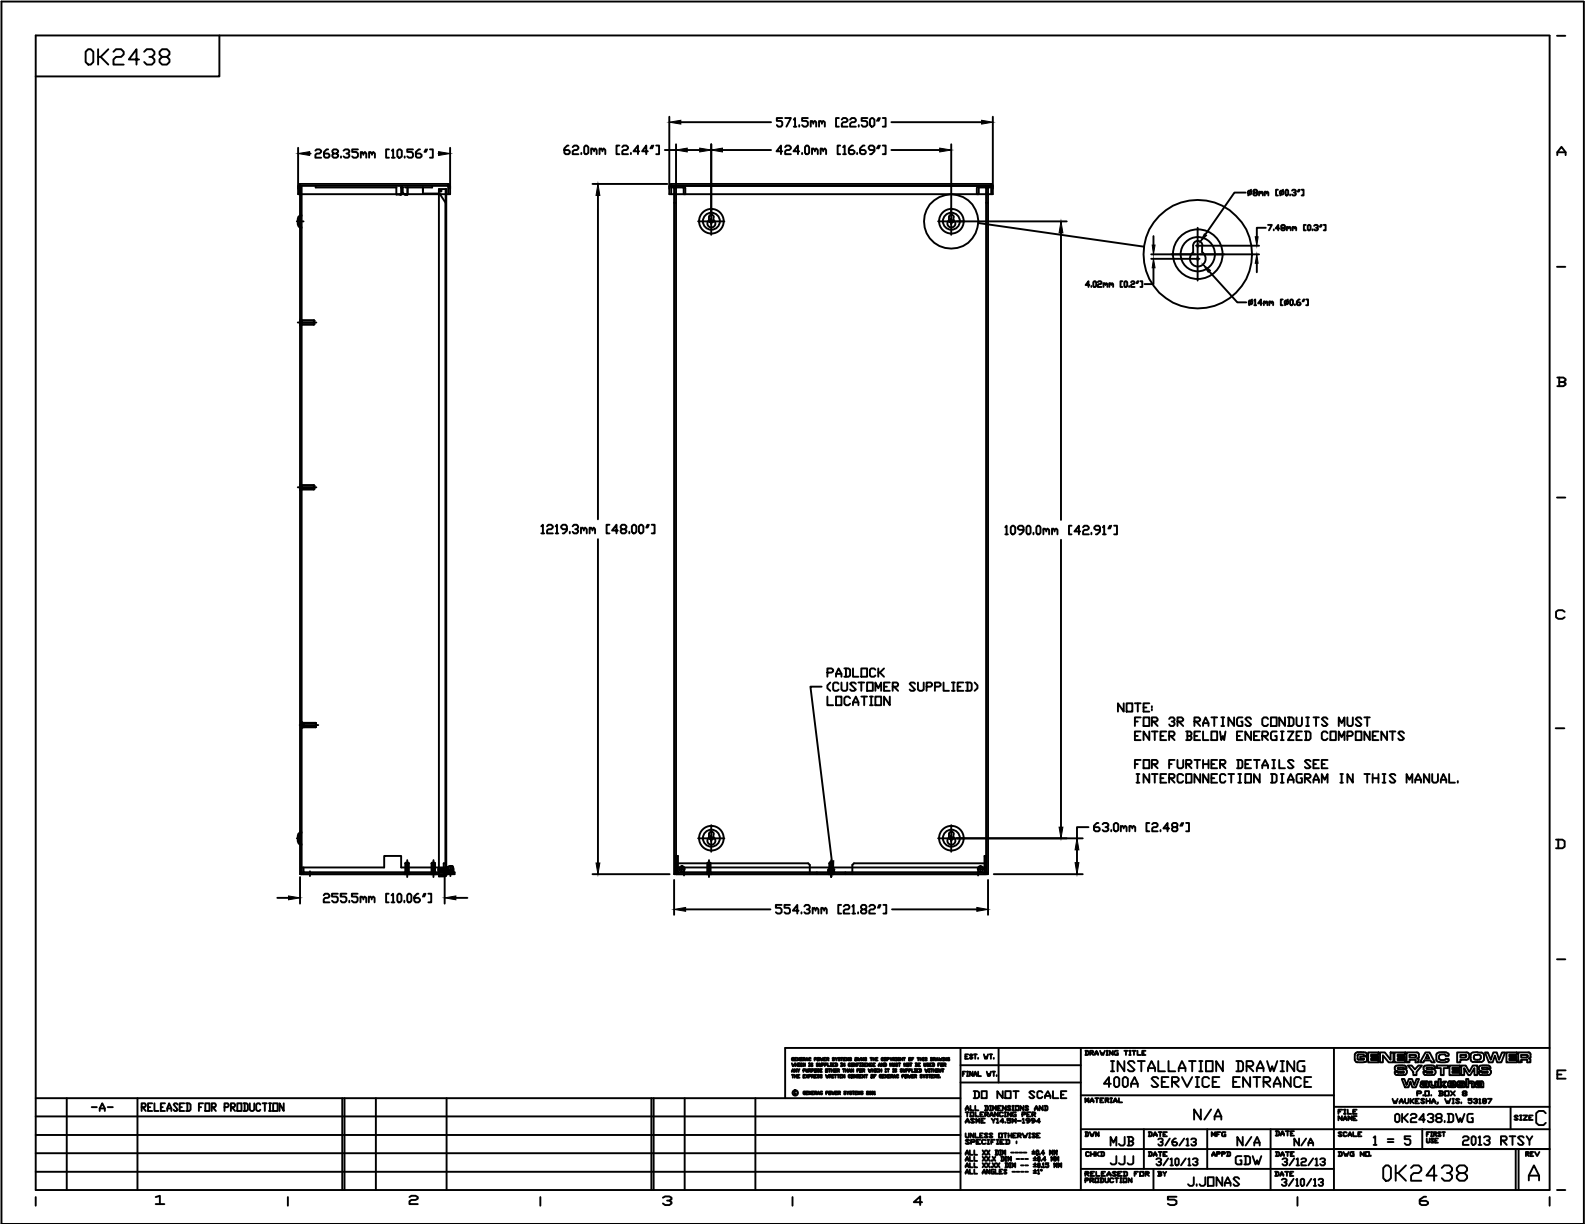

THIS PAGE IS LEFT INTENTIONALLY BLANK

