




GROUP G

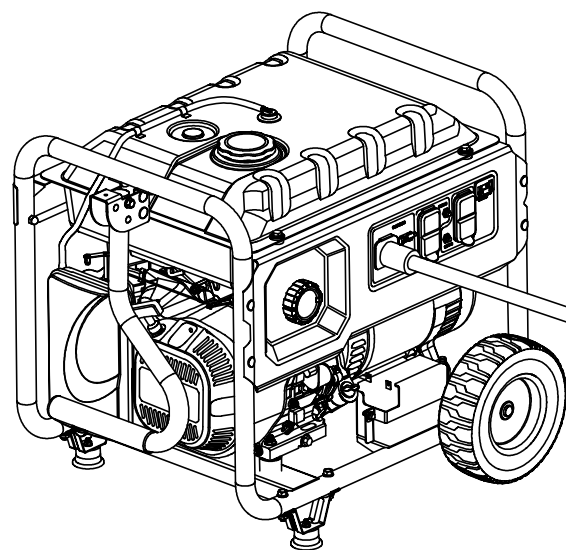


POWER INLET BOX



8 CIRCUIT TRANSFER SWITCH

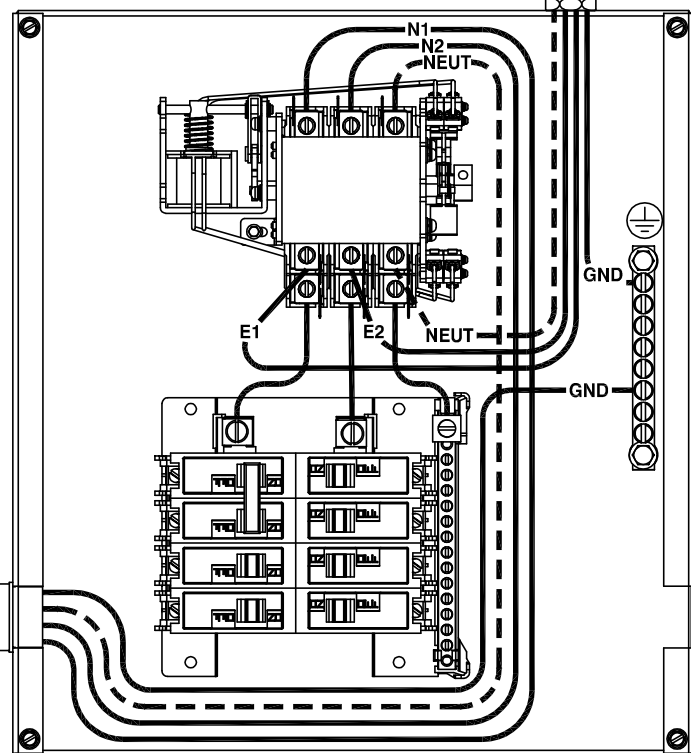

* NOTE:
WHEN UTILIZED IN THIS APPLICATION
A GROUNDING ELECTRODE MAY BE
REQUIRED BY LOCAL CODE TO BE
CONNECTED TO THE GENERATOR.

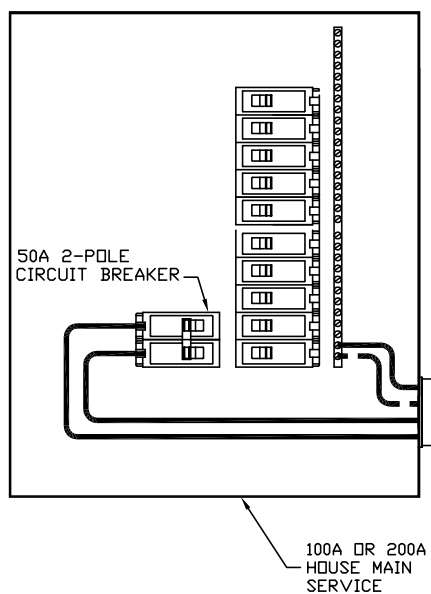

EXPLODED VIEW: INSTALLATION MANUAL TRANSFER

DRAWING #: 0K8845

APPLICABLE TO:

GROUP G

THIS PAGE IS LEFT INTENTIONALLY BLANK