



NOTE: INSTALLATION MUST MEET ALL  
NATIONAL, STATE AND LOCAL  
ELECTRICAL CODES.

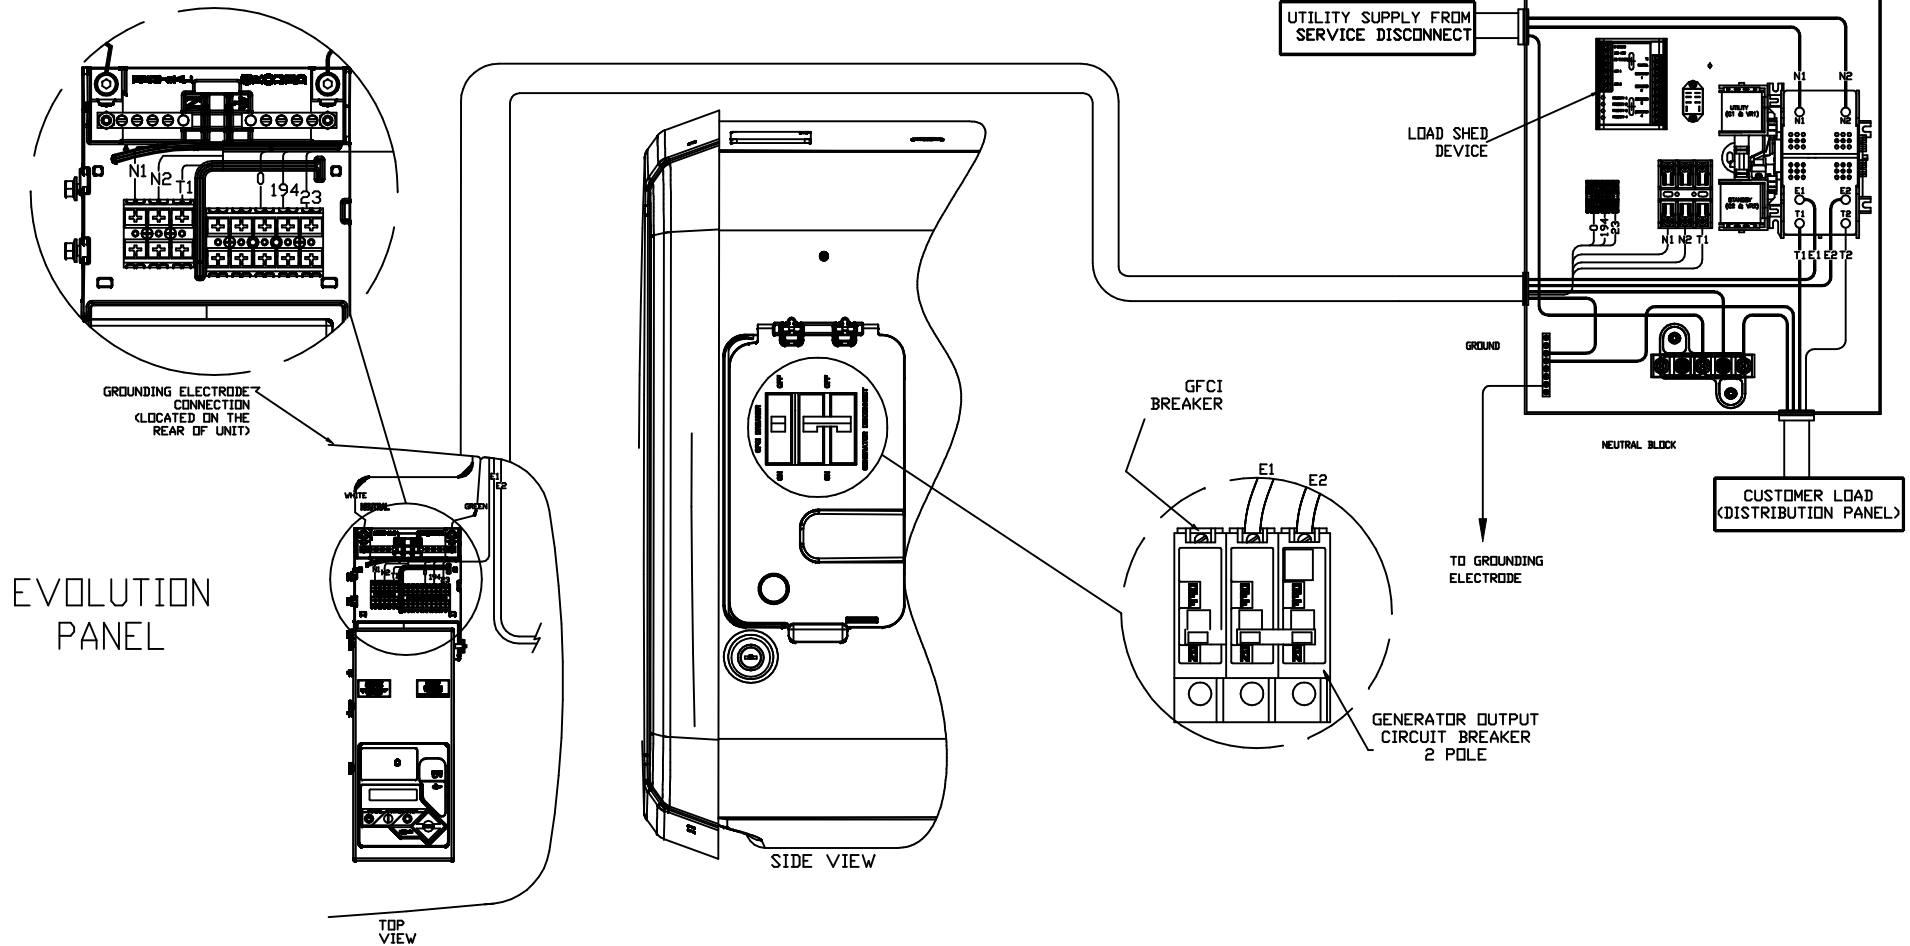

NOTE: INSTALLATION MUST MEET ALL  
NATIONAL, STATE AND LOCAL  
ELECTRICAL CODES.

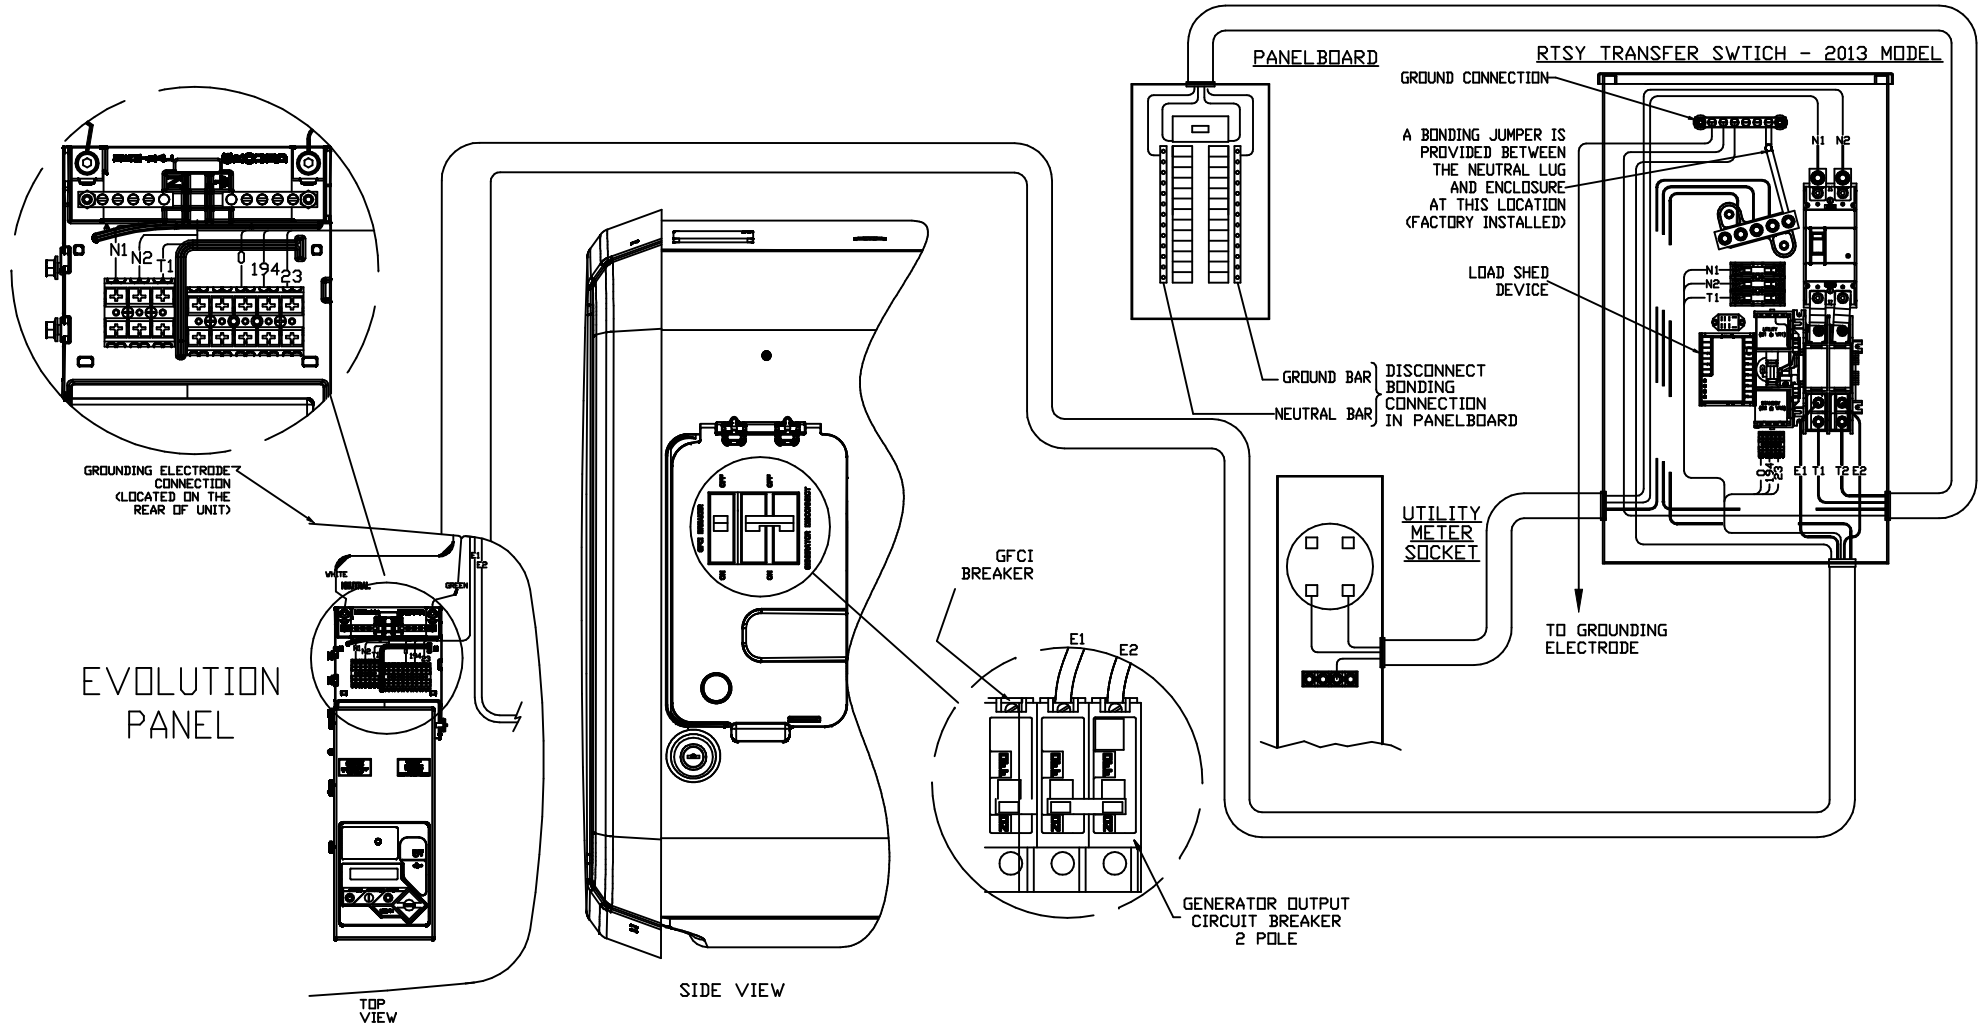

EXPLODED VIEW:  
NON SERVICE ENTRANCE ATS  
DRAWING #0K2516