


0L2827

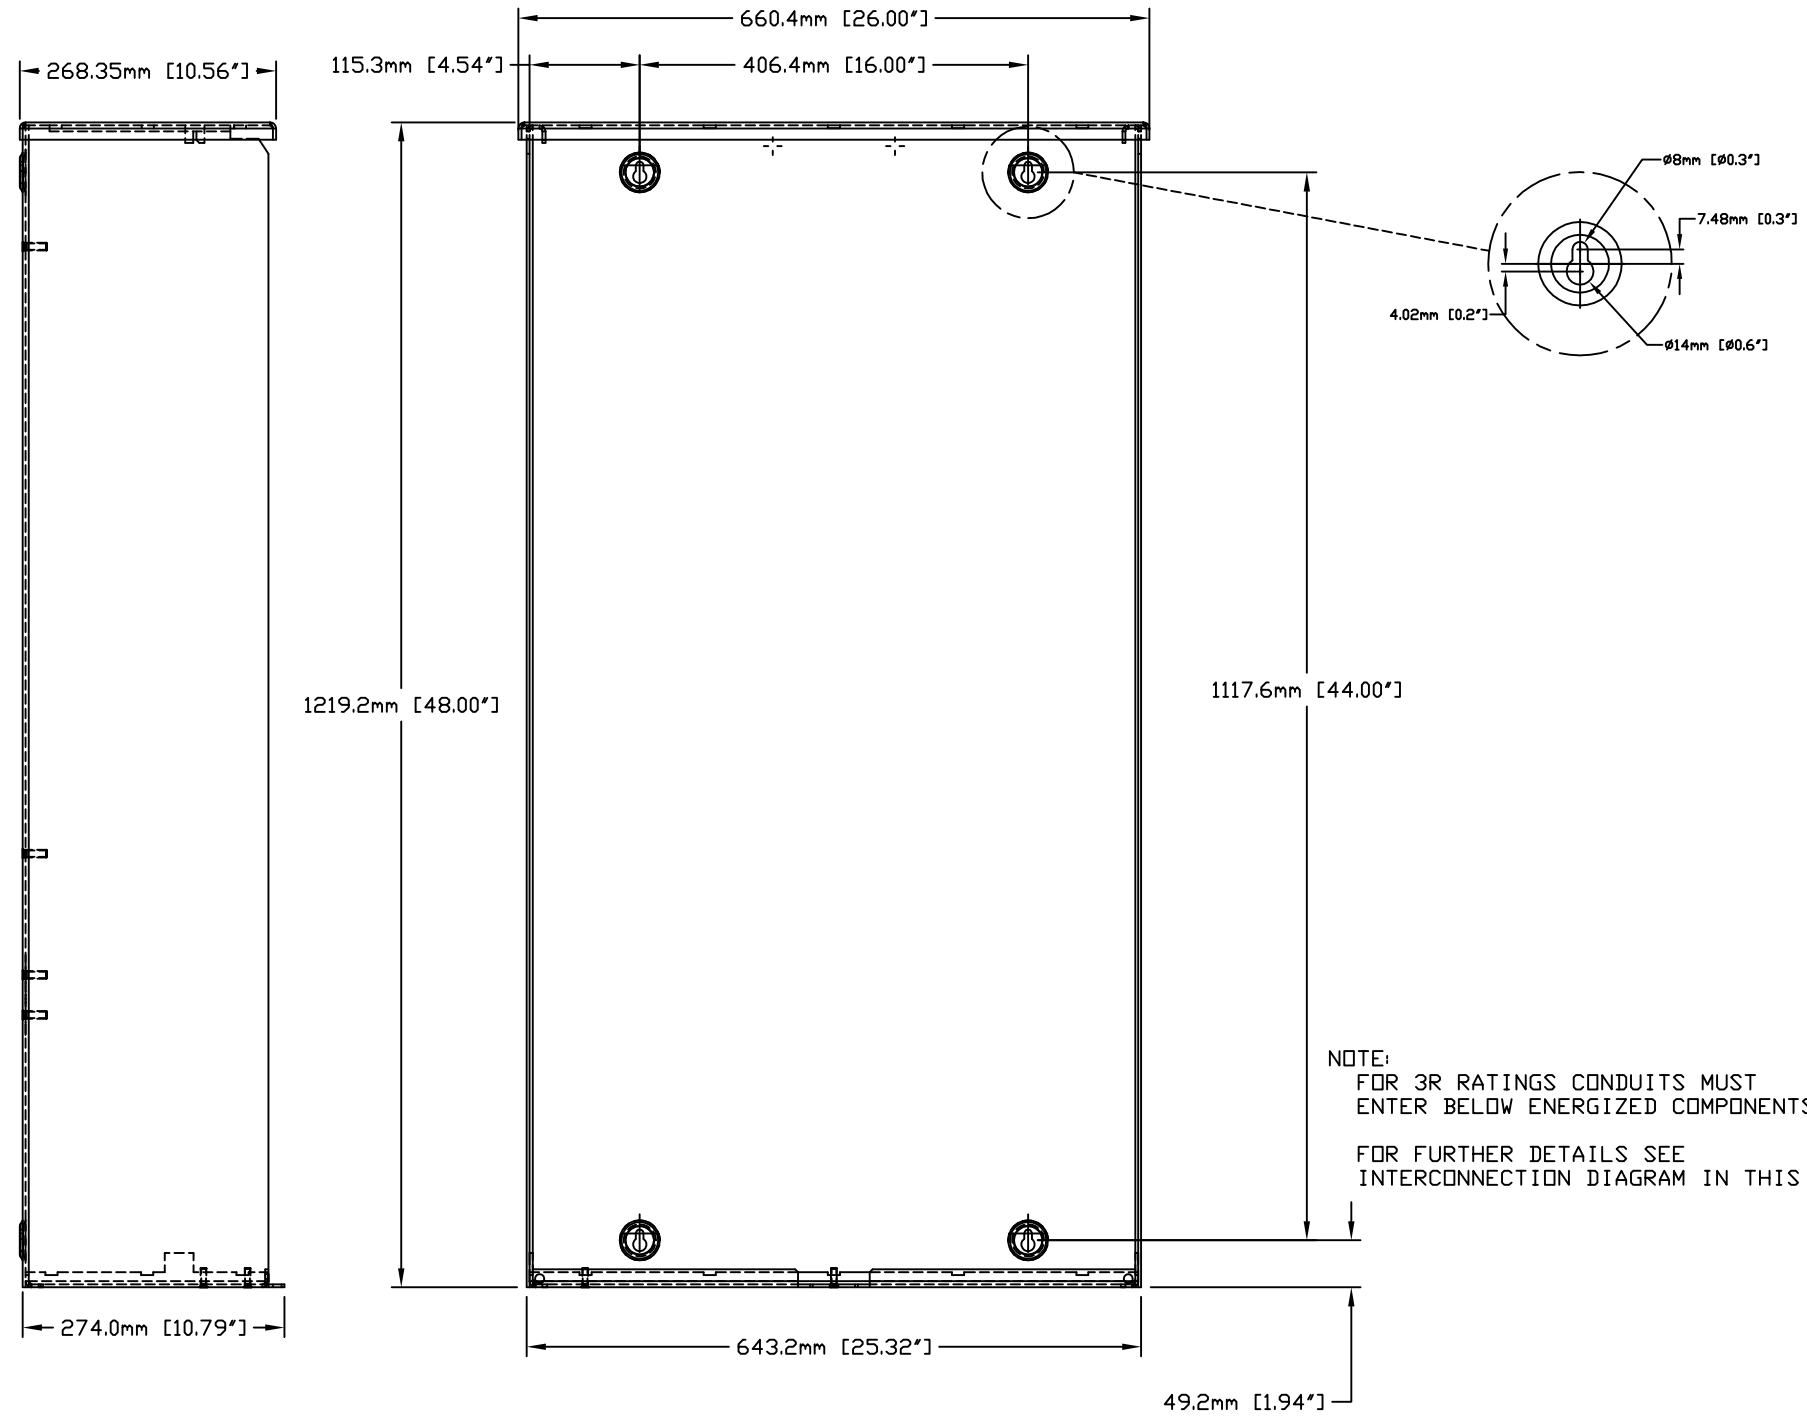

NOTE:  
FOR 3R RATINGS CONDUITS MUST  
ENTER BELOW ENERGIZED COMPONENTS  
  
FOR FURTHER DETAILS SEE  
INTERCONNECTION DIAGRAM IN THIS MANUAL.

<small>GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS. © GENERAC POWER SYSTEMS 2011</small>				EST. WT.	DRAWING TITLE			<b>GENERAC POWER SYSTEMS</b> <b>Waukesha</b> P.O. BOX 8 WAUKESHA, WIS. 53187	
				FINAL WT.	INSTALLATION DRAWING 400A SERVICE ENTRANCE			FILE NAME	SIZE
				DO NOT SCALE		MATERIAL			SCALE
				ALL DIMENSIONS AND TOLERANCING PER ASME Y14.5M-1994		N/A			1 = 5
				UNLESS OTHERWISE SPECIFIED:		DWN	DATE	MFG	DATE
				ALL XX DIM --- ±0.4 MM		MJB	8/20/15		
				ALL XXX DIM --- ±0.4 MM		CHKD	DATE	APPD	DATE
				ALL XXXX DIM --- ±0.15 MM		RELEASED FOR PRODUCTION			DWG NO.
				ALL ANGLES --- ±1°					0L2827
									REV
									A

1 1 2 1 3 1 4 1 5 1 6 1