


CONNECTION PANEL
LIQUID-COOLED ENGINE GENERATOR

UTILITY
METER
SOCKET

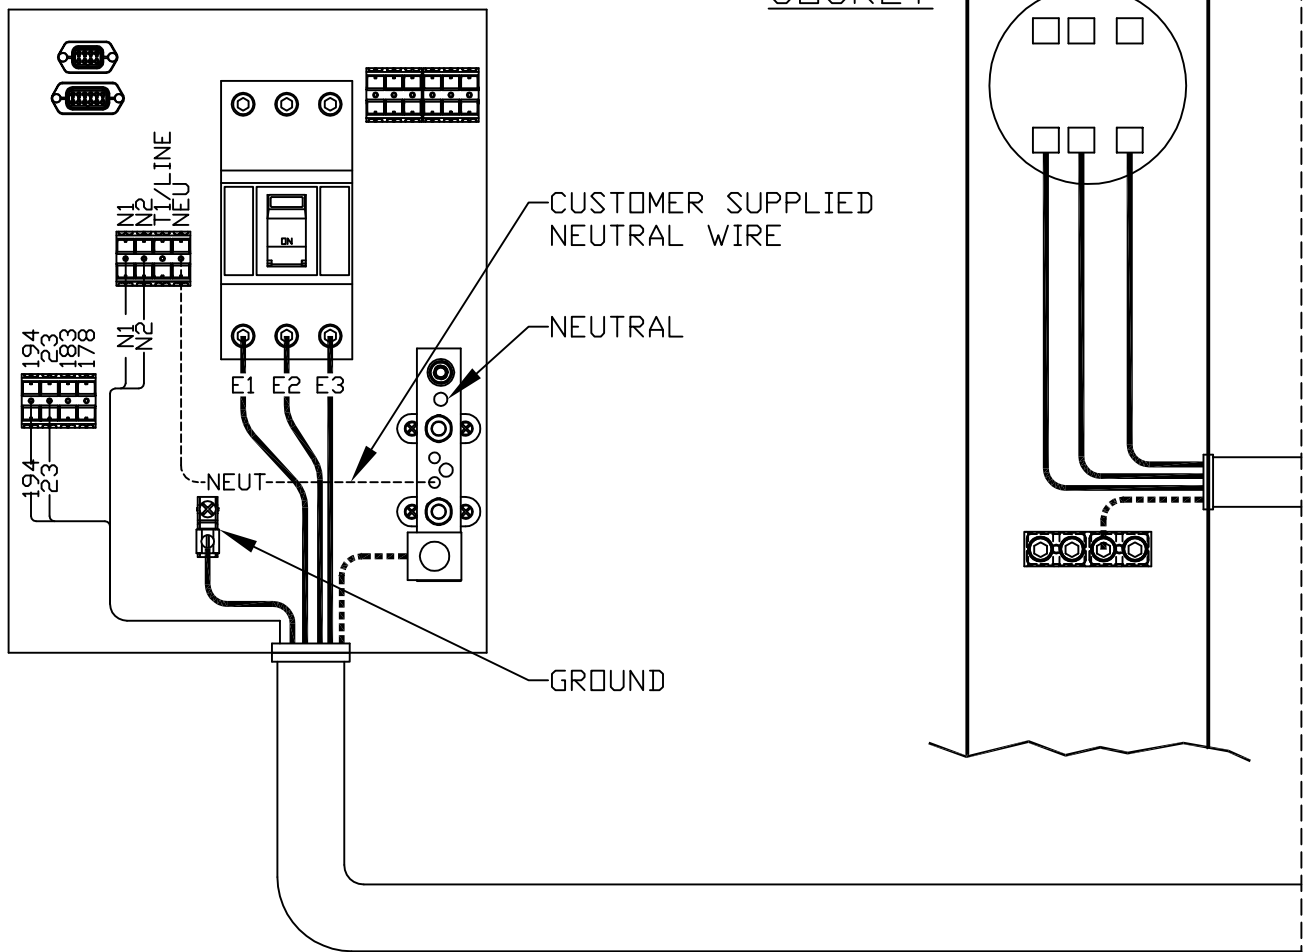

MATCH WIRE
NUMBERS TO
TERMINAL NUMBERS

100/200 AMP

A BONDING JUMPER IS PROVIDED BETWEEN THE NEUTRAL LUG AND ENCLOSURE AT THIS LOCATION (FACTORY INSTALLED)

LIQUID COOLED INSTALLATION

SERVICE ENTRANCE
DISCONNECT ATS

INSTALLATION MUST MEET ALL NATIONAL, STATE AND LOCAL ELECTRICAL CODES.

480V MODEL WITH TRANSFORMERS SHOWN

PANELBOARD


NEUTRAL BAR
SEE PANEL MANUFACTURER FOR DETAILS

GROUND BAR


TO GROUNDING ELECTRODE

GENERATOR FEEDER AND CLASS 1 CONTROL CONDUCTORS


DISCONNECT THE BONDING CONNECTION IN PANELBOARD WHEN INSTALLING SERVICE RATED ATS

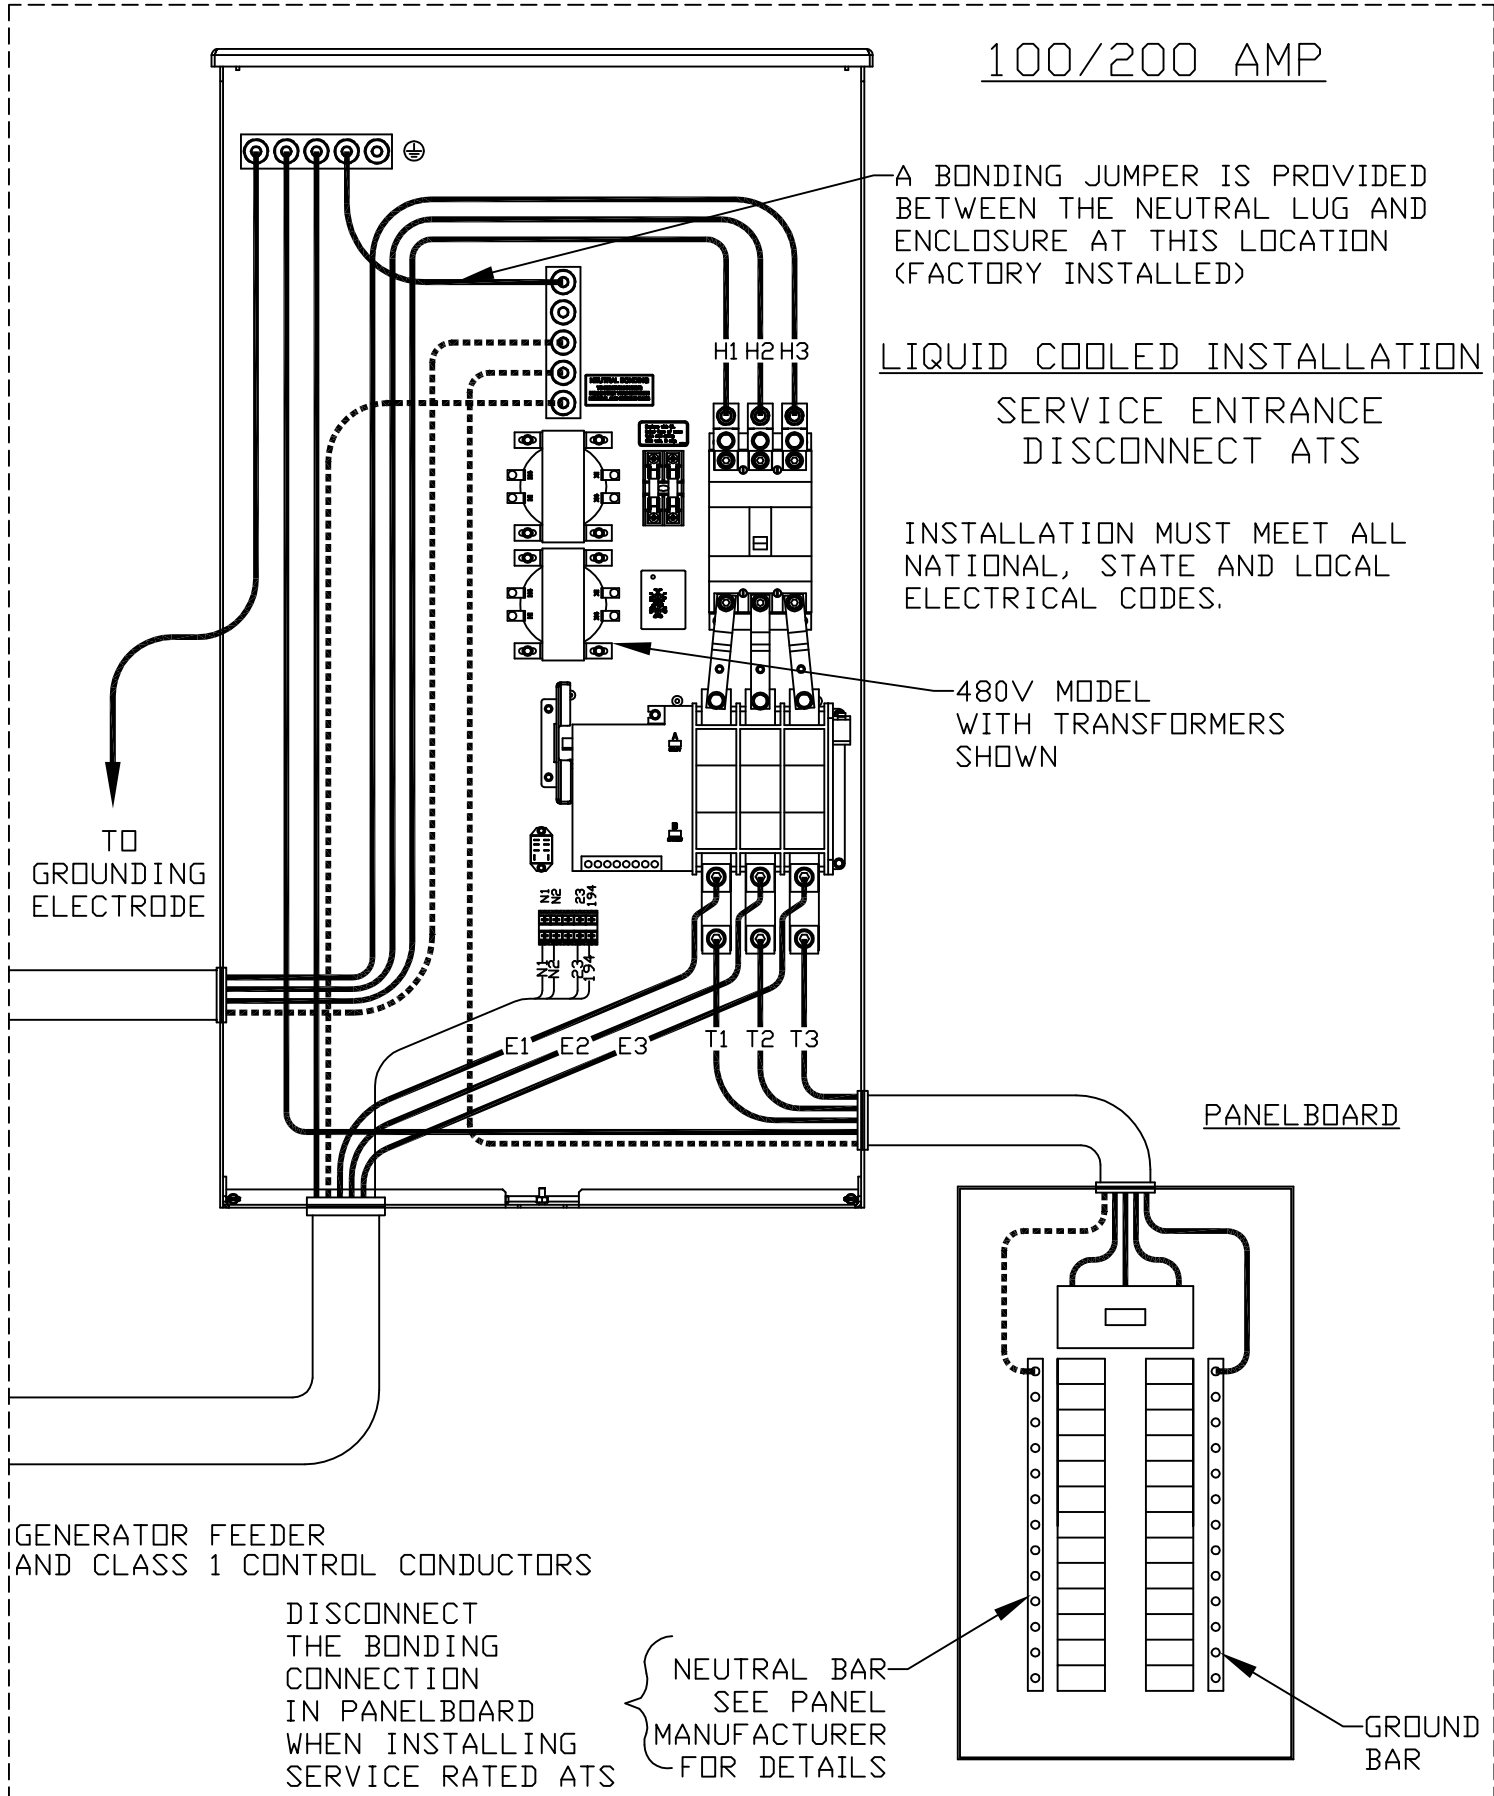

CONNECTION PANEL
LIQUID-COOLED ENGINE GENERATOR

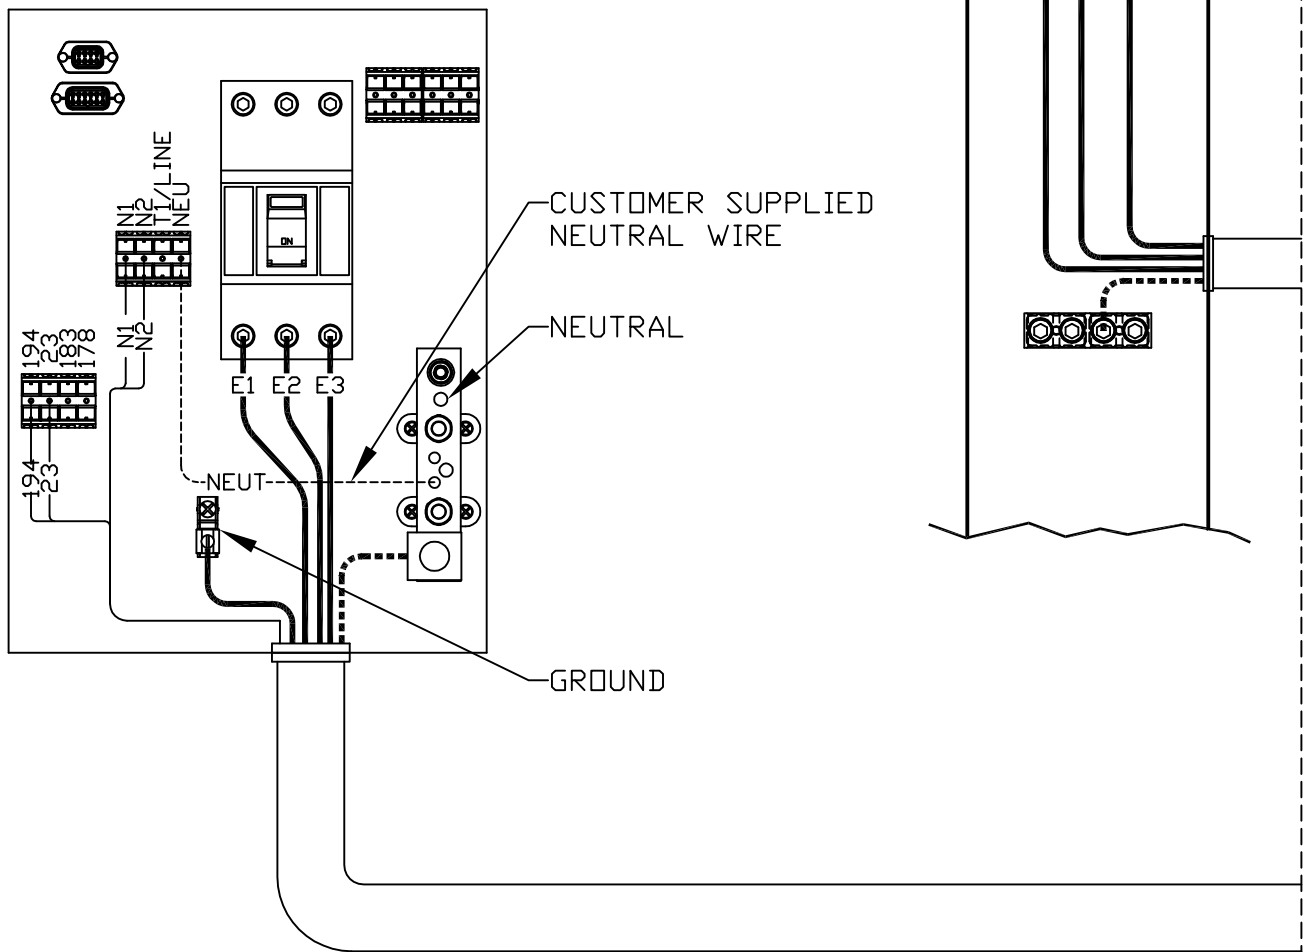

400 AMP

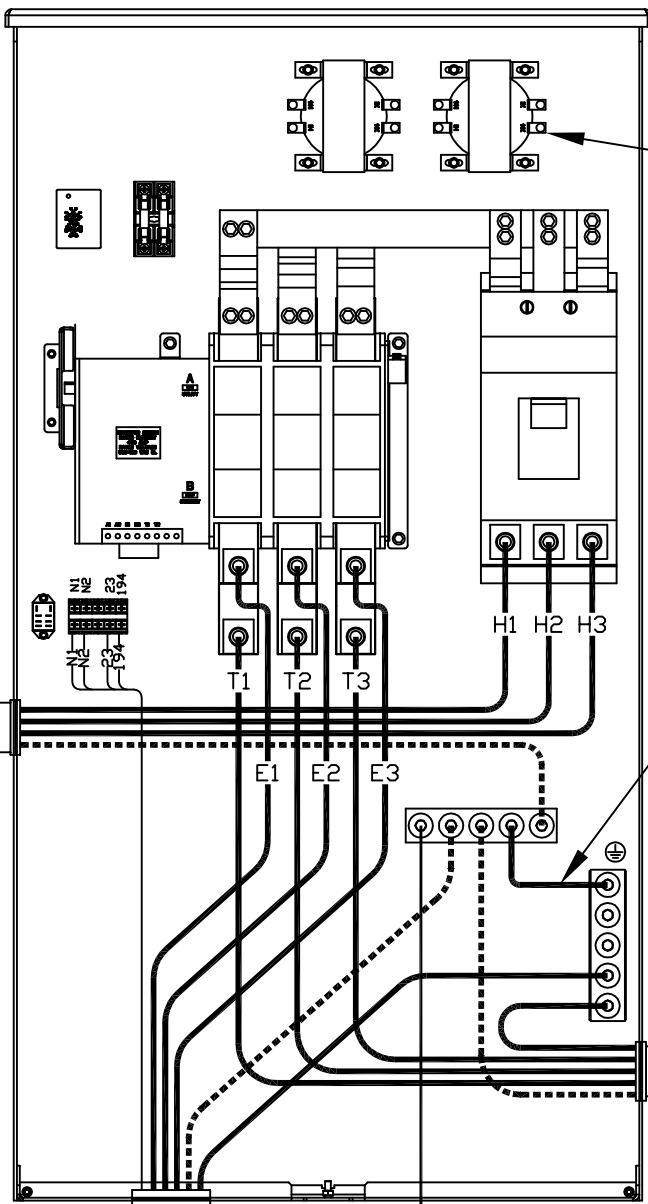

480V MODEL WITH TRANSFORMERS SHOWN

LIQUID COOLED INSTALLATION

SERVICE ENTRANCE
DISCONNECT ATS

INSTALLATION MUST MEET ALL
NATIONAL, STATE AND LOCAL
ELECTRICAL CODES.

A BONDING JUMPER IS PROVIDED
BETWEEN THE NEUTRAL LUG AND
ENCLOSURE AT THIS LOCATION
(FACTORY INSTALLED)


PANELBOARD

TO GROUNDING
ELECTRODE

GENERATOR FEEDER
AND CLASS 1 CONTROL CONDUCTORS

DISCONNECT
THE BONDING
CONNECTION
IN PANELBOARD
WHEN INSTALLING
SERVICE RATED ATS

NEUTRAL BAR
SEE PANEL
MANUFACTURER
FOR DETAILS

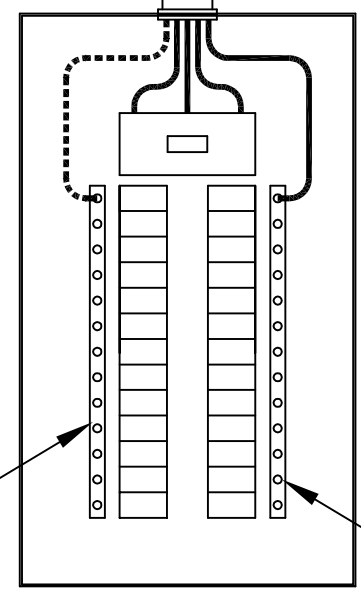

GROUND
BAR

INTERCONNECTION DRAWING

RTS SER 3 PHASE 400A

DRAWING #: 0L2828