


0L2827

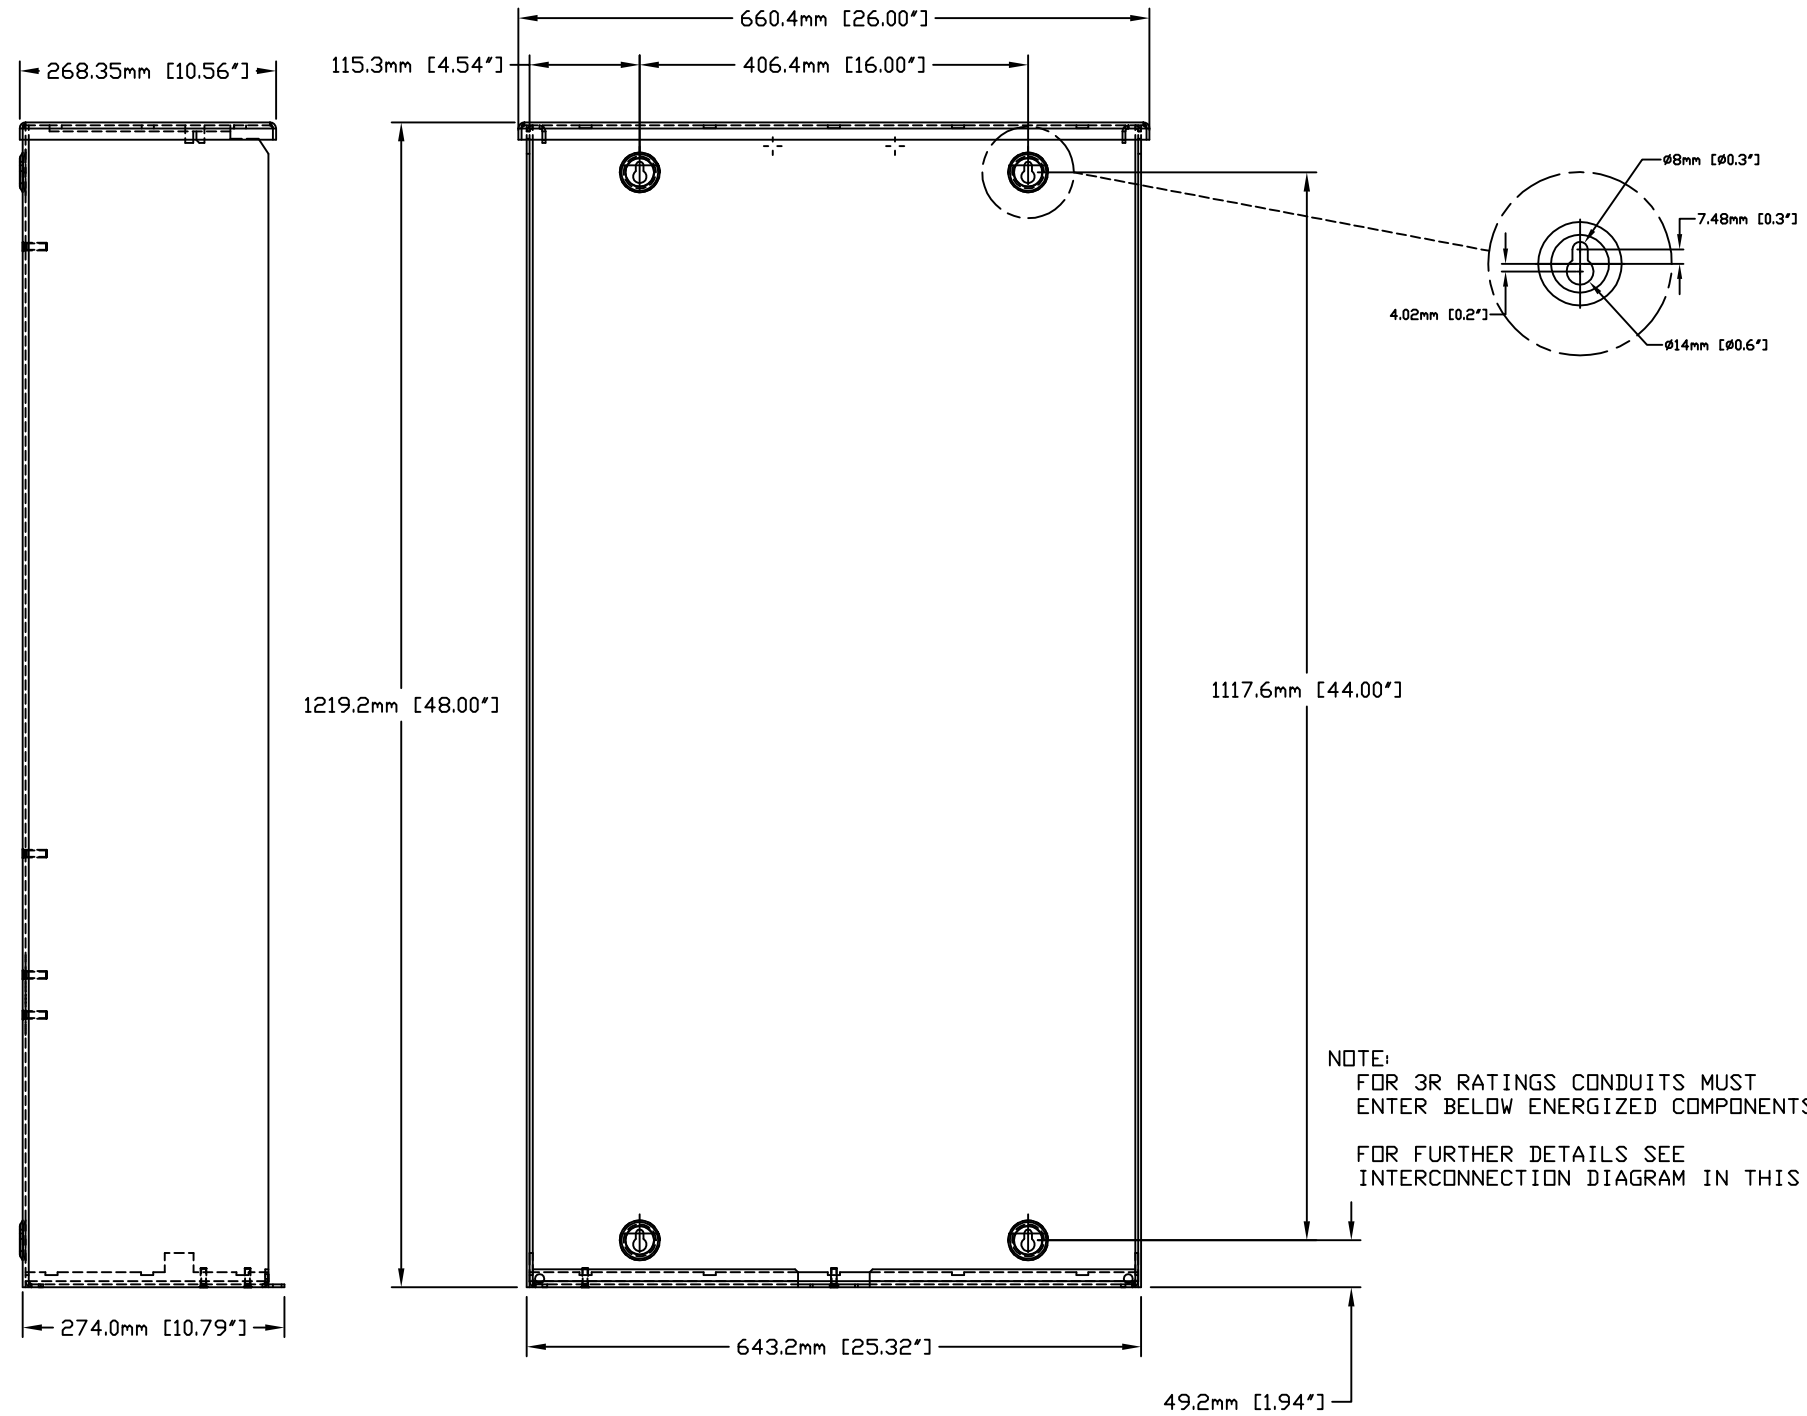

NOTE:
 FOR 3R RATINGS CONDUITS MUST
 ENTER BELOW ENERGIZED COMPONENTS
 FOR FURTHER DETAILS SEE
 INTERCONNECTION DIAGRAM IN THIS MANUAL.

<small>GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS.</small> <small>© GENERAC POWER SYSTEMS 2011</small>				EST. WT. FINAL WT.	DRAWING TITLE INSTALLATION DRAWING 400A SERVICE ENTRANCE	GENERAC POWER SYSTEMS Waukesha <small>P.O. BOX 8 WAUKESHA, WIS. 53187</small>	
DO NOT SCALE ALL DIMENSIONS AND TOLERANCING PER ASME Y14.5M-1994 UNLESS OTHERWISE SPECIFIED: ALL XX DIM --- ±0.4 MM ALL XXX DIM --- ±0.4 MM ALL XXXX DIM --- ±0.15 MM ALL ANGLES --- ±1°				MATERIAL N/A	FILE NAME 0L2827.DWG	SCALE 1 = 5	SIZE C
DWG NO. 0L2827		DATE 8/20/15		DATE 8/20/15		DATE 8/20/15	
BY MJB		APPD MJB		DATE 8/20/15		REV A	

1 1 2 1 3 1 4 1 5 1 6 1